Ⓟs 76A63JA
CE #803 (REV. 6/78)

1

APPLICATION FOR BUILDING PERMIT

COUNTY OF LOS ANGELES — **BUILDING AND SAFETY**

FOR APPLICANT TO FILL IN

BUILDING ADDRESS 15527 Ermanita Ave
CITY Gardena, CA 90249
SIZE OF LOT 100x50 NO. OF BLDGS. NOW ON LOT 1
TRACT 12340 BLOCK LOT NO. 34
OWNER Dale Whit TEL. NO. 675-5975
ADDRESS 15527 Ermanita Ave
CITY Gardena ZIP 90249
ARCHITECT OR ENGINEER TEL. NO.
ADDRESS
CONTRACTOR Allstate Builders TEL. NO. 557-2480
ADDRESS 2029 Century Park E LIC. NO. 316523
CITY L.A LIC. CLASS General
CONSTRUCTION LENDER NAME AND BRANCH
ADDRESS CITY
SQ. FT. SIZE NO. OF STORIES 1 NO. OF FAMILIES
CHECK ONE: NEW ☐ ADD ☐ ALTER ☒ REPAIR ☐ DEMOL ☐
DESCRIPTION OF WORK
Installation of new window 3'x6' w/Header - Removal of 6' wall (Bearing) with installation of new Heater - move 32" door with Header.
USE OF EXISTING BLDG.
APPLICANT (PRINT) TEL NO.
BY (SIGNATURE)

I HEREBY ACKNOWLEDGE THAT I HAVE READ THIS APPLICATION AND STATE THAT THE ABOVE IS CORRECT AND AGREE TO COMPLY WITH ALL ORDINANCES AND LAWS REGULATING BUILDING CONSTRUCTION. I CERTIFY THAT IN DOING THE WORK AUTHORIZED HEREBY I WILL NOT EMPLOY ANY PERSON IN VIOLATION OF THE LABOR CODE OF THE STATE OF CALIFORNIA IN RELATING TO WORKMEN'S COMPENSATION INSURANCE.

SIGNATURE OF PERMITTEE Mark Whitney
ADDRESS
CITY TEL. NO.

USE ZONE R-1 MAP NO. 4140
SPECIAL CONDITIONS
FINAL DATE BY

Expired 5/25/82 Nelson No progress

BUILDING ADDRESS 15527 Ermanita Ave
LOCALITY Gardena CA
NEAREST CROSS ST. CERISE
ASSESSOR MAP BOOK 4070 PAGE 22 PARCEL 23
DISTRICT 7 GROUP R-3 TYPE CONST. V FIRE ZONE 3 PROCESSED BY Shilif
STATISTICAL CLASSIFICATION CLASS NO. 21 DWELL. UNITS Ø SEWER MAP E BK 37 PG
VALUATION $ 1,000

BLDG. SETBACK FROM FRONT PROP. LINE OF ERMANITA (STREET)

HIGHWAY + YARD =	TOTAL SETBACK FROM FRONT PROP. LINE	TYPE OF HIGHWAY	EXISTING WIDTH
+ 20' =	20'	LOC.	56

BLDG. SETBACK FROM SIDE PROP. LINE OF (STREET)

HIGHWAY + YARD =	TOTAL SETBACK FROM SIDE PROP. LINE	TYPE OF HIGHWAY	EXISTING WIDTH
+ =			

P.C. Fee $
Permit Fee $12-
Issuance Fee $7-
Total Fee $19-

PLAN CHECK VALIDATION

PERMIT VALIDATION

INSPECTOR COPY

₱619.8A
#••••••1
1••19.00
•••19.00CH
09.25-79

PLANS TO APPLICANT					INSPECTOR'S NOTES
TO:		RETURNED		APPROVED	
NO	DATE	NO.	DATE		

APPROVALS	REQUIRED		DATE RECEIVED OR APPROVED
	YES	NO	
WATER CERTIFICATE			
HEALTH DEPARTMENT			
FIRE DEPARTMENT			
GRADING			
GEOLOGICAL			
PEDESTRIAN PROTECTION (FENCE) (CANOPY)			
SPECIAL INSPECTION (CONC.) (MASNRY.) (WELDG.)			
LOT DRAINAGE			
PARKING			

APPROVALS	DATE	INSPECTOR'S SIGNATURE
LOCATION-(SETBACK & YARDS)	—	
FOUNDATIONS		
FRAME	6/25/74	TM
LATH/DRYWALL INTERIOR	9/25/74	TM
LATH-EXTERIOR	—	
HOUSE NUMBER-CORRECT & POSTED		
ENERGY INSULATION		
FINAL-ENTER ON FRONT		

1

76A663 CE-806 (11 / 78)

APPLICATION FOR ELECTRICAL PERMIT

COUNTY OF LOS ANGELES **BUILDING AND SAFETY**

FOR APPLICANT TO FILL IN

	EACH	NO.	FEE	
New Residential Bldgs. & Pools				
1 & 2-Family, Sq. Ft.	$ .025	—	$	
Multi-family Sq. Ft.	.02	—		
Residential Swimming Pools	25.00			
Outlets: Rec ___ Light ___ Sw. ___ First 20	.50			
Total No. ___ Additional	.30			
Lighting Fixtures First 20	.50			
Total No. ___ Additional	.30			
Fixed Appliances Not Over 1 HP				
Range ___ Heater ___ D.W. ✓				
Oven ___ Dryer ___ W.M. ___				
Top ___ FAU ___ W.H. ___				
Hood ___ Fan ___ Other ___				
Disp. ✓ Room Air Cond. ___	2.50	2	5	—
Power Apparatus & Large Appliances				
Size & Type HP, KW, KVA, or KVAR				
___ Up to 1 Incl.	2.50			
___ Over 1 to 10 Incl.	5.00			
___ Over 10 to 50 Incl.	12.50			
___ Over 50 to 100 Inc.	25.00			
___ Over 100	40.00			
Services				
0 - 200 Amp. Under 600 V	12.50			
201 - 1000 Amp. Under 600 V	25.00			
Over 1000 Amp. or Over 600 V	50.00			
Temp. Power Pole & Appurtenances	10.00			
Sign with One Branch Circuit	10.00			
Additional Sign Branch Circuits	2.00			
Misc. Conduits & Conductors	10.00			
Other (See Complete Fee Schedule) ___				
PERMIT FEE (Sub-Total)			5	—
PLAN CHECKING FEE (One-Fourth Permit Fee)				
PERMIT ISSUING FEE $7.00			7	—
TOTAL FEE			$12	—

INSPECTION FINALED
date: 4-30-81 By [signature]

JOB ADDRESS 15527 Ermanita Ave
LOCALITY Gardena
NEAREST CROSS ST. Cerise
OWNER OR FIRM NAME Dale Whit
MAIL ADDRESS 15527 Ermanita Ave
CITY Gar Tel. No. 675-5975
PLAN CHECK APPLICANT
ADDRESS
CITY Tel. No.
PERMIT APPLICANT Allstate Builders
ADDRESS 2029 Century Park East
CITY L.A Tel. No. 557-2480
LICENSE OR REG. NUMBER 316523 Class General

I HEREBY ACKNOWLEDGE THAT I HAVE READ THIS APPLICATION AND STATE THAT THE ABOVE IS CORRECT AND AGREE TO COMPLY WITH ALL COUNTY ORDINANCES AND STATE LAWS REGULATING ELECTRICAL WIRING.

I HEREBY CERTIFY THAT I AM PROPERLY REGISTERED AND/OR LICENSED AS REQUIRED BY LOS ANGELES COUNTY AND STATE OF CALIFORNIA OR THAT I AM THE LEGAL OWNER OF THE ABOVE DESCRIBED RESIDENTIAL PROPERTY.

PERMITEE SIGNATURE Mark Whitney

DISTRICT NO. 7 PROCESSED BY [signature]

INSPECTION INFORMATION ON REVERSE SIDE

PLAN CHECK VALIDATION

PERMIT VALIDATION

INSPECTOR COPY

$6199A
#•••••2
1••1200
•••1200 CH
09.25-79

Ps

APPROVALS	DATE	INSPECTOR'S SIGNATURE
TEMP. POWER POLE		
UNDERSLAB WORK		
ROUGH CONDUIT		
WIRING		
FIXTURES		
POWER AUTHORIZED		
UTILITY CO. NOTIFIED		
FINAL	*Enter on Front*	

NOTES

ADDRESS 15527 Ermanita Ave LOCALITY Gardena

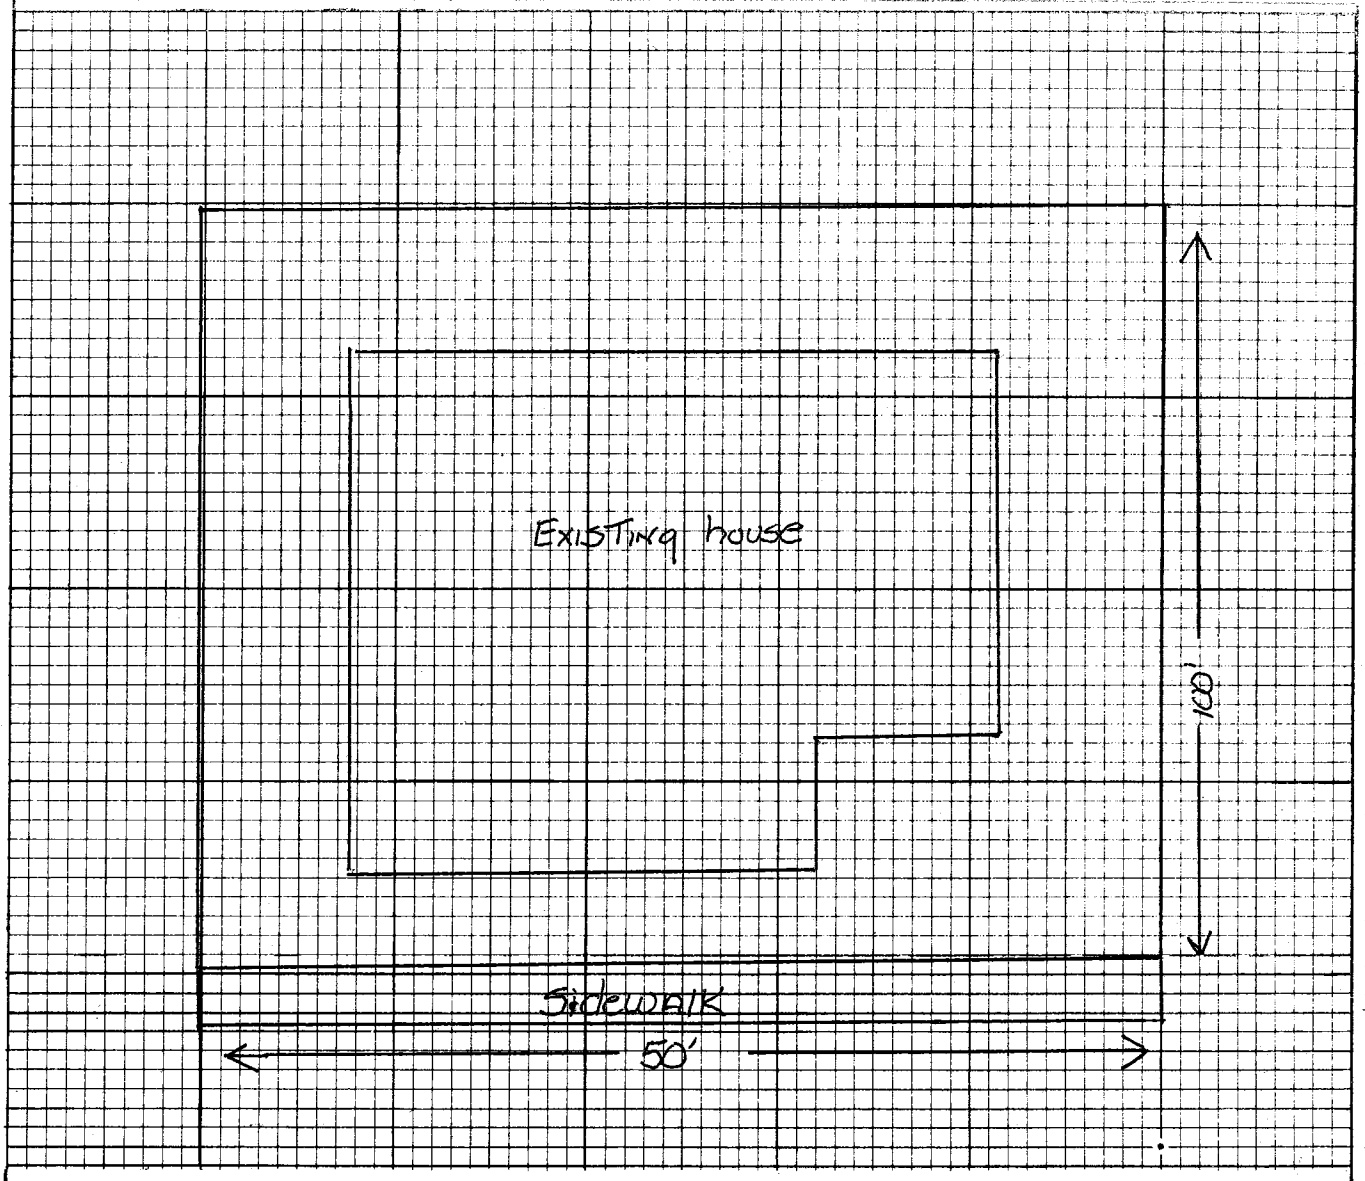

I HEREBY STATE THAT THIS PLOT PLAN AND THE DIMENSIONS SHOWN ARE CORRECT:

SIGNATURE OF APPLICANT _____ MAIL ADDRESS _____

JOB ADDRESS 15527 ERMANITA

OWNER

OBTAIN A BUILDING PERMIT FOR DRYWALL & WALL ALTERATION.

PROVIDE SEPARATE CIRCUIT FOR DISHWASHER, GARAGE DISPOSAL

OBTAIN ELEC. PERMIT DISHWASH & GARAGE DISPOSAL.

OK TO LATH

PROVIDE GAS TEST.

NEW SERVICE NOT IN.

9-21-77 TL

DATE INSPECTOR'S SIGNATURE

JOB ADDRESS 15527 ERMANITA

OWNER

LATH OK

VAL. $2000 —

BUILDING PERMIT

TO: LATH

WINDOW

HEADER

REMOVE WALL

ELEC.

CALL FOR FINAL WHEN COMPLETE.

9-25-79 TL

DATE INSPECTOR'S SIGNATURE

JOB ADDRESS 15527 Ermanita

OWNER D. Witt

1) Bare (unprotected) electrical service ground is not permitted.

4-30-81

Nelson

Obtain permit for water & waste lines for laundry area

4-30-81

Nelson

DATE INSPECTOR'S SIGNATURE

JOB ADDRESS 15527 Ermanita

OWNER

Protect ground electrode conductor along its entire length. Use approved clamp to rod.

6/23/81

Nelson

DATE INSPECTOR'S SIGNATURE

JOB ADDRESS 15527 Ermanita

OWNER Witt

Complete elect corrections. Protect ground conductor or use armored cable.

3-8-82

Complete within 10 days.

Nelson

DATE INSPECTOR'S SIGNATURE