CREW MAP
TD 903209

CITY OF HAWTHORNE
HARDY 4KV
LENNOX

VTC/PTC REQ'D
PERMIT REQ'D

E-ALL POLE W/ RENTER
JPA NOT REQUIRED

NOTE: HARD SET 1' NORTH.
SCE CREW TO TRANSFER
COMMUNICATION

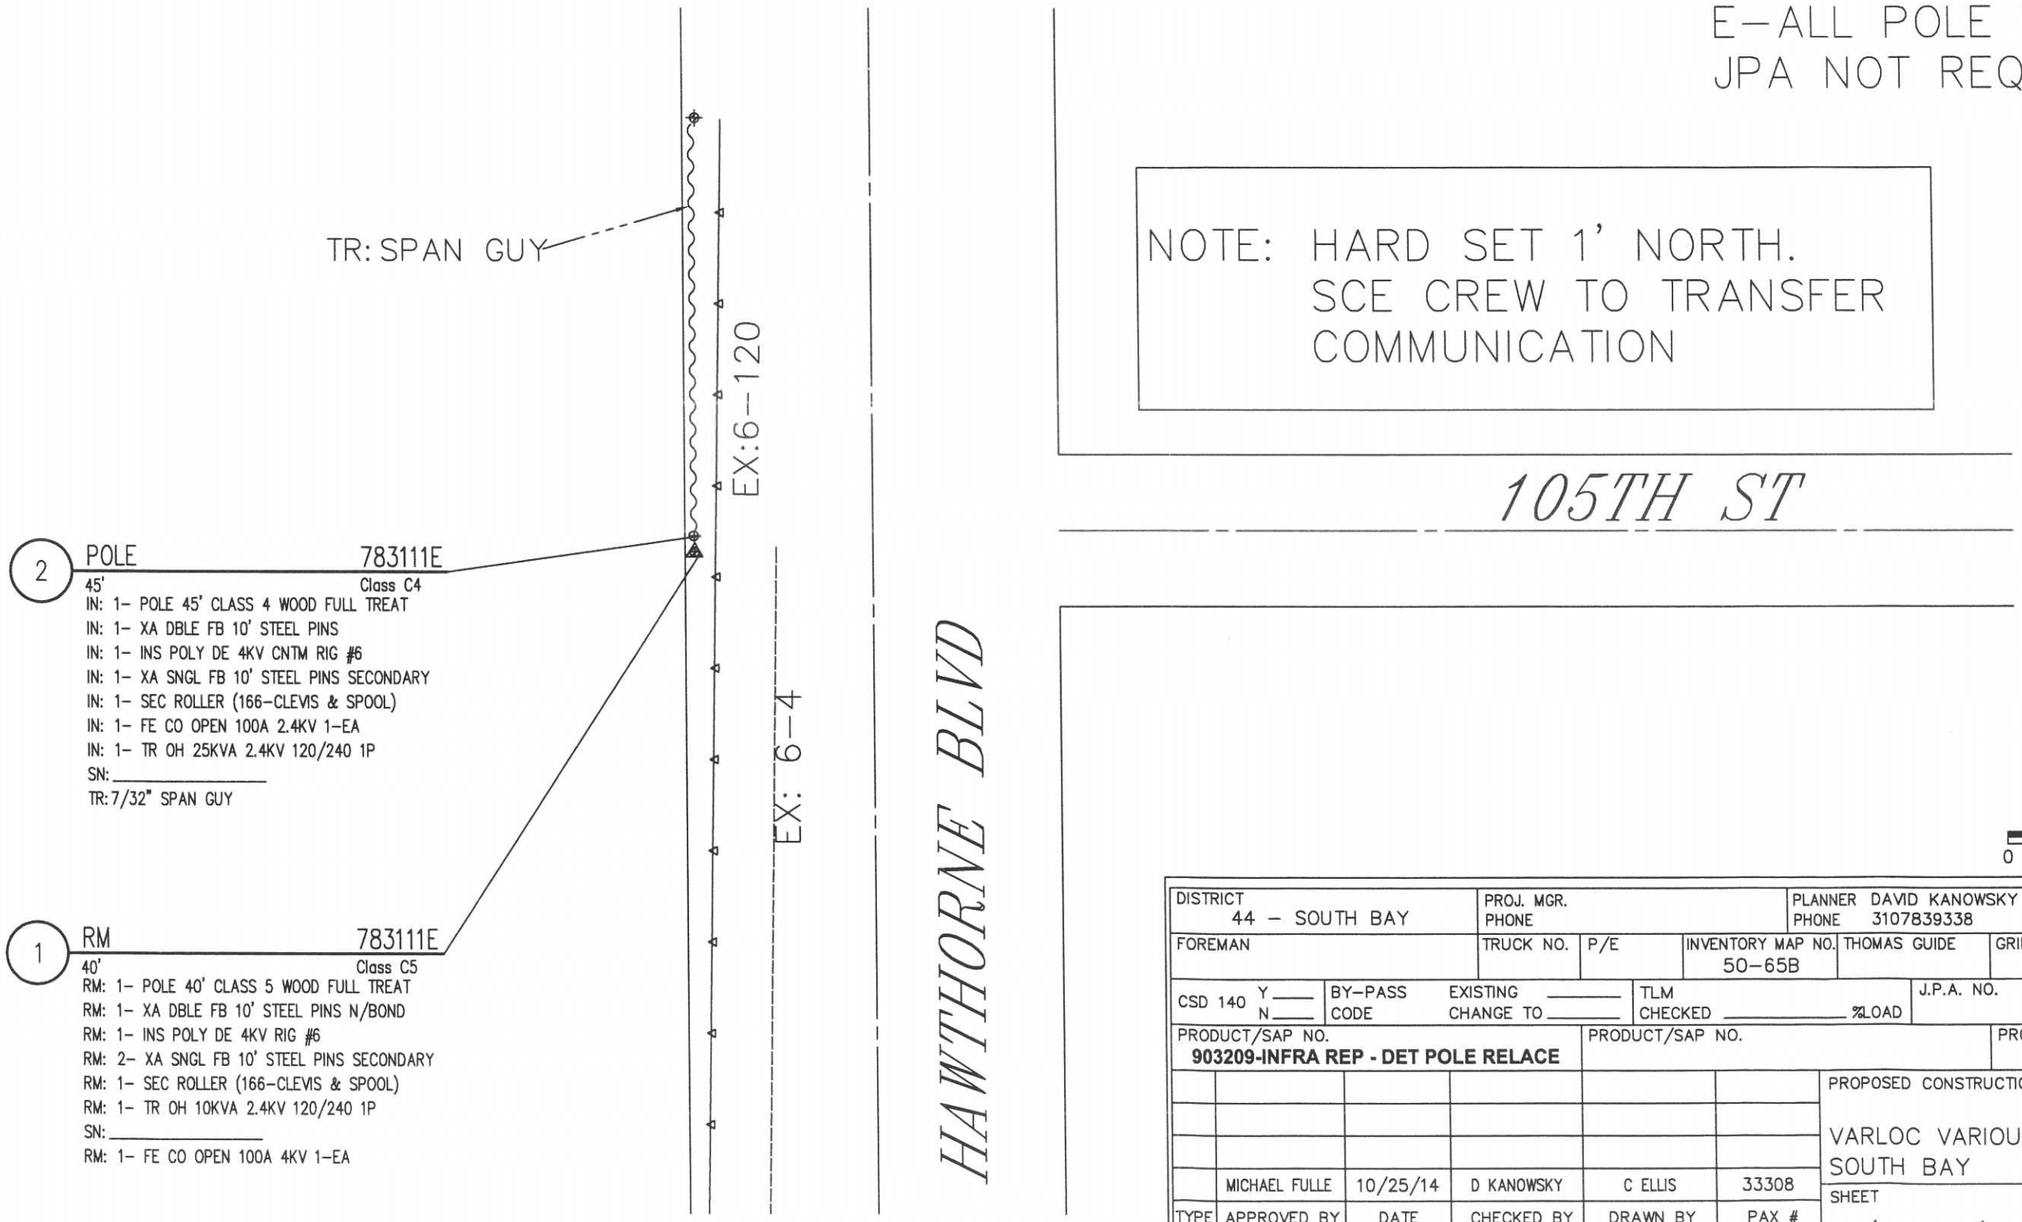

2 POLE 783111E
45' Class C4
IN: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- XA DBLE FB 10' STEEL PINS
IN: 1- INS POLY DE 4KV CNTM RIG #6
IN: 1- XA SNGL FB 10' STEEL PINS SECONDARY
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- FE CO OPEN 100A 2.4KV 1-EA
IN: 1- TR OH 25KVA 2.4KV 120/240 1P
SN:_____
TR: 7/32" SPAN GUY

1 RM 783111E
40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- XA DBLE FB 10' STEEL PINS N/BOND
RM: 1- INS POLY DE 4KV RIG #6
RM: 2- XA SNGL FB 10' STEEL PINS SECONDARY
RM: 1- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- TR OH 10KVA 2.4KV 120/240 1P
SN:_____
RM: 1- FE CO OPEN 100A 4KV 1-EA

DISTRICT 44 – SOUTH BAY	PROJ. MGR. PHONE		PLANNER DAVID KANOWSKY PHONE 3107839338		
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 50-65B	THOMAS GUIDE	GRID NO.	DESIGN NO. 628918_0.01
CSD 140 Y___ N___	BY-PASS CODE	EXISTING _____ CHANGE TO _____	TLM CHECKED _____ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 903209-INFRA REP - DET POLE RELACE	PRODUCT/SAP NO.	PRODUCT/SAP NO.

	MICHAEL FULLE	10/25/14	D KANOWSKY	C ELLIS	33308
TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

PROPOSED CONSTRUCTION (LOCATION)
VARLOC VARIOUS SOUTH BAY CA 90000
SOUTH BAY

SHEET 1 OF 1

JOB NO. 628918 0.01

Southern California Edison Co.