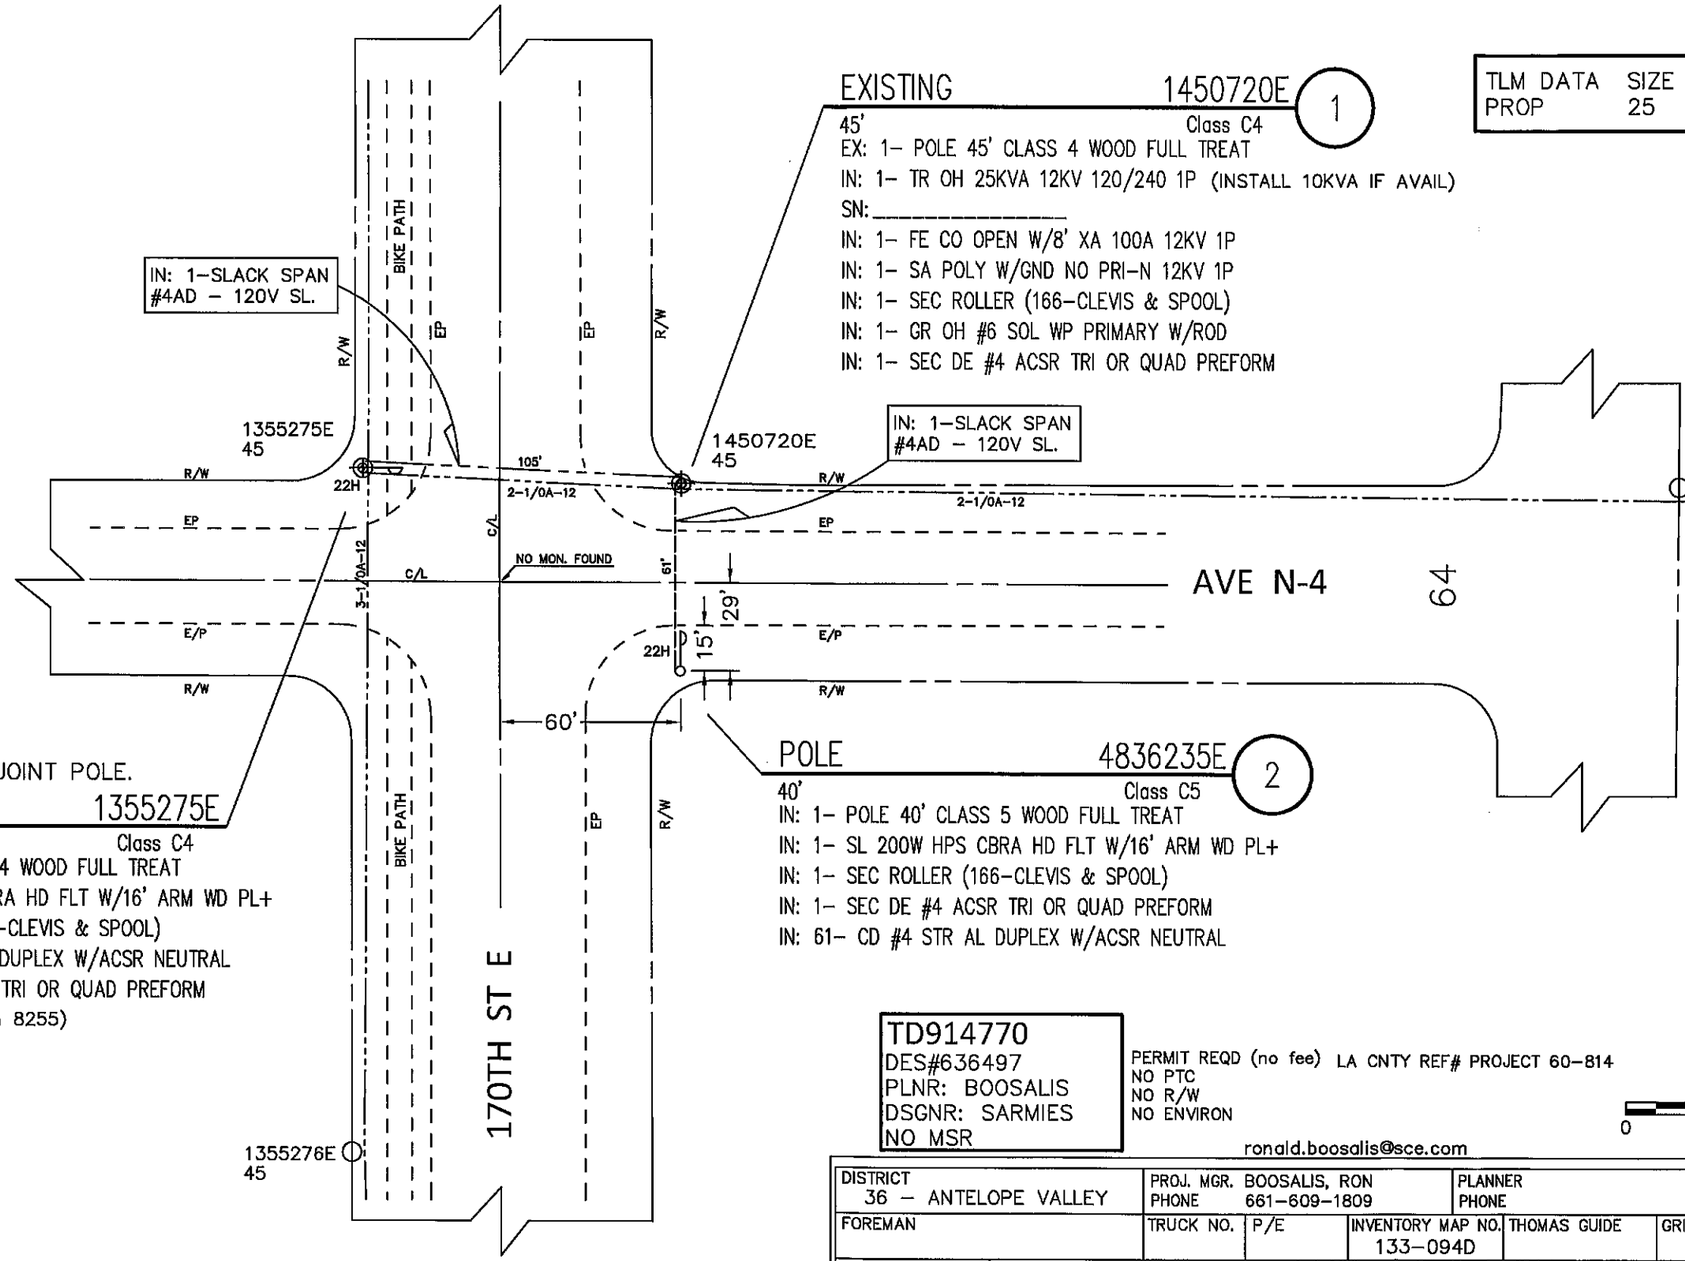

EXISTING 1450720E (1)
45' Class C4
EX: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- TR OH 25KVA 12KV 120/240 1P (INSTALL 10KVA IF AVAIL)
SN: _____
IN: 1- FE CO OPEN W/8' XA 100A 12KV 1P
IN: 1- SA POLY W/GND NO PRI-N 12KV 1P
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- GR OH #6 SOL WP PRIMARY W/ROD
IN: 1- SEC DE #4 ACSR TRI OR QUAD PREFORM

TLM DATA	SIZE	KVA	CUST	%
PROP	25	.4	1	1.6

PETAN-12
PIUTE SUB

EX 12KV RISER - JOINT POLE.
(3) EXISTING 1355275E
45' Class C4
EX: 1- POLE 45' CLASS 4 WOOD FULL TREAT
IN: 1- SL 200W HPS CBRA HD FLT W/16' ARM WD PL+
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 105- CD #4 STR AL DUPLEX W/ACSR NEUTRAL
IN: 1- SEC DE #4 ACSR TRI OR QUAD PREFORM
IN: GUARD ARM (not on 8255)

POLE 4836235E (2)
40' Class C5
IN: 1- POLE 40' CLASS 5 WOOD FULL TREAT
IN: 1- SL 200W HPS CBRA HD FLT W/16' ARM WD PL+
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- SEC DE #4 ACSR TRI OR QUAD PREFORM
IN: 61- CD #4 STR AL DUPLEX W/ACSR NEUTRAL

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

TD914770
DES#636497
PLNR: BOOSALIS
DSGNR: SARMIES
NO MSR

PERMIT REQD (no fee) LA CNTY REF# PROJECT 60-814
NO PTC
NO R/W
NO ENVIRON

ronald.boosalis@sce.com

SCALE: 1" = 50'
0 50 100

DISTRICT 36 - ANTELOPE VALLEY	PROJ. MGR. BOOSALIS, RON PHONE 661-609-1809		PLANNER PHONE		TD914770
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 133-094D	THOMAS GUIDE	GRID NO.	DESIGN NO. 636497_0.01
CSD 140 Y___ N___	BY-PASS CODE	EXISTING ___ CHANGE TO ___	TLM CHECKED ___ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 914770-ST LT INSTALLATION			PRODUCT/SAP NO.		PRODUCT/SAP NO. TD914770

PROPOSED CONSTRUCTION (LOCATION)
LA CO ST LTG
AVE N-4 & 170TH ST EAST
LAKE LOS ANGELES

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

Southern California Edison Company

SHEET 1 OF 1
JOB NO. TD914770
DES# 636497_0.01