
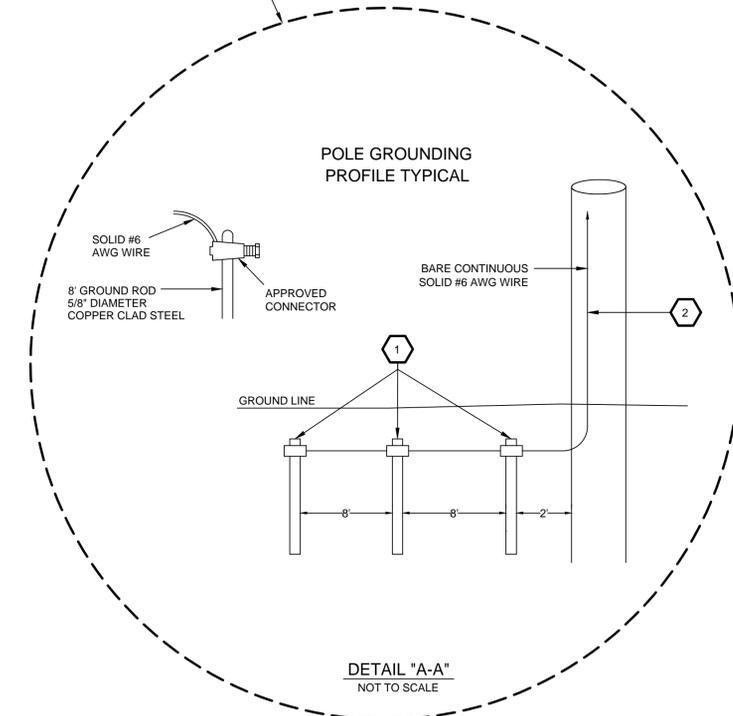
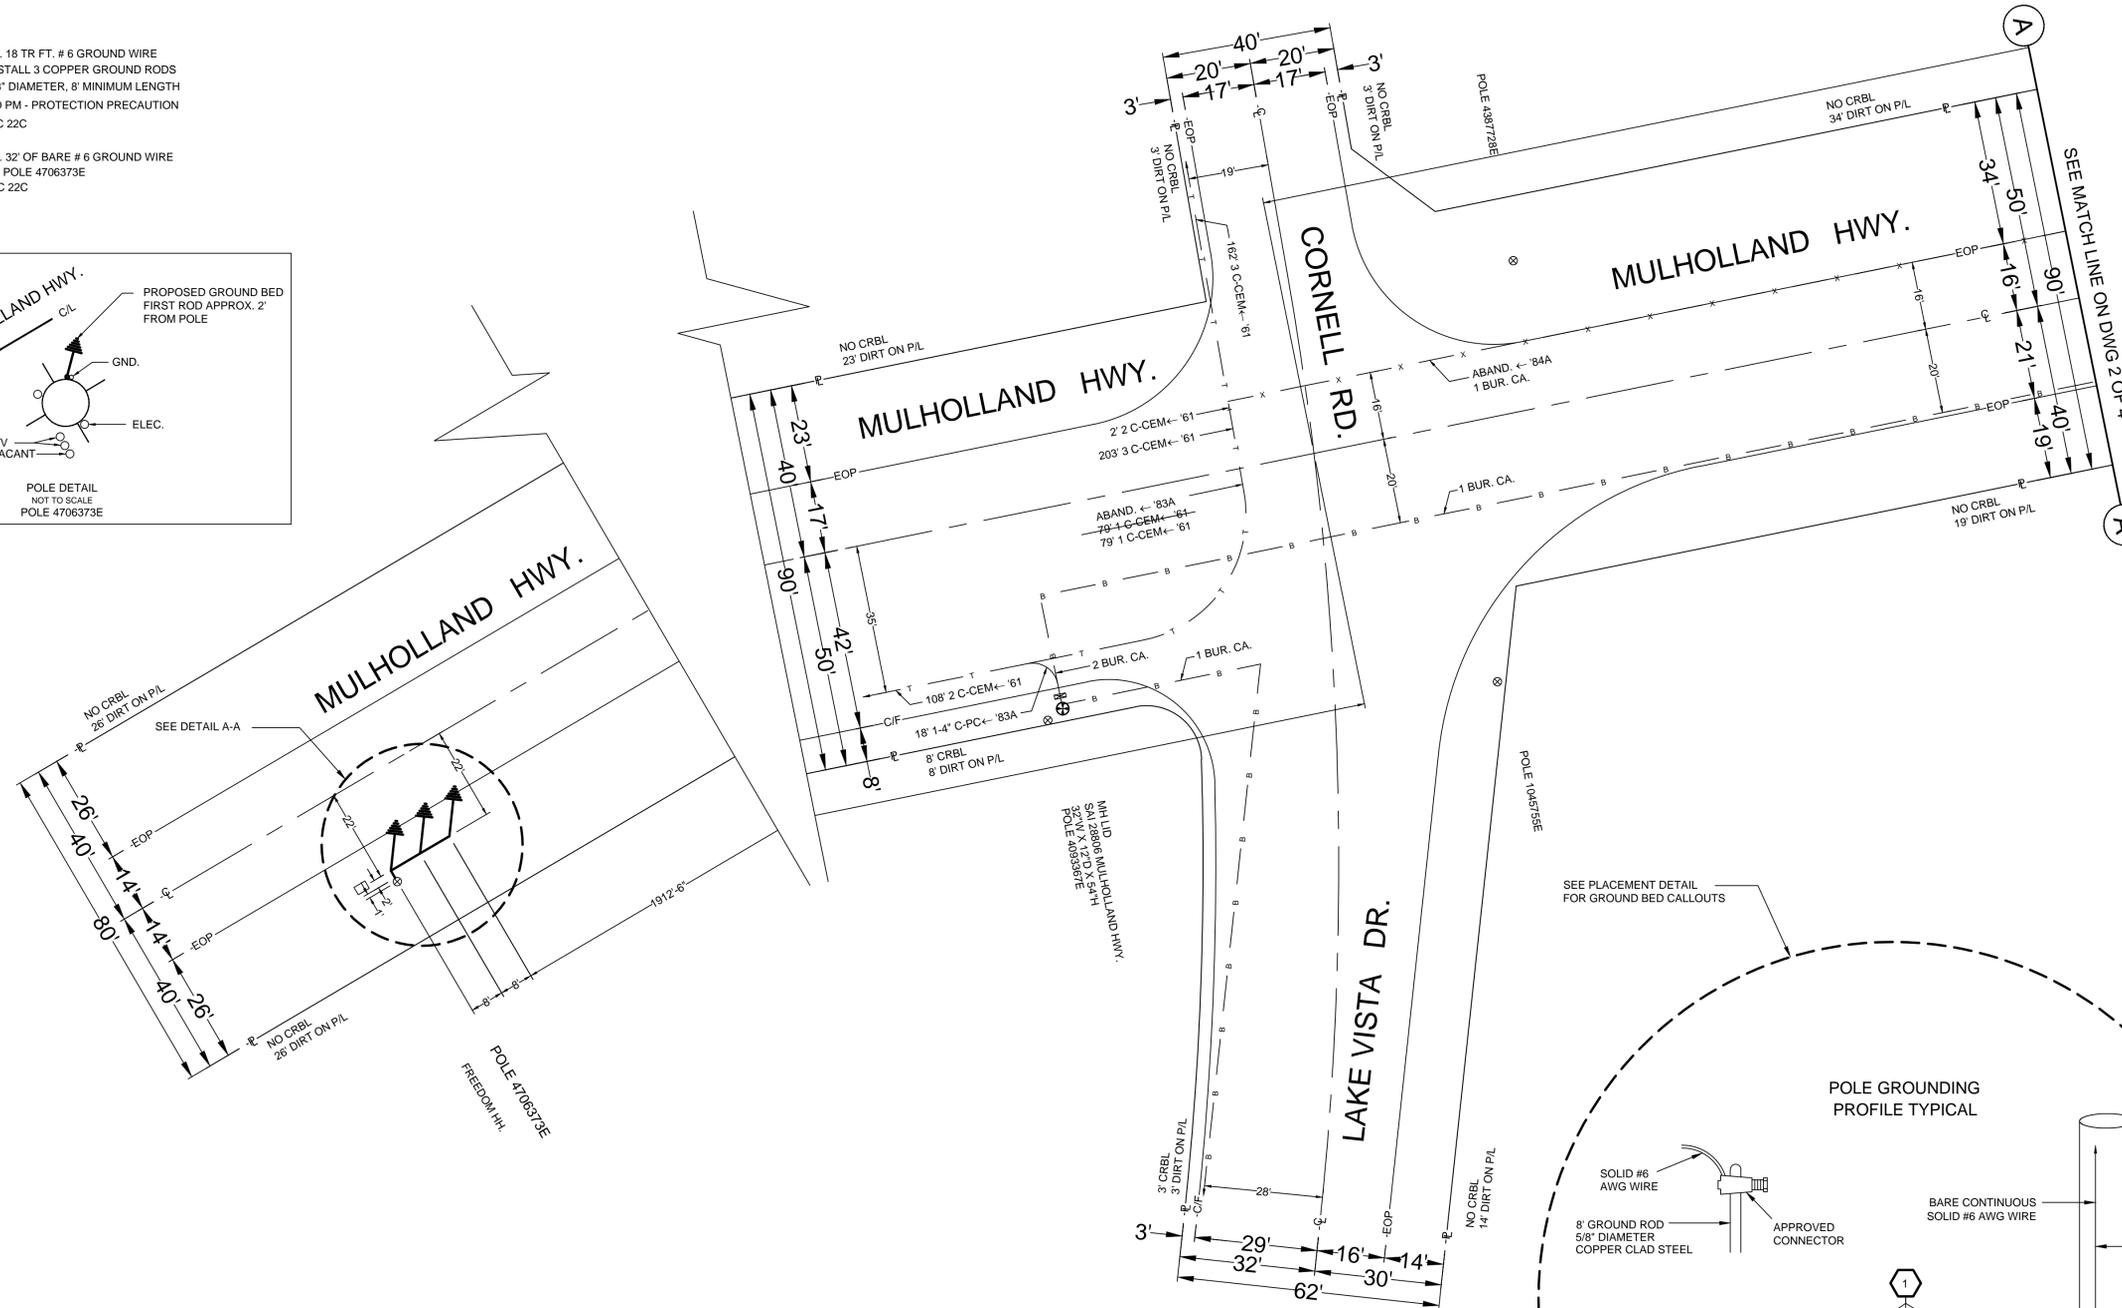


**PLACEMENT DATA**

- ① PL. 18 TR FT. # 6 GROUND WIRE  
INSTALL 3 COPPER GROUND RODS  
5/8" DIAMETER, 8' MINIMUM LENGTH  
NO PM - PROTECTION PRECAUTION  
R/C 22C
- ② PL. 32' OF BARE # 6 GROUND WIRE  
AT POLE 4706373E  
R/C 22C

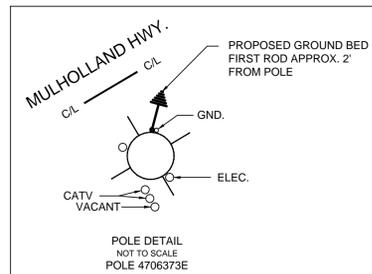

**CONSTRUCTION REQUIREMENTS**

1. MAINTAIN MINIMUM COVER OF 36" BELOW FLOW LINE.
2. VERIFY EXISTING SUBSTRUCTURES PRIOR TO EXCAVATION.
3. ALL 4" TO CONFORM TO PTS.-77 OR EQUIVALENT.
4. ALL 2" TO CONFORM TO PTS.-66 OR EQUIVALENT.
5. ALL BACKFILL TO BE SAND 12" BELOW AND 6" ABOVE.
6. DO NOT BACKFILL OVER ANY TELEPHONE BURIED SPlice LOCATIONS UNTIL AUTHORIZED BY TELEPHONE COMPANY INSPECTOR.
7. PLACE # 6 TINNED GROUND WIRE AT BONDING POINTS. (SEE BONDING DETAIL)
8. PLACE PULL ROPE IN NEW CONDUIT.
9. DO NOT CUT CURB & GUTTER.
10. ALL SURFACES AND LANDSCAPES WHICH HAVE BEEN REMOVED OR DAMAGED IN THE COURSE OF CONSTRUCTION SHALL BE RECONSTRUCTED OR REPLACED TO AT LEAST EQUAL OR BETTER THAN THE PREVIOUS OR ADJACENT SURFACE.
11. ALL TRAFFIC CONTROL TO BE IN ACCORDANCE WITH THE CALIFORNIA MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) LATEST EDITION.
12. PER AT&T GUIDELINES, ALL HANDHOLES, SPlice BOXES, AND MANHOLES TO BE PURCHASED FROM EITHER NEWBASE OR UTILITY VAULT.

THIS PROJECT REQUIRES EXCAVATION. CONSTRUCTION WILL UTILIZE AND IMPLEMENT ALL BEST MANAGEMENT PRACTICES (BMP'S) AS REQUIRED TO ENSURE COMPLIANCE WITH AT&T POLICY LETTER ISSUED FEBRUARY 21, 2003 AND REVISED IN OCTOBER 2005 BY ENVIRONMENTAL MANAGEMENT CONCERNING STORM WATER PERMITTING AND STORM WATER POLLUTION PREVENTION PLANS (SWPPP'S) AND IN ACCORDANCE WITH THE CLEAN WATER ACT (1972) AND EPA REGULATIONS PUBLISHED IN 1990 AS MODIFIED BY THE PHASE II RULE IN 1999.

LOCATION: MULHOLLAND HWY., S/S OF STREET, 1912'-6" W/O C/L OF LAKE VISTA DR.

DESCRIPTION: PLACE GROUND BED & 32' OF BARE # 6 GROUND WIRE AT POLE 4706373E.

BACKFILL SHALL BE PER COUNTY OF LOS ANGELES STANDARDS.

STREET TYPE	SOIL CLASS	PROPOSED BACKFILL
MAJOR	N/A	N/A
SECONDARY	N/A	N/A
LOCAL	N/A	N/A
ALLEY	N/A	N/A

CONDUIT RECORD: B126C162 CORNELL RD. 736' N/O MULHOLLAND HWY TO MULHOLLAND HWY	
SUB MAP #: N/A	
STREET NAME: N/A	
MATERIAL: N/A	
LINEAR FEET: N/A	

EXCAVATION DATA	
CITY OF:	LOS ANGELES COUNTY
PLACING:	GROUND BED & 32' OF BARE # 6 GROUND WIRE

EXCAVATION IN	
EXCAVATION IN CONCRETE SIDEWALK	
EXCAVATION IN ASPHALT STREET	
EXCAVATION IN ASPHALT STREET	
EXCAVATION IN DIRT	18' X 1' = 18 SQ FT

TOTAL EXCAVATION:	18 SQ FT
NUMBER OF CUTS:	1

DATE	ATTID	LAYOUT ENGINEER
DRAWN: 08/15/13	CHC / AM0266	TELEPHONE NUMBER
CHECKED:		EMAIL ADDRESS
APPROVED:		FACILITY ENGINEER AMY ILLANGAKOON
DATE	REVISIONS	TELEPHONE NUMBER 949-313-6094
		DECOO B1-26
		CENTRAL OFFICE AGOURA

SCALE: 1" = 20'	THOMAS GUIDE: 588 - B3	UNDERGROUND CONSTRUCTION PROJECT NUMBER: 8850253
FILENAME: B126 8850253.dwg	DRAWING: 1/4	

**CHC Consulting, LLC**  
1700 E. Garry Ave., Suite 210  
Santa Ana, CA 92705  
(949) 250-0004 / FAX (949) 250-0006





**CONSTRUCTION REQUIREMENTS**

1. MAINTAIN MINIMUM COVER OF 36" BELOW FLOW LINE.
2. VERIFY EXISTING SUBSTRUCTURES PRIOR TO EXCAVATION.
3. ALL 4" TO CONFORM TO PTS.-77 OR EQUIVALENT.
4. ALL 2" TO CONFORM TO PTS.-66 OR EQUIVALENT.
5. ALL BACKFILL TO BE SAND 12" BELOW AND 6" ABOVE.
6. DO NOT BACKFILL OVER ANY TELEPHONE BURIED SPLICE LOCATIONS UNTIL AUTHORIZED BY TELEPHONE COMPANY INSPECTOR.
7. PLACE # 6 TINNED GROUND WIRE AT BONDING POINTS. (SEE BONDING DETAIL)
8. PLACE PULL ROPE IN NEW CONDUIT.
9. DO NOT CUT CURB & GUTTER.
10. ALL SURFACES AND LANDSCAPES WHICH HAVE BEEN REMOVED OR DAMAGED IN THE COURSE OF CONSTRUCTION SHALL BE RECONSTRUCTED OR REPLACED TO AT LEAST EQUAL OR BETTER THAN THE PREVIOUS OR ADJACENT SURFACE.
11. ALL TRAFFIC CONTROL TO BE IN ACCORDANCE WITH THE CALIFORNIA MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) LATEST EDITION.
12. PER AT&T GUIDELINES, ALL HANDHOLES, SPLICE BOXES, AND MANHOLES TO BE PURCHASED FROM EITHER NEWBASE OR UTILITY VAULT.

THIS PROJECT REQUIRES EXCAVATION. CONSTRUCTION WILL UTILIZE AND IMPLEMENT ALL BEST MANAGEMENT PRACTICES (BMP'S) AS REQUIRED TO ENSURE COMPLIANCE WITH AT&T POLICY LETTER ISSUED FEBRUARY 21, 2003 AND REVISED IN OCTOBER 2005 BY ENVIRONMENTAL MANAGEMENT CONCERNING STORM WATER PERMITTING AND STORM WATER POLLUTION PREVENTION PLANS (SWPPP'S) AND IN ACCORDANCE WITH THE CLEAN WATER ACT (1972) AND EPA REGULATIONS PUBLISHED IN 1990 AS MODIFIED BY THE PHASE II RULE IN 1999.

LOCATION: MULHOLLAND HWY., S/S OF STREET, 1281' W/O C/L OF APRIL RD.

DESCRIPTION: PLACE GROUND BED & 32' OF BARE # 6 GROUND WIRE AT POLE NO TAG.

BACKFILL SHALL BE PER COUNTY OF LOS ANGELES STANDARDS.

STREET TYPE	SOIL CLASS	PROPOSED BACKFILL
MAJOR	N/A	N/A
SECONDARY	N/A	N/A
LOCAL	N/A	N/A
ALLEY	N/A	N/A

CONDUIT RECORD/NO CONDUIT RECORD AVAILABLE

SUB MAP #: N/A

STREET NAME: N/A

MATERIAL: N/A

LINEAR FEET: N/A



**EXCAVATION DATA**

CITY OF: LOS ANGELES COUNTY  
PLACING: GROUND BED & 32' OF BARE # 6 GROUND WIRE

EXCAVATION IN  
EXCAVATION IN CONCRETE SIDEWALK  
EXCAVATION IN ASPHALT STREET  
EXCAVATION IN ASPHALT STREET  
EXCAVATION IN DIRT 18' X 1' = 18 SQ FT

TOTAL EXCAVATION: 18 SQ FT

NUMBER OF CUTS: 1

DATE	ATTID	LAYOUT ENGINEER
DRAWN 08/15/13	CHC / AM0266	TELEPHONE NUMBER
CHECKED		EMAIL ADDRESS
APPROVED		FACILITY ENGINEER AMY ILLANGAKOON TELEPHONE NUMBER 949-313-6094

DATE	REVISIONS
	DECOO B1-26 CENTRAL OFFICE AGOURA




UNDERGROUND CONSTRUCTION PROJECT NUMBER: 8850253

SCALE: 1" = 20' THOMAS GUIDE 588 - C4

FILENAME: B126 8850253.dwg DRAWING: 3/4

**PLACEMENT DATA**

1. PL 18 TR FT. # 6 GROUND WIRE  
INSTALL 3 COPPER GROUND RODS  
5/8" DIAMETER, 8' MINIMUM LENGTH  
NO PM - PROTECTION PRECAUTION  
R/C 22C
2. PL 32' OF BARE # 6 GROUND WIRE  
AT POLE NO TAG  
R/C 22C

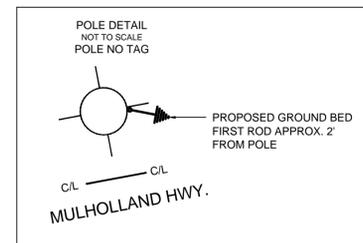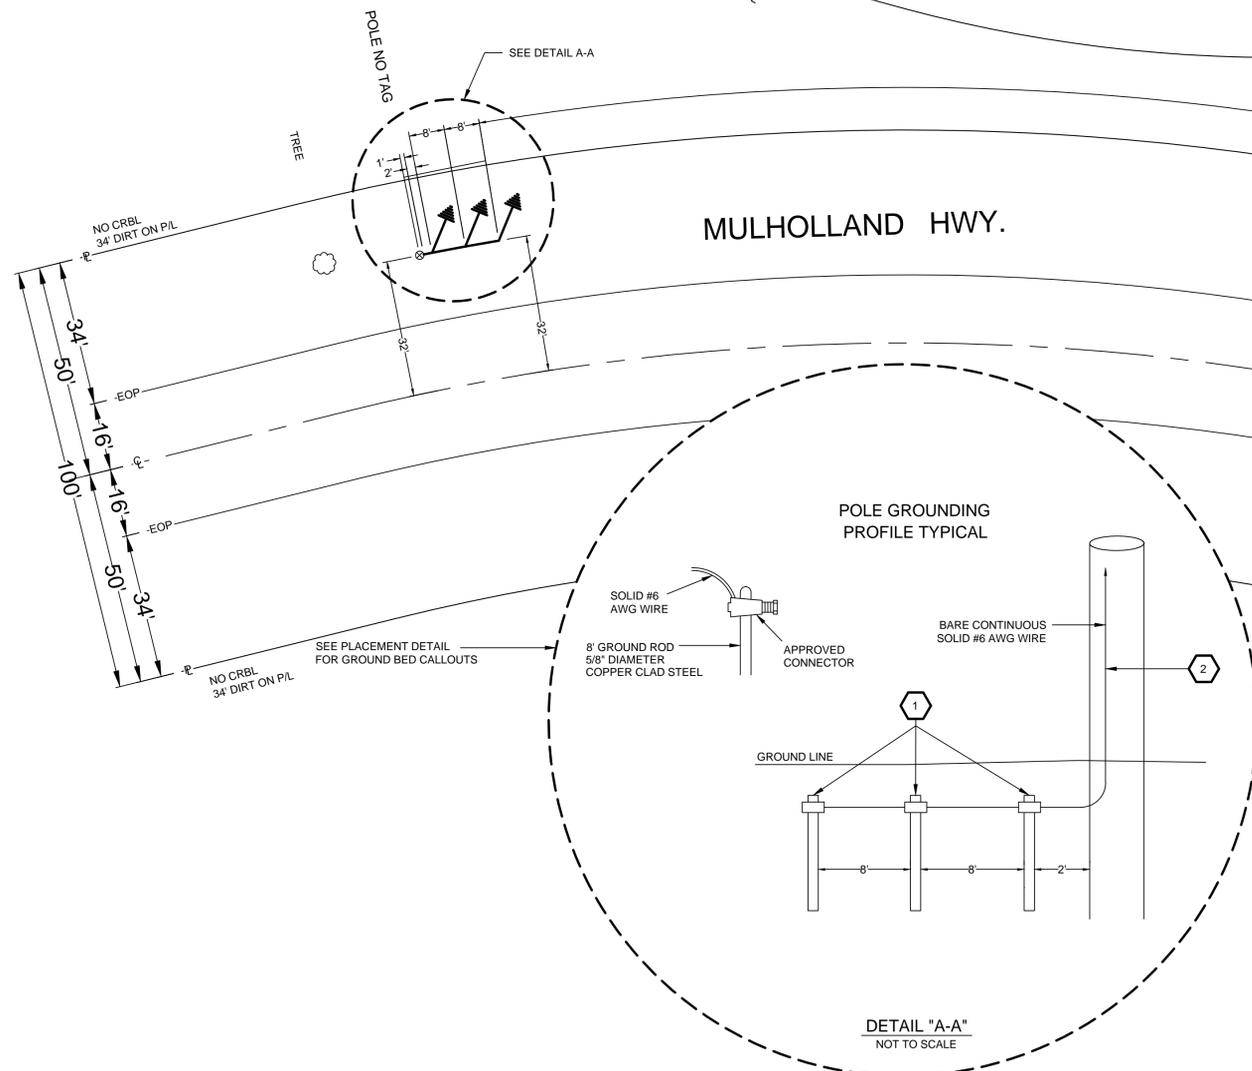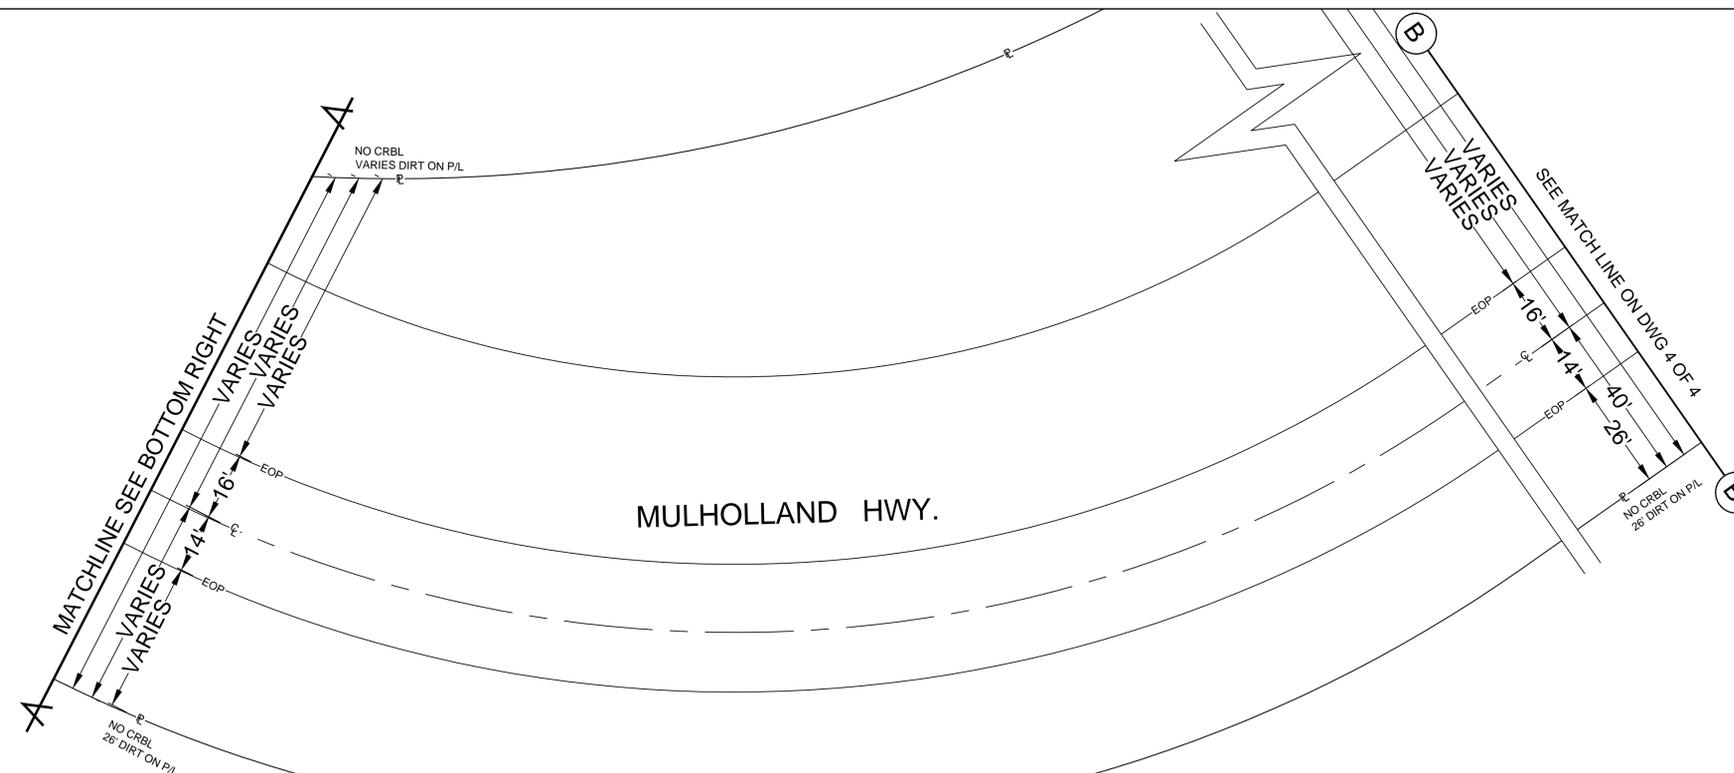



**CONSTRUCTION REQUIREMENTS**

1. MAINTAIN MINIMUM COVER OF 36" BELOW FLOW LINE.
2. VERIFY EXISTING SUBSTRUCTURES PRIOR TO EXCAVATION.
3. ALL 4" TO CONFORM TO PTS.-77 OR EQUIVALENT.
4. ALL 2" TO CONFORM TO PTS.-66 OR EQUIVALENT.
5. ALL BACKFILL TO BE SAND 12" BELOW AND 6" ABOVE.
6. DO NOT BACKFILL OVER ANY TELEPHONE BURIED SPLICE LOCATIONS UNTIL AUTHORIZED BY TELEPHONE COMPANY INSPECTOR.
7. PLACE # 6 TINNED GROUND WIRE AT BONDING POINTS. (SEE BONDING DETAIL)
8. PLACE PULL ROPE IN NEW CONDUIT.
9. DO NOT CUT CURB & GUTTER.
10. ALL SURFACES AND LANDSCAPES WHICH HAVE BEEN REMOVED OR DAMAGED IN THE COURSE OF CONSTRUCTION SHALL BE RECONSTRUCTED OR REPLACED TO AT LEAST EQUAL OR BETTER THAN THE PREVIOUS OR ADJACENT SURFACE.
11. ALL TRAFFIC CONTROL TO BE IN ACCORDANCE WITH THE CALIFORNIA MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) LATEST EDITION.
12. PER AT&T GUIDELINES, ALL HANDHOLES, SPLICE BOXES, AND MANHOLES TO BE PURCHASED FROM EITHER NEWBASE OR UTILITY VAULT.

THIS PROJECT REQUIRES EXCAVATION. CONSTRUCTION WILL UTILIZE AND IMPLEMENT ALL BEST MANAGEMENT PRACTICES (BMP'S) AS REQUIRED TO ENSURE COMPLIANCE WITH AT&T POLICY LETTER ISSUED FEBRUARY 21, 2003 AND REVISED IN OCTOBER 2005 BY ENVIRONMENTAL MANAGEMENT CONCERNING STORM WATER PERMITTING AND STORM WATER POLLUTION PREVENTION PLANS (SWPPP'S) AND IN ACCORDANCE WITH THE CLEAN WATER ACT (1972) AND EPA REGULATIONS PUBLISHED IN 1990 AS MODIFIED BY THE PHASE II RULE IN 1999.

LOCATION: 1. MULHOLLAND HWY., N/S OF STREET, 29'-6" W/O C/L OF APRIL RD.  
2. MULHOLLAND HWY., S/S OF STREET, 1172'-6" E/O C/L OF APRIL RD.

DESCRIPTION: PLACE GROUND BED & 32' OF BARE # 6 GROUND WIRE AT POLE 1056486H & POLE 843971E.

BACKFILL SHALL BE PER COUNTY OF LOS ANGELES STANDARDS.

STREET TYPE	SOIL CLASS	PROPOSED BACKFILL
MAJOR	N/A	N/A
SECONDARY	N/A	N/A
LOCAL	N/A	N/A
ALLEY	N/A	N/A

CONDUIT RECORD/NO CONDUIT RECORD AVAILABLE

SUB MAP #: N/A

STREET NAME: N/A

MATERIAL: N/A

LINEAR FEET: N/A



**EXCAVATION DATA**

CITY OF: LOS ANGELES COUNTY  
PLACING: GROUND BED & 32' OF BARE # 6 GROUND WIRE

EXCAVATION IN	
EXCAVATION IN CONCRETE SIDEWALK	
EXCAVATION IN ASPHALT STREET	
EXCAVATION IN ASPHALT STREET	
EXCAVATION IN DIRT	(2) 18' X 1' = 36 SQ FT

TOTAL EXCAVATION: 36 SQ FT

NUMBER OF CUTS: 2

DATE	ATTID	LAYOUT ENGINEER
DRAWN 08/15/13	CHC / AM0266	TELEPHONE NUMBER
CHECKED		EMAIL ADDRESS
APPROVED		FACILITY ENGINEER AMY ILLANGAKOON
DATE	REVISIONS	TELEPHONE NUMBER 949-313-6094
		DECO B1-26
		CENTRAL OFFICE AGOURA





UNDERGROUND CONSTRUCTION PROJECT NUMBER

SCALE: 1" = 20' THOMAS GUIDE: 588 - C4 & D4 PROJECT NUMBER: 8850253

FILENAME: B126 8850253.dwg DRAWING: 4/4

**PLACEMENT DATA**

- ① PL. 18 TR FT. # 6 GROUND WIRE  
INSTALL 3 COPPER GROUND RODS  
5/8" DIAMETER, 8' MINIMUM LENGTH  
NO PM - PROTECTION PRECAUTION  
R/C 22C
- ② PL. 32' OF BARE # 6 GROUND WIRE  
AT POLE 1056486H & POLE 843971E  
R/C 22C

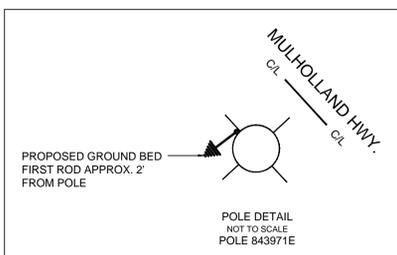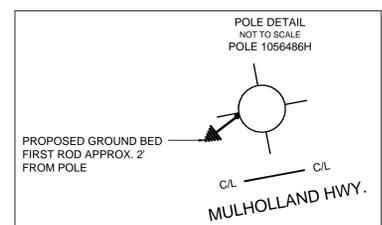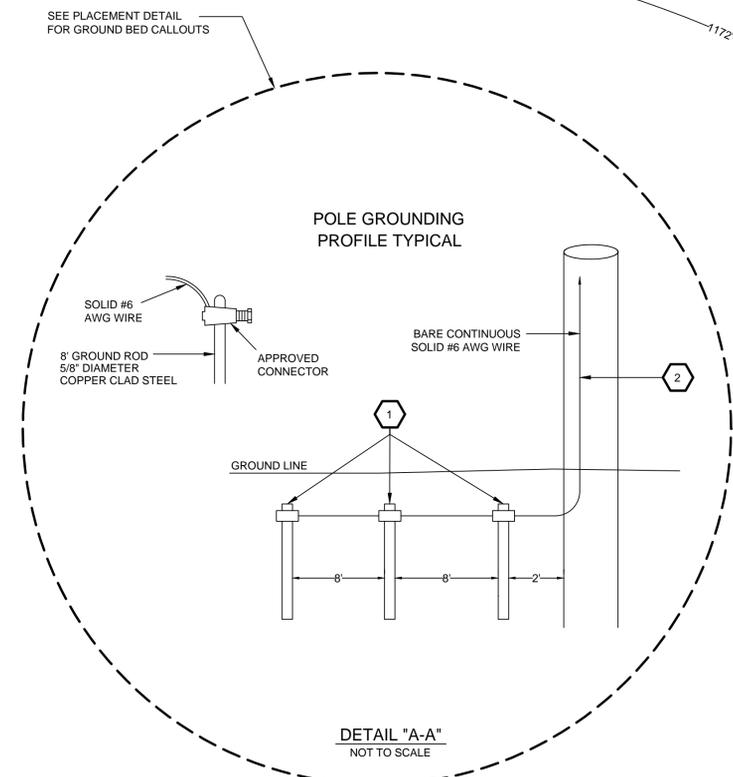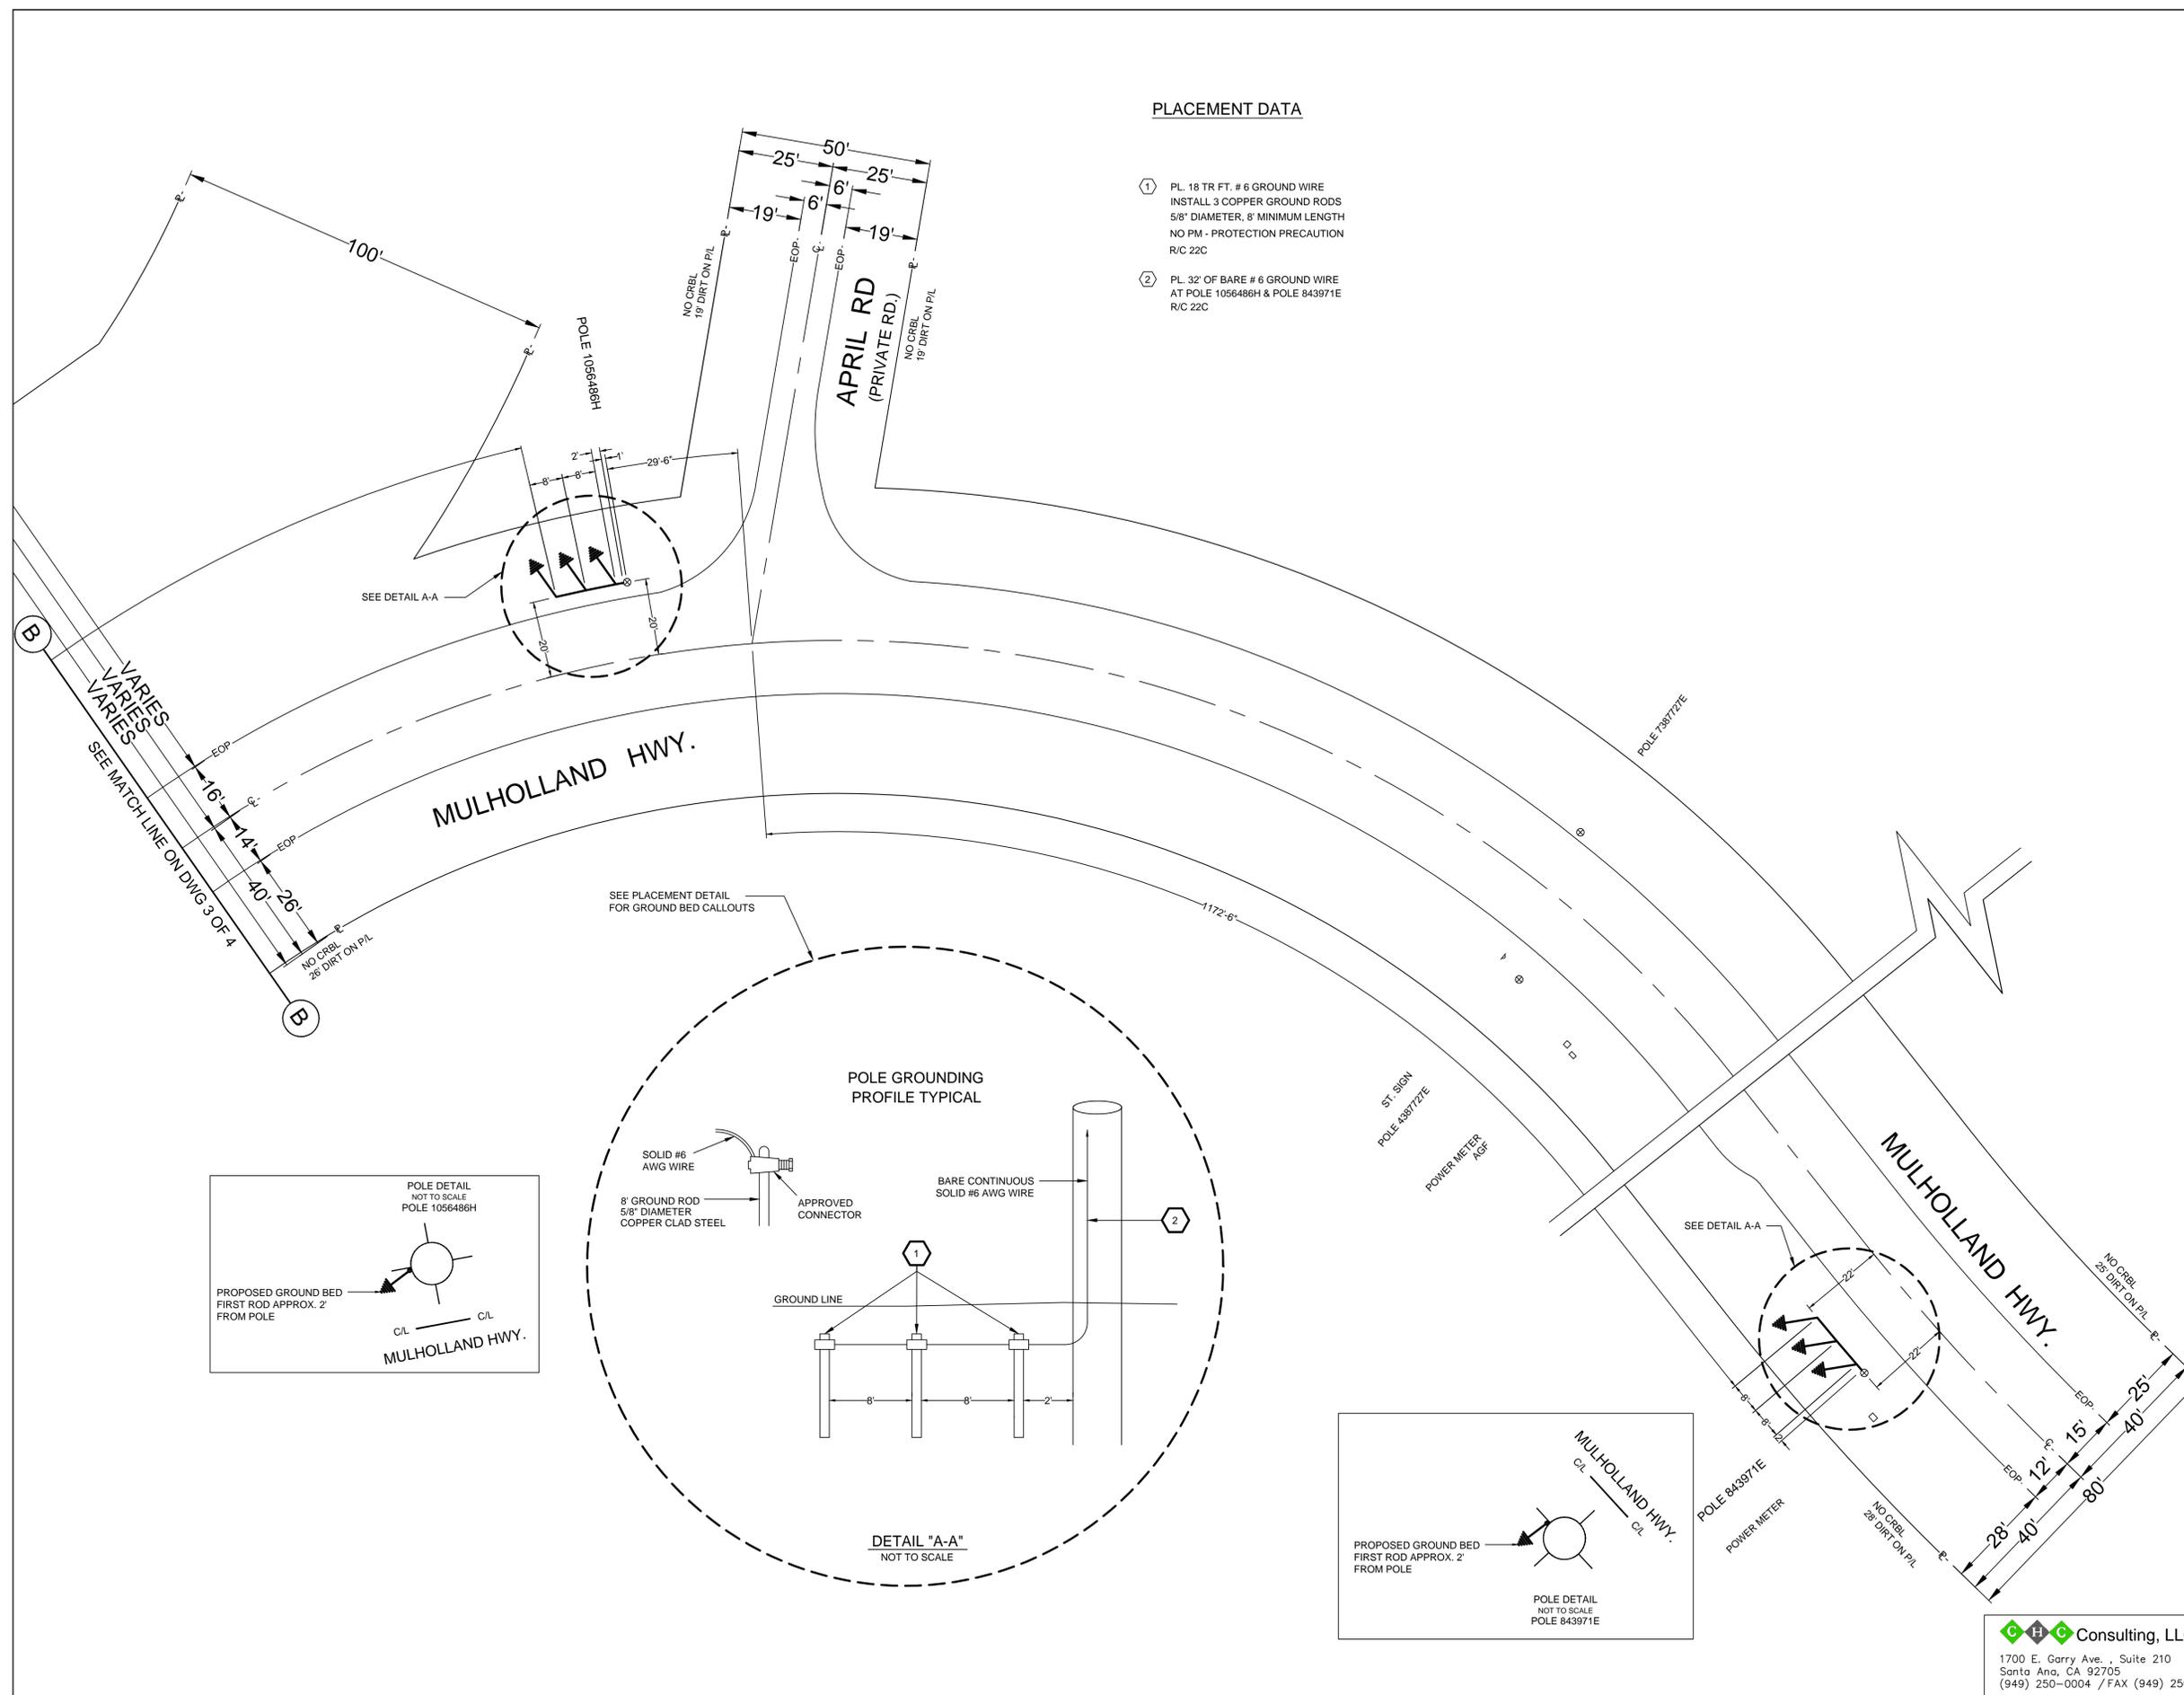

**CHC Consulting, LLC**  
1700 E. Garry Ave., Suite 210  
Santa Ana, CA 92705  
(949) 250-0004 / FAX (949) 250-0006