



CONSTRUCTION REQUIREMENTS

1. MAINTAIN MINIMUM COVER OF 36" BELOW FLOW LINE.
2. VERIFY EXISTING SUBSTRUCTURES PRIOR TO EXCAVATION.
3. ALL 4" TO CONFORM TO P.T.S.-77 OR EQUIVALENT.
4. ALL 2" TO CONFORM TO P.T.S.-88 OR EQUIVALENT.
5. ALL BACKFILL TO BE SLURRY BACKFILL.
6. DO NOT BACKFILL OVER ANY TELEPHONE BURIED SPLICE LOCATIONS UNTIL AUTHORIZED BY TELEPHONE COMPANY INSPECTOR.
7. PLACE # 6 TINNED GROUND WIRE AT BONDING POINTS. (SEE BONDING DETAIL)
8. PLACE PULL ROPE IN NEW CONDUIT.
9. DO NOT CUT CURB & GUTTER.
10. ALL SURFACES AND LANDSCAPES WHICH HAVE BEEN REMOVED OR DAMAGED IN THE COURSE OF CONSTRUCTION SHALL BE RECONSTRUCTED OR REPLACED TO AT LEAST EQUAL OR BETTER THAN THE PREVIOUS OR ADJACENT SURFACE.
11. ALL TRAFFIC CONTROL TO BE IN ACCORDANCE WITH THE CALIFORNIA MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) LATEST EDITION.
12. PER AT&T GUIDELINES, ALL HANDHOLES, SPLICE BOXES, AND MANHOLES TO BE PURCHASED FROM EITHER NEWBASE OR UTILITY VAULT.

THIS PROJECT REQUIRES EXCAVATION. CONSTRUCTION WILL UTILIZE AND IMPLEMENT ALL BEST MANAGEMENT PRACTICES (BMPs) AS REQUIRED TO ENSURE COMPLIANCE WITH AT&T POLICY LETTER ISSUE FEBRUARY 21, 2003 AND REVISED IN OCTOBER 2005 BY ENVIRONMENTAL MANAGEMENT CONCERNING STORM WATER PERMITTING AND STORM WATER POLLUTION PREVENTION PLANS (SWPPP's) AND IN ACCORDANCE WITH THE CLEAN WATER ACT (1972) AND EPA REGULATIONS PUBLISHED IN 1990 AS MODIFIED BY THE PHASE II RULE IN 1999.

LOCATION: N. ALTADENA DR., W/S OF STREET, 371' S/O CL OF GARFIAS DR.

DESCRIPTION: PLACE GROUND BED & 32' OF BARE # 6 GROUND WIRE AT POLE # 504272H.

BACKFILL SHALL BE PER COUNTY OF LOS ANGELES STANDARDS.

STREET TYPE	SOIL CLASS	PROPOSED BACKFILL
MAJOR	N/A	N/A
SECONDARY	N/A	N/A
LOCAL	N/A	N/A
ALLEY	N/A	N/A

CONDUIT RECORD: NO CONDUIT RECORD AVAILABLE

SUB MAP #: N/A

STREET NAME: N/A

MATERIAL: N/A

LINEAR FEET: N/A



EXCAVATION DATA



CITY OF:	LOS ANGELES COUNTY		
PLACING:	GROUND BED & 32' OF BARE # 6 GROUND WIRE		
EXCAVATION IN			
EXCAVATION IN CONCRETE SIDEWALK			
EXCAVATION IN ASPHALT STREET			
EXCAVATION IN ASPHALT ALLEY			
EXCAVATION IN DIRT	18' X 1' = 18 SQ FT		
EXCAVATION IN CONCRETE SIDEWALK			
TOTAL EXCAVATION:	18 SQ FT		
NUMBER OF CUTS:	1		
DATE	ATTID	DESIGN ENGINEER	
01/26/15	AFL / RVM	DAWN HOLTZMAN	
DRAWN	TELEPHONE NUMBER		
01/26/15	818-778-2404		
CHECKED	EMAIL ADDRESS		
	DH7852@ATT.COM		
APPROVED	FACILITY ENGINEER		
1/29/15	LINDA KUE		
DATE REVISIONS	TELEPHONE NUMBER		
	949-204-3317		
	SECCD		
	K1-07		
	CENTRAL OFFICE		
	PASADENA -LAKE		
	UNDERGROUND CONSTRUCTION PROJECT NUMBER		
	A002GJ1		
SCALE	THISSIDE ISSUE		
1" = 20'	566-E1		
FILENAME:	DRAWING:		
K107 A002JG1.dwg	4/4		

AFL Telecommunications
170 RIDGEVIEW CIRCLE
DUNCAN, SC 29334

PLACEMENT DATA

1. PL. 18 TR FT. # 6 GROUND WIRE
INSTALL 3 COPPER GRIMUD RODS
5/8" DIAMETER, 8' MINIMUM LENGTH
NO PM - PROTECTION PRECAUTION
R/C 22C
2. PL. 32' OF BARE # 6 GROUND WIRE
AT POLE # NO TAG (POLE #504272H)
R/C 22C

CONSTRUCTION NOTE:
ALL EXCAVATION WORK WILL BE HAND DIG.
NO EXCAVATION WILL TAKE PLACE PRIOR TO
WORK SITE BEING MARKED BY USA

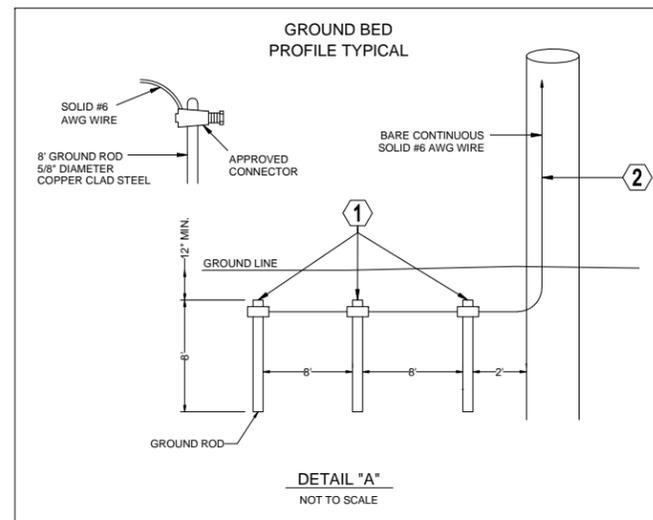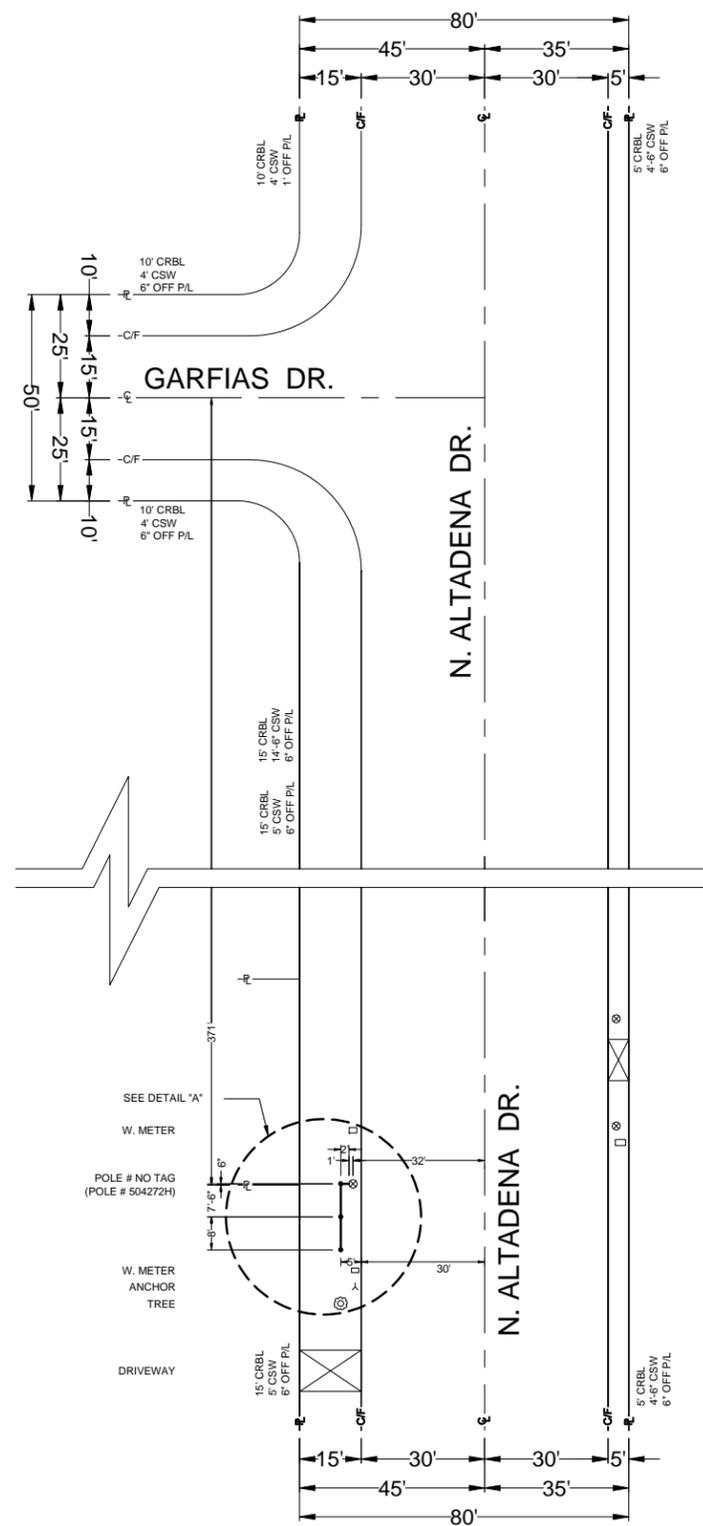

POLE # NO TAG

DRIVEWAY

POLE # 1798308E
W. METER

