

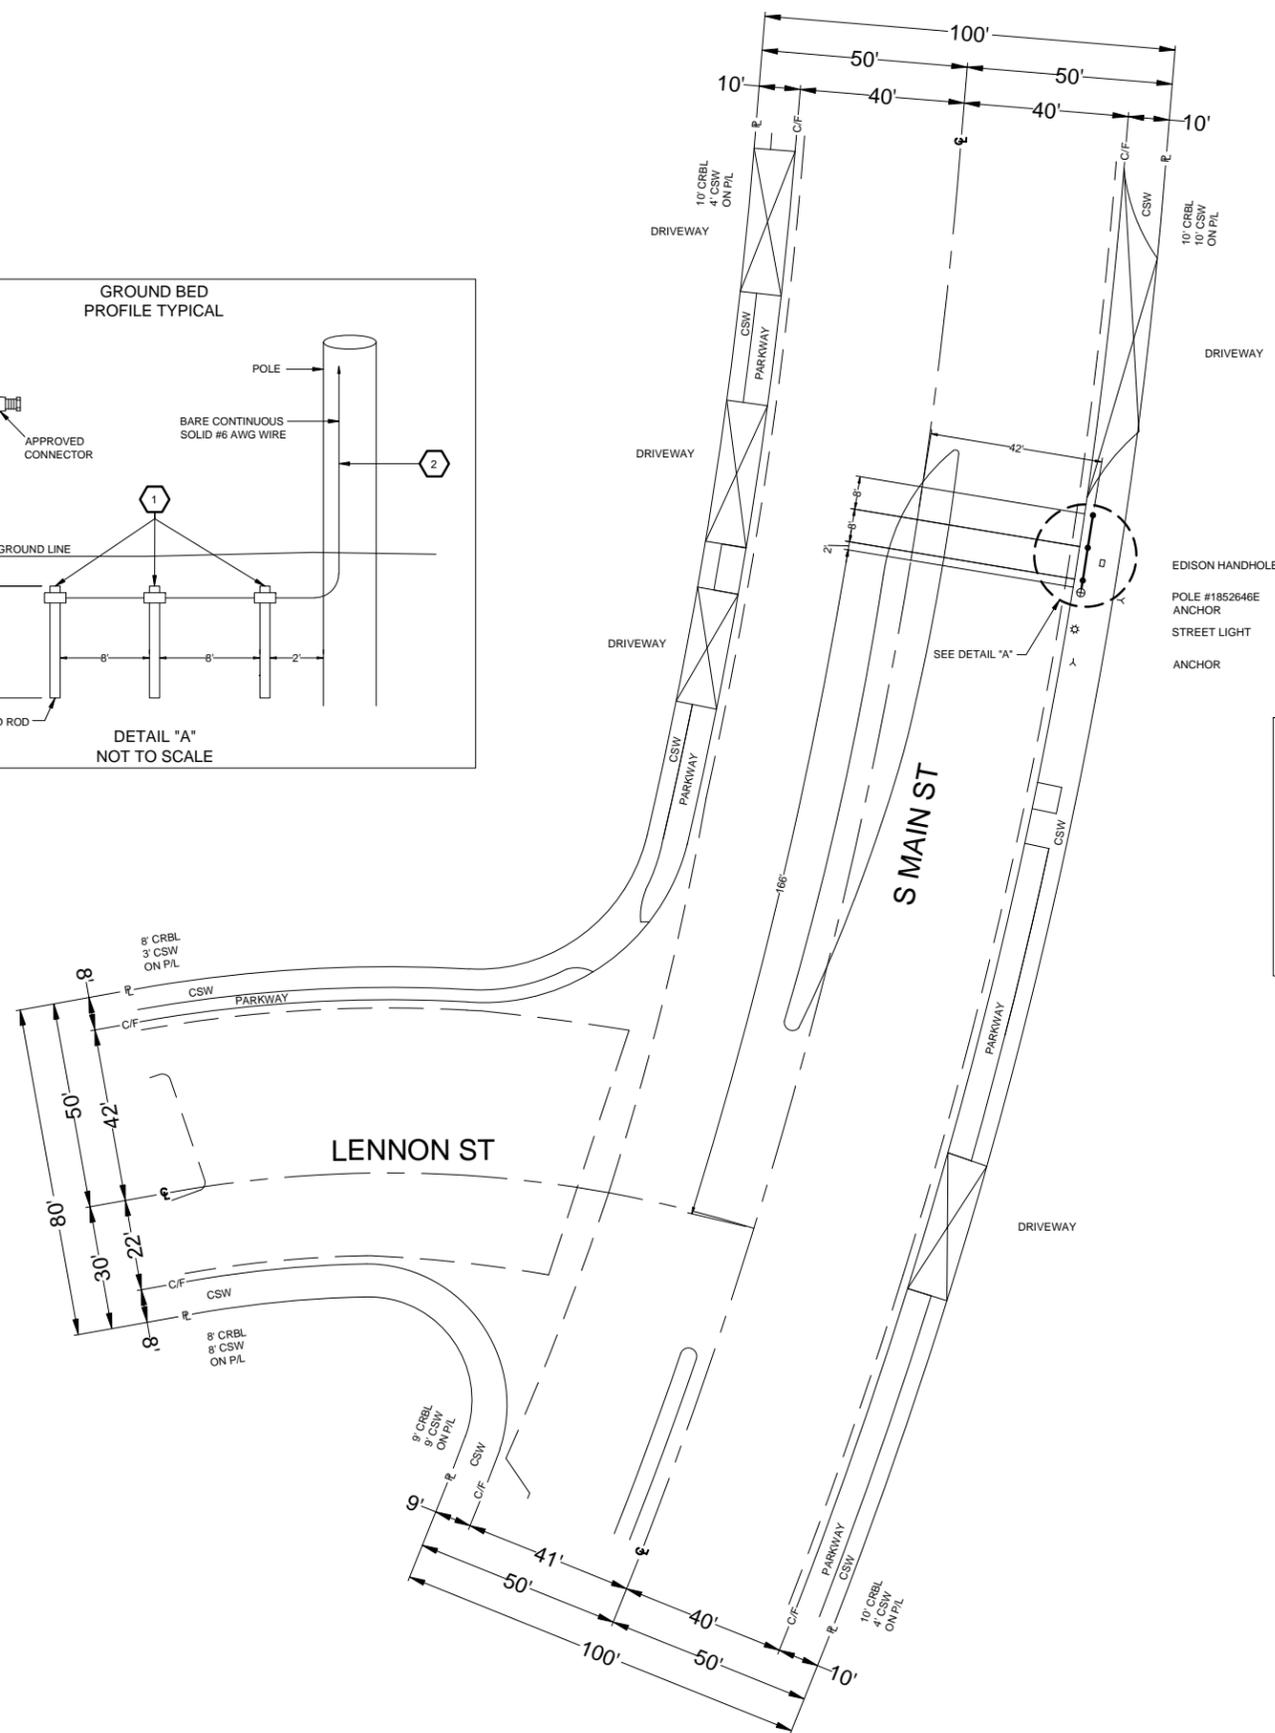


PLACEMENT DATA

- ① PL. 18 TR FT. # 6 GROUND WIRE
INSTALL 3 COPPER GROUND RODS
5/8" DIAMETER, 8' MINIMUM LENGTH
NO PM - PROTECTION PRECAUTION
R/C 22C
- ② PL. 32' # 6 GROUND WIRE ON
POLE # 1852646E
R/C 22C

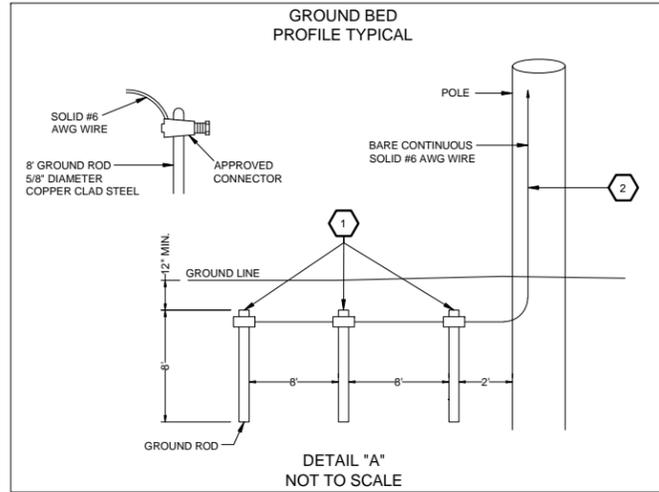

All excavation work will be hand dug.
No excavation will take place prior to
work site being marked by USA

FJS CABLE ENGINEERING, INC.
www.fjscei.com
23105HN
14340 Robin Olson Rd., Suite K
Whittier, CA 92603
TEL: (714) 997-5783
FAX: (714) 997-9993



CONSTRUCTION REQUIREMENTS

1. MAINTAIN MINIMUM COVER OF 36" BELOW FLOW LINE.
2. VERIFY EXISTING SUBSTRUCTURES PRIOR TO EXCAVATION.
3. ALL 4" TO CONFORM TO PTS.-77 OR EQUIVALENT.
4. ALL 2" TO CONFORM TO PTS.-86 OR EQUIVALENT.
5. ALL BACKFILL TO BE SAND 12" BELOW AND 6" ABOVE.
6. DO NOT BACKFILL OVER ANY TELEPHONE BURIED SPLICE LOCATIONS UNTIL AUTHORIZED BY TELEPHONE COMPANY INSPECTOR.
7. PLACE # 6 TINNED GROUND WIRE AT BONDING POINTS. (SEE BONDING DETAIL)
8. PLACE PULL ROPE IN NEW CONDUIT.
9. DO NOT CUT CURB & GUTTER.
10. ALL SURFACES AND LANDSCAPES WHICH HAVE BEEN REMOVED OR DAMAGED IN THE COURSE OF CONSTRUCTION SHALL BE RECONSTRUCTED OR REPLACED TO AT LEAST EQUAL OR BETTER THAN THE PREVIOUS OR ADJACENT SURFACE.
11. ALL TRAFFIC CONTROL TO BE IN ACCORDANCE WITH THE CALIFORNIA MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) LATEST EDITION.
12. PER AT&T GUIDELINES, ALL HANDHOLES, SPLICE BOXES, AND MANHOLES TO BE PURCHASED FROM EITHER NEWBASE OR UTILITY VAULT.

THIS PROJECT REQUIRES EXCAVATION. CONSTRUCTION WILL UTILIZE AND IMPLEMENT ALL BEST MANAGEMENT PRACTICES (BMPs) AS REQUIRED TO ENSURE COMPLIANCE WITH AT&T POLICY LETTER ISSUE FEBRUARY 21, 2003 AND REVISED IN OCTOBER 2005 BY ENVIRONMENTAL MANAGEMENT CONCERNING STORM WATER PERMITTING AND STORM WATER POLLUTION PREVENTION PLANS (SWPPP's) AND IN ACCORDANCE WITH THE CLEAN WATER ACT (1972) AND EPA REGULATIONS PUBLISHED IN 1990 AS MODIFIED BY THE PHASE II RULE IN 1999.

LOCATION: S MAIN ST E/S OF THE STREET 166' NO C/L OF LENNON ST

DESCRIPTION: PLACE GROUND BED AND 32' OF BARE #6 GROUND WIRE AT POLE #1852646E

BACKFILL SHALL BE PER COUNTY OF LOS ANGELES STANDARDS

STREET TYPE	SOIL CLASS	PROPOSED BACKFILL
MAJOR	N/A	N/A
SECONDARY	N/A	N/A
LOCAL	N/A	N/A
ALLEY	N/A	N/A

CONDUIT RECORD: N/A	
SUB MAP #: N/A	
STREET NAME: N/A	
MATERIAL: N/A	
LINEAR FEET: N/A	

EXCAVATION DATA			
CITY OF:	COUNTY OF LOS ANGELES	DATE:	7-07-15
PLACING:	GROUND BED AND BARE #6 GROUND WIRE	ATTID:	AL1832
EXCAVATION IN:		LAYOUT ENGINEER:	ANDREW LEWIS
EXCAVATION IN CONCRETE SIDEWALK	18' X 1' = 18 SQ FT	TELEPHONE NUMBER:	818-778-2720
EXCAVATION IN ASPHALT STREET		EMAIL ADDRESS:	
EXCAVATION IN ASPHALT ALLEY		FACILITY ENGINEER:	TANYA JAMES
EXCAVATION IN DIRT		TELEPHONE NUMBER:	949-204-3317
TOTAL EXCAVATION:	18 SQ FT	PERIOD:	A5-06
NUMBER OF CUTS:	1	CENTRAL OFFICE:	GARDENA
DATE:	7/9/15	UNDERGROUND CONSTRUCTION PROJECT NUMBER:	A00608F
REVISIONS:		SCALE:	1" = 20'
		THOMAS GUIDE:	734-D4
		FILENAME:	A506 A00608F.dwg
		DRAWING:	1/1