



CONSTRUCTION REQUIREMENTS

1. MAINTAIN MINIMUM COVER OF 36" BELOW FLOW LINE.
2. VERIFY EXISTING SUBSTRUCTURES PRIOR TO EXCAVATION.
3. ALL 4" TO CONFORM TO PTS-77 OR EQUIVALENT.
4. ALL 2" TO CONFORM TO PTS-66 OR EQUIVALENT.
5. ALL BACKFILL TO BE SAND 12" BELOW AND 6" ABOVE.
6. DO NOT BACKFILL OVER ANY TELEPHONE BURIED SPLICE LOCATIONS UNTIL AUTHORIZED BY TELEPHONE COMPANY INSPECTOR
7. PLACE # 6 TINNED GROUND WIRE AT BONDING POINTS. (SEE BONDING DETAIL)
8. PLACE PULL ROPE IN NEW CONDUIT.
9. DO NOT CUT CURB & GUTTER.
10. ALL SURFACES AND LANDSCAPES WHICH HAVE BEEN REMOVED OR DAMAGED IN THE COURSE OF CONSTRUCTION SHALL BE RECONSTRUCTED OR REPLACED TO AT LEAST EQUAL OR BETTER THAN THE PREVIOUS OR ADJACENT SURFACE.
11. ALL TRAFFIC CONTROL TO BE IN ACCORDANCE WITH THE CALIFORNIA MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) LATEST EDITION.
12. PER AT&T GUIDELINES, ALL HANDHOLES, SPLICE BOXES, AND MANHOLES TO BE PURCHASED FROM EITHER NEWBASE OR UTILITY VAULT.

THIS PROJECT REQUIRES EXCAVATION. CONSTRUCTION WILL UTILIZE AND IMPLEMENT ALL BEST MANAGEMENT PRACTICES (BMPs) AS REQUIRED TO ENSURE COMPLIANCE WITH AT&T POLICY LETTER ISSUE FEBRUARY 21, 2003 AND REVISED IN OCTOBER 2005 BY ENVIRONMENTAL MANAGEMENT CONCERNING STORM WATER PERMITTING AND STORM WATER POLLUTION PREVENTION PLANS (SWPPP) AND IN ACCORDANCE WITH THE CLEAN WATER ACT (1972) AND EPA REGULATIONS PUBLISHED IN 1990 AS MODIFIED BY THE PHASE II RULE IN 1999.

LOCATION: ALLEY N/S OF ALLEY, 186'-6" N/O C/L OF CESAR E. CHAVEZ AVE., 29' E/O C/L OF DITMAN AVE.

DESCRIPTION: PLACE GROUND BED AND 32' OF BARE #6 GROUND WIRE AT POLE# 483906H.

BACKFILL SHALL BE PER COUNTY OF LOS ANGELES STANDARDS.

STREET TYPE	SOIL CLASS	PROPOSED BACKFILL
MAJOR	N/A	N/A
SECONDARY	N/A	N/A
LOCAL	N/A	N/A
ALLEY	N/A	N/A

CONDUIT RECORD: N/A.

SUB MAP #:	N/A
STREET NAME:	N/A
MATERIAL:	N/A
LINEAR FEET:	N/A



EXCAVATION DATA

CITY OF:	LOS ANGELES COUNTY
PLACING:	GROUND BED 32' BARE# 6 GROUND WIRE
EXCAVATION IN CONCRETE SIDEWALK	
EXCAVATION IN ASPHALT STREET	
EXCAVATION IN ASPHALT ALLEY	18' X 1' = 18 SQ FT
EXCAVATION IN DIRT	

TOTAL EXCAVATION: 18' X 1' = 18 SQ FT

DATE	ATTID	LAYOUT ENGINEER
5/7/14	AFL/MP	Jovito Fadrigio
CHECKED	jB462	TELEPHONE NUMBER
05/14/14		626-817-4234
APPROVED		FACILITY ENGINEER
		LAURA FITZHARRIS




DATE	REVISIONS	TELEPHONE NUMBER
		(909) 242-0434
		GEOCO
		E3-10
		CENTRAL OFFICE
		ANGELLUS

SCALE: 1" = 20'
THOMAS GUIDE: 635-D5
PROJECT NUMBER: 8877561 REL 2

FILENAME: E310 8877561 REL 2.dwg
DRAWING: 1/1

PLACEMENT DATA

1. PL. 18 TR FT. # 6 GROUND WIRE
INSTALL 3 COPPER GROUND RODS
5/8" DIAMETER, 8' MINIMUM LENGTH
NO PM - PROTECTION PRECAUTION
R/C 22C
2. PL. 32' OF BARE # 6 GROUND WIRE
POLE # 483906H
R/C 22C

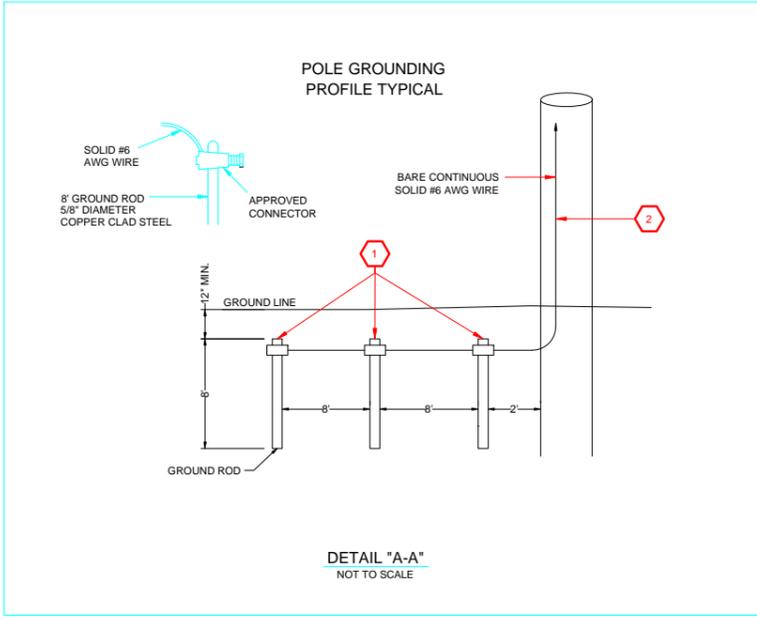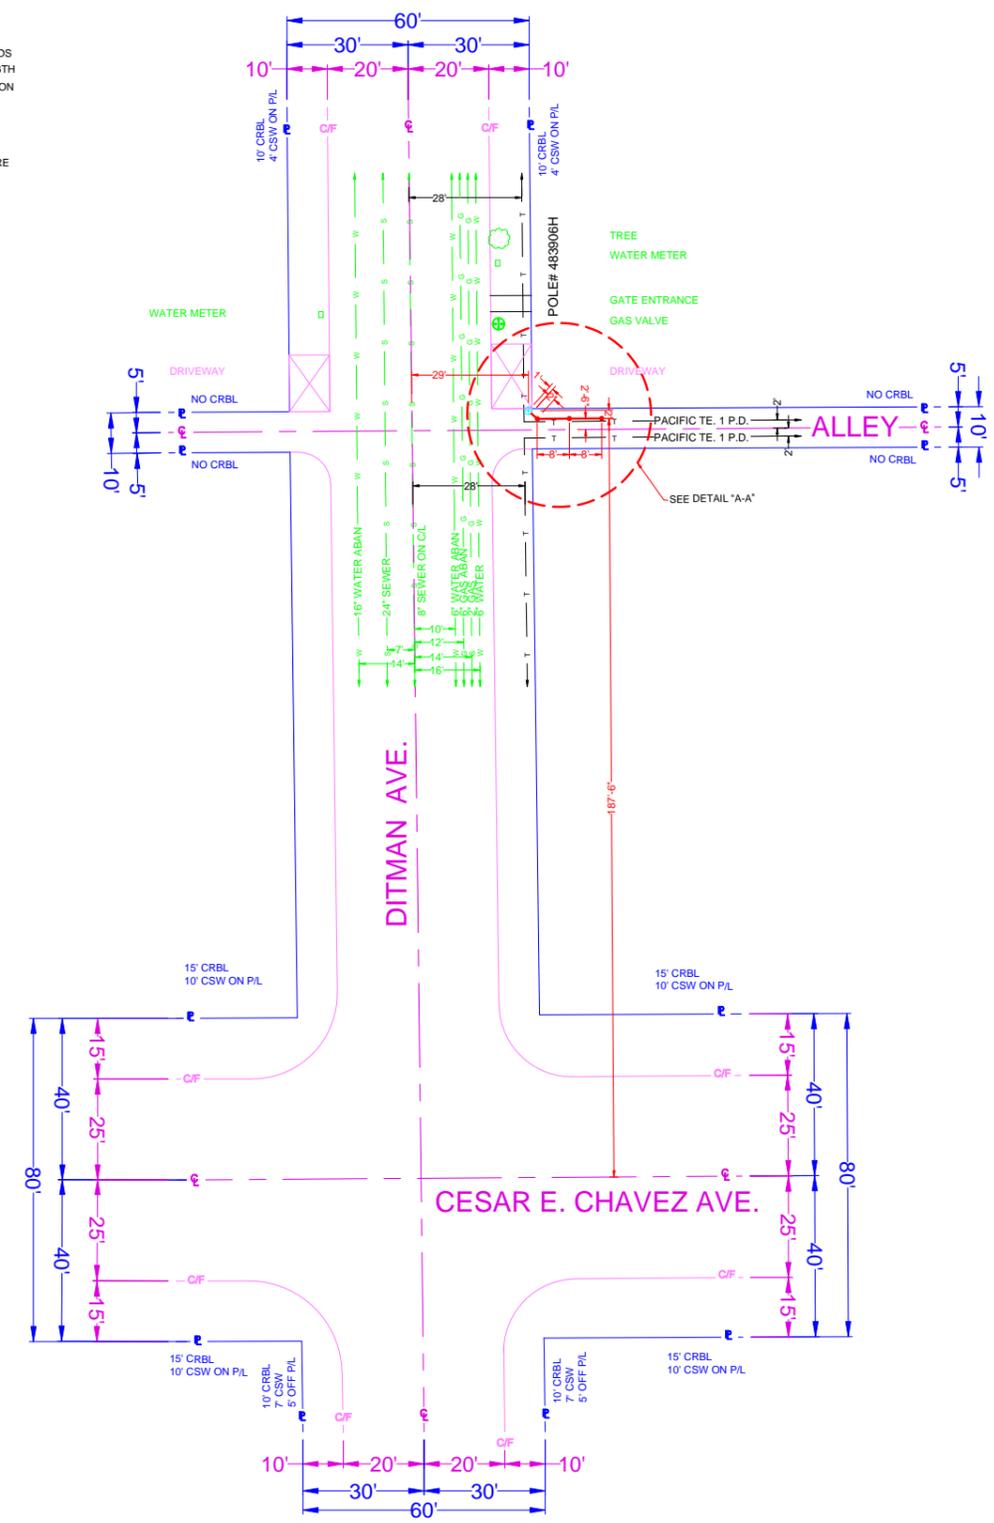

AFL Telecommunications
170 RIDGEVIEW CIRCLE
DUNGAN, SC 29334