ASPLUNDH CONSTRUCTION CORP.

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

DETERIORATED POLE REPLACEMENT

CIRCUIT (S):
MOONGLOW 12KV o/o QUARTZ HILL SUB

STA'S 9-10

ADDRESS:
LOCATION: 43RD ST W E/S, 310' N/O AV K-10
CITY: LANCASTER
*** NOTES:**

TRANSFER (S):
2/C 6B-12KV
1-1/0AT-120V (W)
1-4AT-120V (SVC)

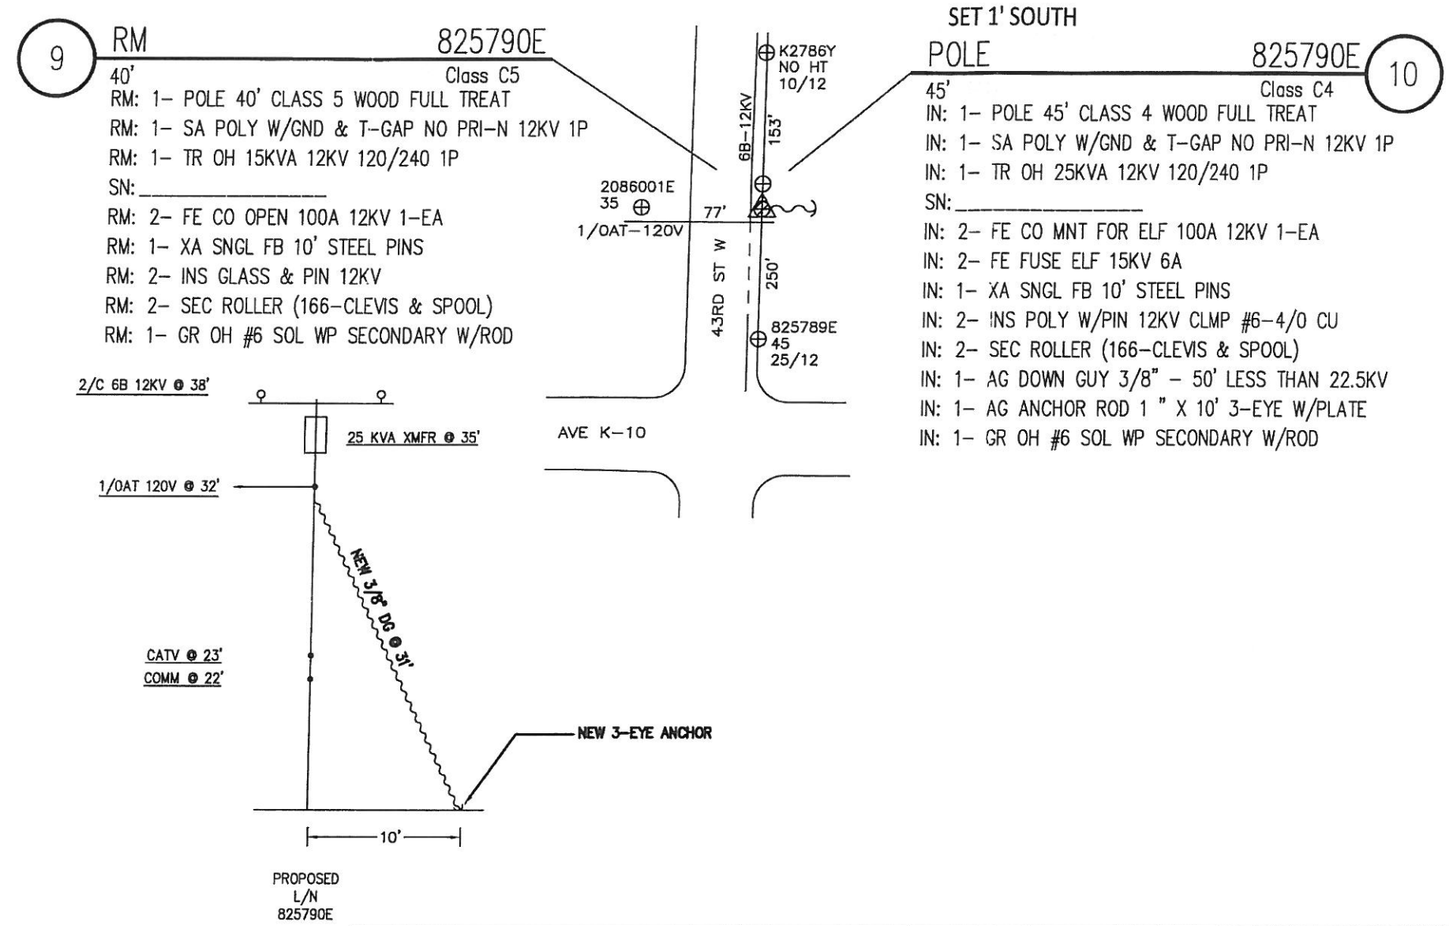

NOT TO SCALE

PERMIT REQ'D.

CALTRANS:	
ENCROACHMENT:	
RAILROAD:	
HELICOPTER:	
OTHER:	

SPEED LIMIT 25

PEDESTRIAN TRAFFIC CONTROL REQUIRED
☐ YES ☒ NO

GPS: LAT: N 34° 39' 57.8"
LONG: W 118° 12' 26.8"

TLM DATA:

	SIZE	KVA	CUST.	% LOAD
EXIST	15	17	2	113.3
PROP.	25	17	2	68

VOLTAGE DROP ____ %

PRI. CIRC. MOONGLOW 12KV

NOTES

JOINT POLE:	X
RENTER:	
MITC FUME:	
JOINT MEET:	
TRUCK ACCESS:	X
HAND SET:	
CONTACT CATV:	
ENVIRONMENTAL:	
REAL PROP. REVIEW:	
PAVEMENT REPAIR:	
☐ CONCRETE ☐ ASPHALT	____X____

DISTRICT 36 – ANTELOPE VALLEY	PROJ. MGR. RODRIGUEZ, JOHN T PHONE 909-469-0219		PLANNER UNG, CASEY PHONE 714-893-2405		
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 138-78B	THOMAS GUIDE LA 4104-J3	GRID NO.
DESIGN NO. 573162_0.01					
CSD 140 Y____ N____	BY-PASS CODE	EXISTING ____ CHANGE TO ____	TLM CHECKED ____ %LOAD	J.P.A. NO. 4060082677	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 821005-INFRA REP - DET POLE RELACE	PRODUCT/SAP NO.			PRODUCT/SAP NO.	

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

PROPOSED CONSTRUCTION (LOCATION)
DETERIORATED POLE REPLACEMENT
VARIOUS ANTELOPE VALLEY CA 93534
ANTELOPE VALLEY

SHEET ____ OF ____

JOB NO. 573162_0.01

Southern California Edison Company