ASPLUNDH CONSTRUCTION CORP.

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

DETERIORATED POLE REPLACEMENT

CIRCUIT (S):
MOONGLOW 12KV o/o QUARTZ HILL SUB

STA'S
1-2

ADDRESS:
LOCATION: 45TH ST W E/S 1280' S/O AV K
CITY: LANCASTER
*** NOTES:**

1 RM 917739E
40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- SA POLY W/GND PRI-N 12K 3P
RM: 2- XA SNGL FB 10' STEEL PINS
RM: 4- INS GLASS & PIN 12KV
RM: 2- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

SET SAME HOLE

POLE 917739E 2
45' Class H1
IN: 1- POLE 45' CLASS H1 WOOD FULL TREAT
IN: 1- SA POLY W/GND PRI-N 12K 3P
IN: 2- XA SNGL FB 10' STEEL PINS
IN: 1- INS POLY W/PIN 12KV CLMP #4-653 ACSR
IN: 3- INS POLY W/PIN 12KV CLMP #6-4/0 CU
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- AG DOWN GUY 9/32" - 50' LESS THAN 22.5KV

TRANSFER (S):
- 3/C 4B-12KV
- 1-2A-12KV
- 1-1/0AT-120V
- 2-4AT-120V
- 3-12KV POTHEADS
- 1-4" RISER

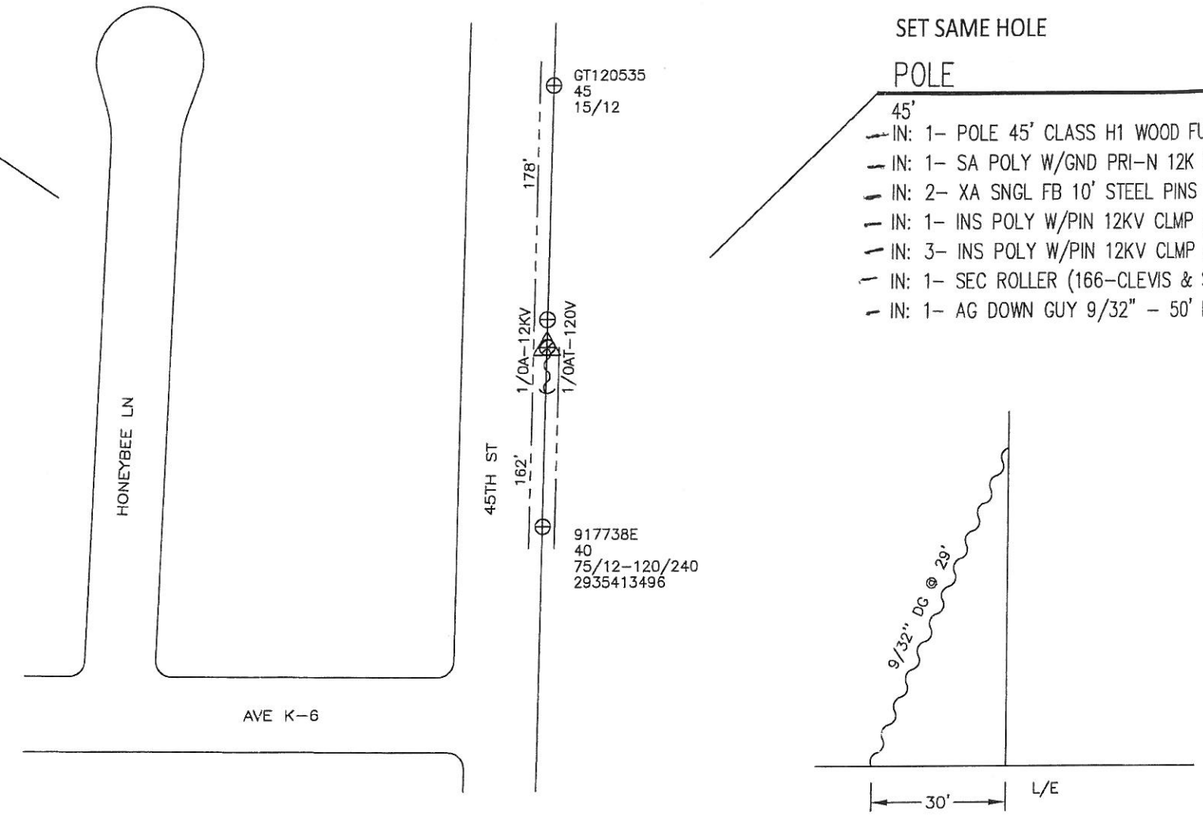

EXISTING RISER DETAIL



NOT TO SCALE

PERMIT REQ'D.
- CALTRANS:
- ENCROACHMENT:
- RAILROAD:
- HELICOPTER:
- OTHER:

SPEED LIMIT 35

PEDESTRIAN TRAFFIC CONTROL REQUIRED
[X] YES [ ] NO

GPS: LAT: N 34° 40.2' 57"
LONG: W 118° 12.6' 12"

TLM DATA:

	SIZE	KVA	CUST.	% LOAD
EXIST				
PROP.				

VOLTAGE DROP ____ %
PRI. CIRC. _____

NOTES

JOINT POLE:	X
RENTER:	
MITC FUME:	
JOINT MEET:	
TRUCK ACCESS:	X
HAND SET:	
CONTACT CATV:	
ENVIRONMENTAL:	
REAL PROP. REVIEW:	
PAVEMENT REPAIR:	
[ ] CONCRETE / [ ] ASPHALT	____X____

DISTRICT 36 - ANTELOPE VALLEY	PROJ. MGR. RODRIGUEZ, JOHN T. PHONE 909-469-0219		PLANNER CHENIER, WARREN PHONE 714-893-2405		
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 138-74A	THOMAS GUIDE LA 4104-J2	GRID NO.
DESIGN NO. 573546_0.01					
CSD 140 Y ___ N ___	BY-PASS CODE	EXISTING ___ CHANGE TO ___	TLM CHECKED ___ %LOAD	J.P.A. NO. 401023842	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 821529-INFRA REP - DET POLE RELACE		PRODUCT/SAP NO.		PRODUCT/SAP NO.	

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #
				LW	

PROPOSED CONSTRUCTION (LOCATION)
DET POLE REPLACEMENT
VARLOC VARIOUS ANTELOPE VALLEY CA 93534
ANTELOPE VALLEY

SHEET ___ OF ___
JOB NO. 573546_0.01

Southern California Edison Company