NEWHALL

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 50'

0 50 100

CO. PERMIT REQUIRED
ENCROACHMENT ____
SPATS ✓

EXISTING 1248724E (1)
50' CLASS C4
RM: 1–MTR KWH 30A 120/240 1P 3W (DM 900)
IN: 1–MTR KWH 30A 120/240 1P 3W (DM 900)

CALGROVE 16KV
NEWHALL
C3

EXISTING 1248724E (2)
50' Class C4
EX: 1– TR OH 15KVA 16KV 120/240 1P
RM: 1– RSR ALL SIZES PVC/HDG
RM: 50– CBL 2–1/0 1–#2 AL 3–1/C 600V CLP DB
RM: 1– TM 2–1/0 & 1–#2 600V 1P UG TO OH

EXISTING 4393496E (3)
40' Class C5
IN: 1– RSR 3" TO 2" EXTENSION
CF: 1– CM DUCT 2 1/2" TO 4"
CF: 135– CM DUCT FOR EXCAVATION
IN: 165– CBL 2–1/0 1–#2 AL 3–1/C 600V IN DUCT
IN: 1– TM 2–1/0 & 1–#2 600V 1P UG TO OH

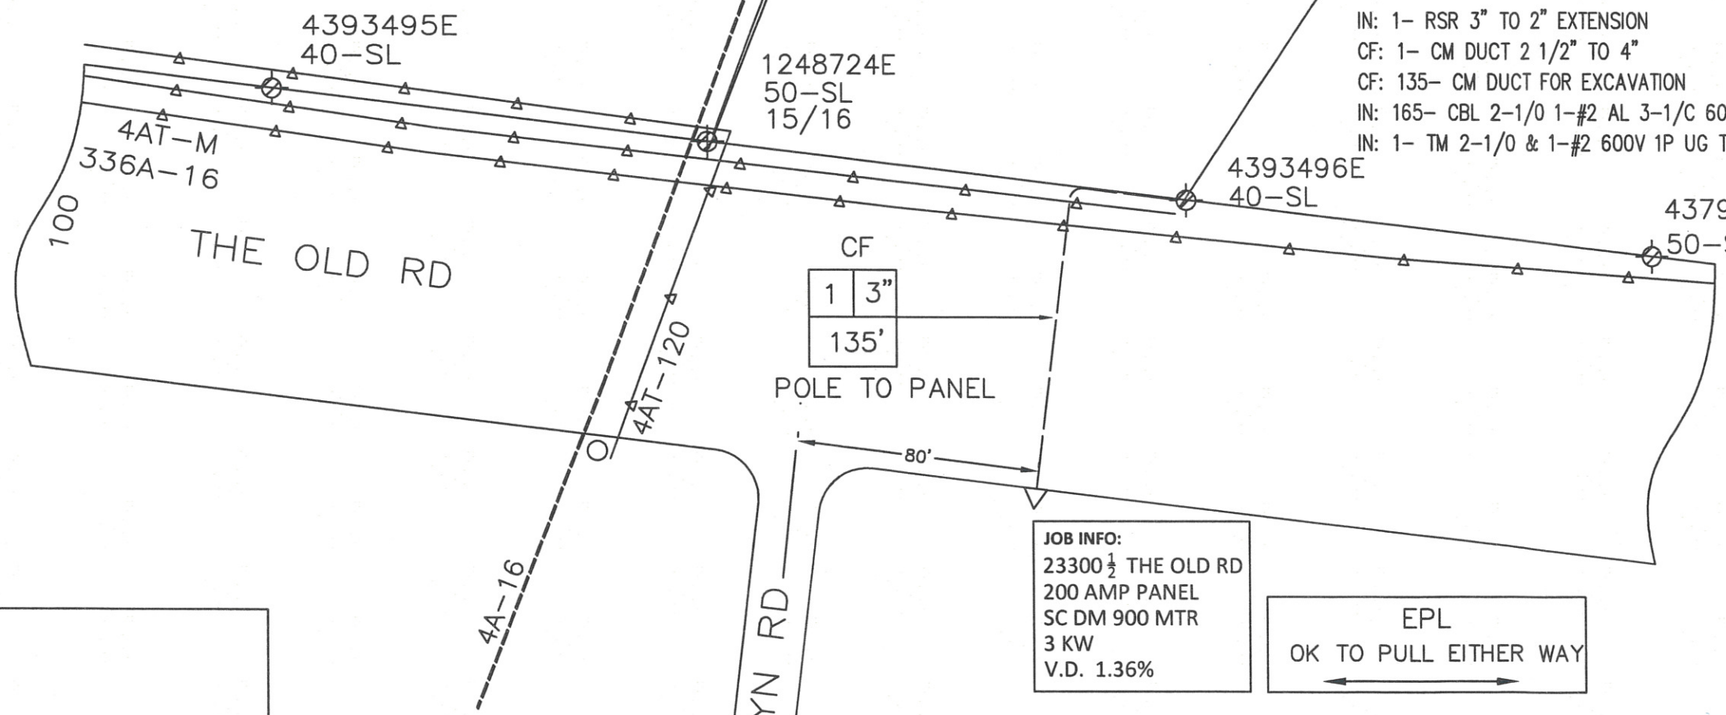

TLM DATA:	1248724E			
	SIZE	kVA	CUST	%LOAD
EXIST:	15	5.6	2	37.55
PROP:	15	6	2	40
VD= 1.36		FLICKER= N/A		

JOB INFO:
23300 ½ THE OLD RD
200 AMP PANEL
SC DM 900 MTR
3 KW
V.D. 1.36%

EPL
OK TO PULL EITHER WAY

CUSTOMER:
CALTRANS
MARIO GARCIA, INSPECTOR
PHONE: (949) 456-6213

VICINITY MAP

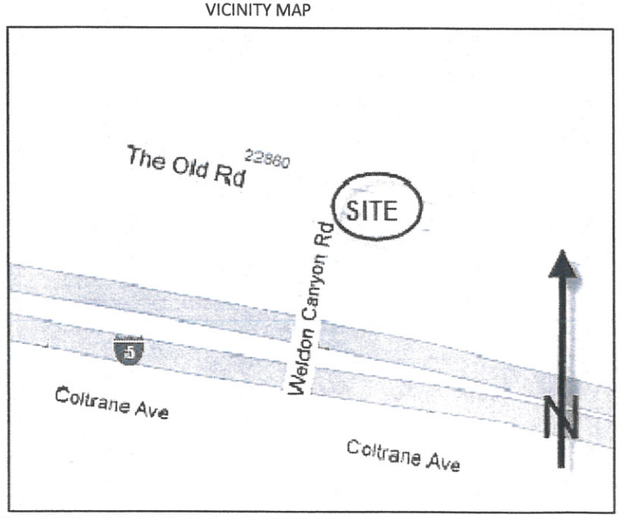

RISER DETAIL

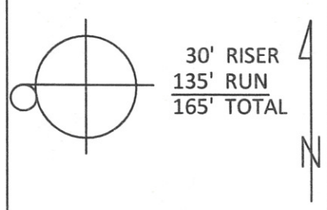

RISER TO BE PLACED IN SE QUADRANT

DISTRICT 59 – VALENCIA	PROJ. MGR. JENSEN, BOBBIE PHONE 661–257–8274		PLANNER JENSEN, BOBBIE PHONE 661–257–8274		
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 99–57	THOMAS GUIDE 4641 A6	GRID NO.
DESIGN NO. 437704_0.01					
CSD 140 Y ____ N ____	BY–PASS CODE	EXISTING ____ CHANGE TO ____	TLM CHECKED ____ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 611725-METER & SERVICE CHANGE	PRODUCT/SAP NO.		PRODUCT/SAP NO.		

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

PROPOSED CONSTRUCTION (LOCATION)
23300 1/2 THE OLD RD
NEWHALL CA 91321

SHEET 2 OF 2

JOB NO. 437704_0.01

Southern California Edison Company

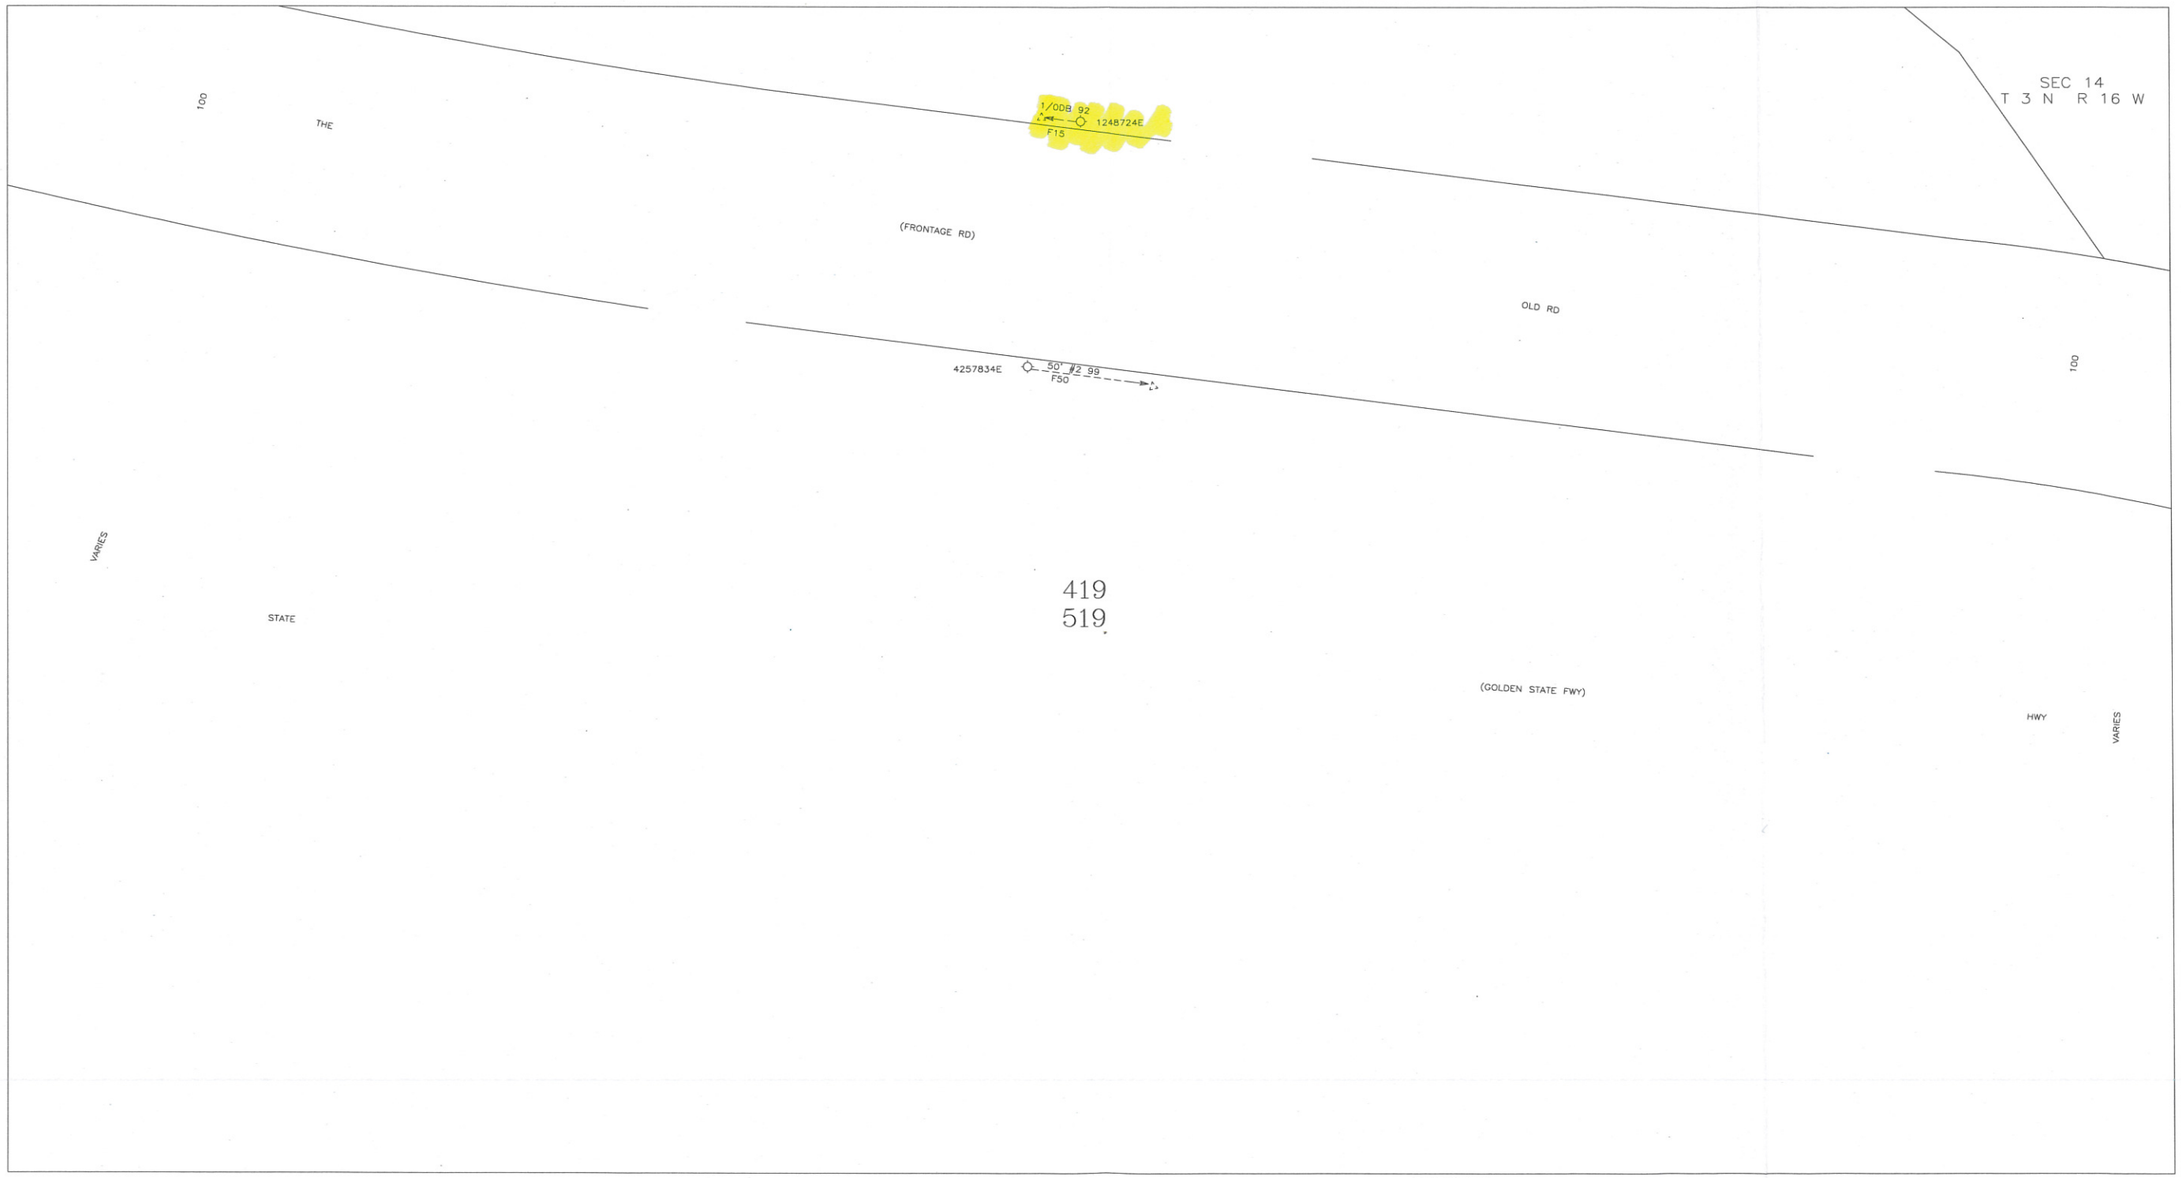

7-02 LLUND	
	JMEDI