EX: CO 25' WOOD POLE

VD=0.43%
FL=4.30%
200AMP PANEL
120/240V 1PHASE
6.5KW 4.5TON

11693 E AVENUE K LANCASTER CA 93536

NO PTC

PERMIT REQUIRED

TLM DATA:	4686865E			
	SIZE	kVA	CUST	%LOAD
EXIST:	N/A	N/A	N/A	N/A
PROP:	25	6.5	1	26
VD= .43		FLICKER= 4.30		

IN: 91' 1/0 ATT

EX: 3-336A-12

EAST AVENUE K

EXISTING 4686865E

1

25' Class C5

IN: 1- FE CO OPEN W/8' XA 100A 12KV 1P
IN: 1- SA POLY W/GND & T-GAP NO PRI-N 12KV 1P
IN: 2- FE FUSE LINK 2.4 TO 25KV 5A
IN: 2- INS GLASS DE ROLLER 1/0 ACSR
IN: 1- TR OH 25KVA 12KV 120/240 1P
SN: _____
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD
IN: CD 1/0 STR AL TRIPLEX W/ACSR NEUTR 91' (1 runs)
IN: 1- MTR KWH 30A 120/240 1P 3W

PETAN
PIUTE

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 40'

0 40 80

MSR: 7306268

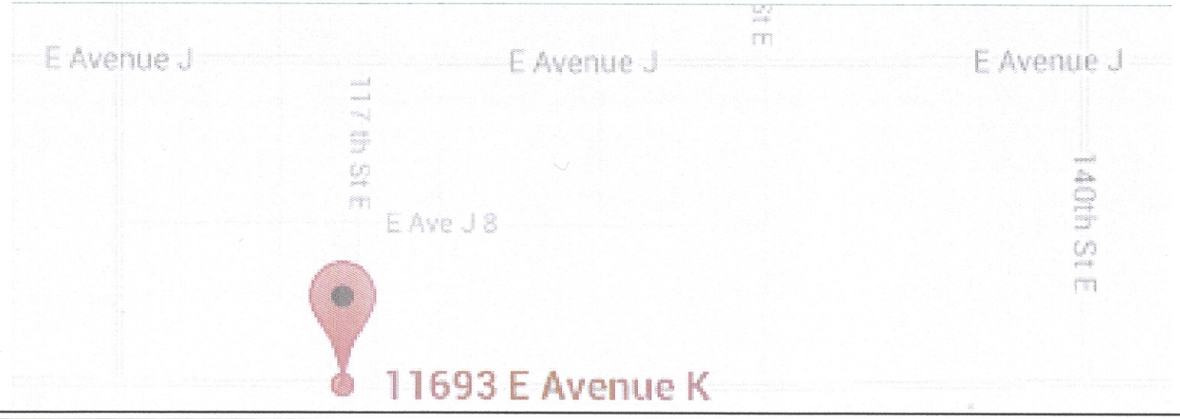

DISTRICT	PROJ. MGR.	PLANNER	
36 – ANTELOPE VALLEY	LLOYD JR, JAMES RAY	LLOYD JR, JAMES RAY	
	PHONE 667.726.5672	PHONE 667.726.5672	

FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO.	THOMAS GUIDE	GRID NO.	DESIGN NO.
			139-89	LAC4108F1		456742_0.01

CSD 140 Y___ N___	BY-PASS CODE	EXISTING _____ CHANGE TO _____	TLM CHECKED _____ %LOAD	J.P.A. NO. N/A	ASSOCIATED DESIGN NO.

PRODUCT/SAP NO.	PRODUCT/SAP NO.	PRODUCT/SAP NO.
646439-LINE EXTENSION		

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)

11693 E AVENUE K
LANCASTER CA 93535

SHEET	JOB NO.
1 OF 1	456742_0.01

459229E / 4686865E

11684 East Avenue K
Exit Street View
© 2014 Google
Google earth
Report a problem
34°4'0.31.14" N 117°55'19.27" W elev 2491 ft
Eye alt 2499 ft

EX
CUSTOMER
OWNED
POLE
25'
EX
4592229E