END POINT TESTING

To schedule End Point Testing (EPT), call the EPT Hotline at (714) 285-4325, 7:00 AM to 4:00 PM, Mon. – Fri. If the test needs to be performed after hours, please state the day and approximate timeframe.

D17 Rev: 12/01/09

EXISTING 4651419E (1)
50' Class C4
RM: 1- SW KPF HZ DE 600A 12KV 3W/4W
SN: _____
RM: 1- AE AR OIL 16KV 560A
IN: 1- SW OMNI HZ-I RP DE 600A 12KV 3W
SN: _____
IN: 1- AE AR VAC W/DISC SW 12KV 600A 3P

REPLACE KPF SWITCH WITH INVERTED OMNI-RUPTER
USE EXISTING DISCONNECTS & SEL-351R CONTROLLER
REPLACE OIL FILLED RECLOSER WITH G&W VIPER RECLOSER
INSTALL DEDICATED CONTROL TRANSFORMER
CONSTRUCT PER DOH AP505

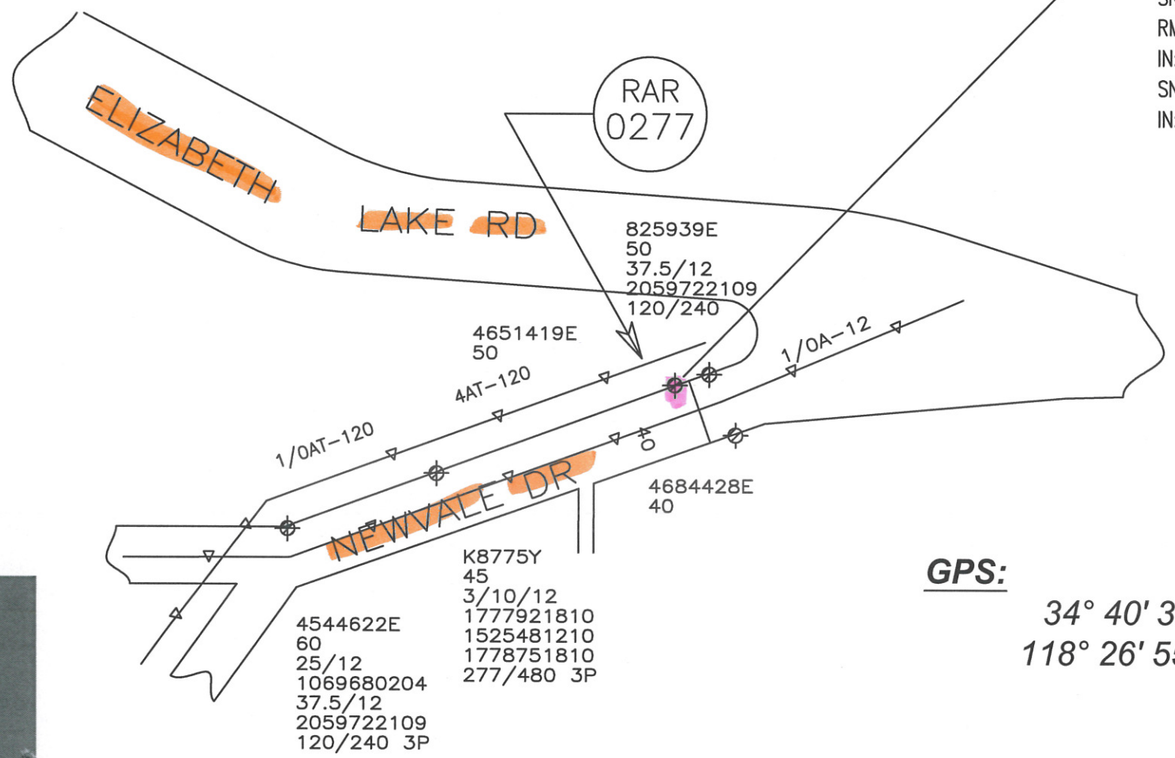

GPS:

34° 40' 38" N
118° 26' 55" W

4651419E 825939E

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 100'
0 100 200

LAKE HUGHES 12KV o/o DEL SUR

DISTRICT 36 – ANTELOPE VALLEY	PROJ. MGR. DIELI, JOHN L PHONE		PLANNER DWIGHT MATNEY PHONE 75606		
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 140-61	THOMAS GUIDE LA 4101 H2	GRID NO.	DESIGN NO. 493734_0.01
CSD 140 Y ___ N ___	BY-PASS CODE	EXISTING ___ CHANGE TO ___	TLM CHECKED ___ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 703259-INFRA REPLACE-AUTO RECLOSERS	PRODUCT/SAP NO.	PRODUCT/SAP NO.			

PROPOSED CONSTRUCTION (LOCATION)
SCE – OH RAR REPLACEMENT 2014
18023 NEWVALE DR
LAKE HUGHES

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

Southern California Edison Company

SHEET 1 OF 1

JOB NO. 493734_0.01

N2
EXISTING SCE POLE
ELIZABETH LAKE ROAD
Newvale Dr
© 2014 Google
Google