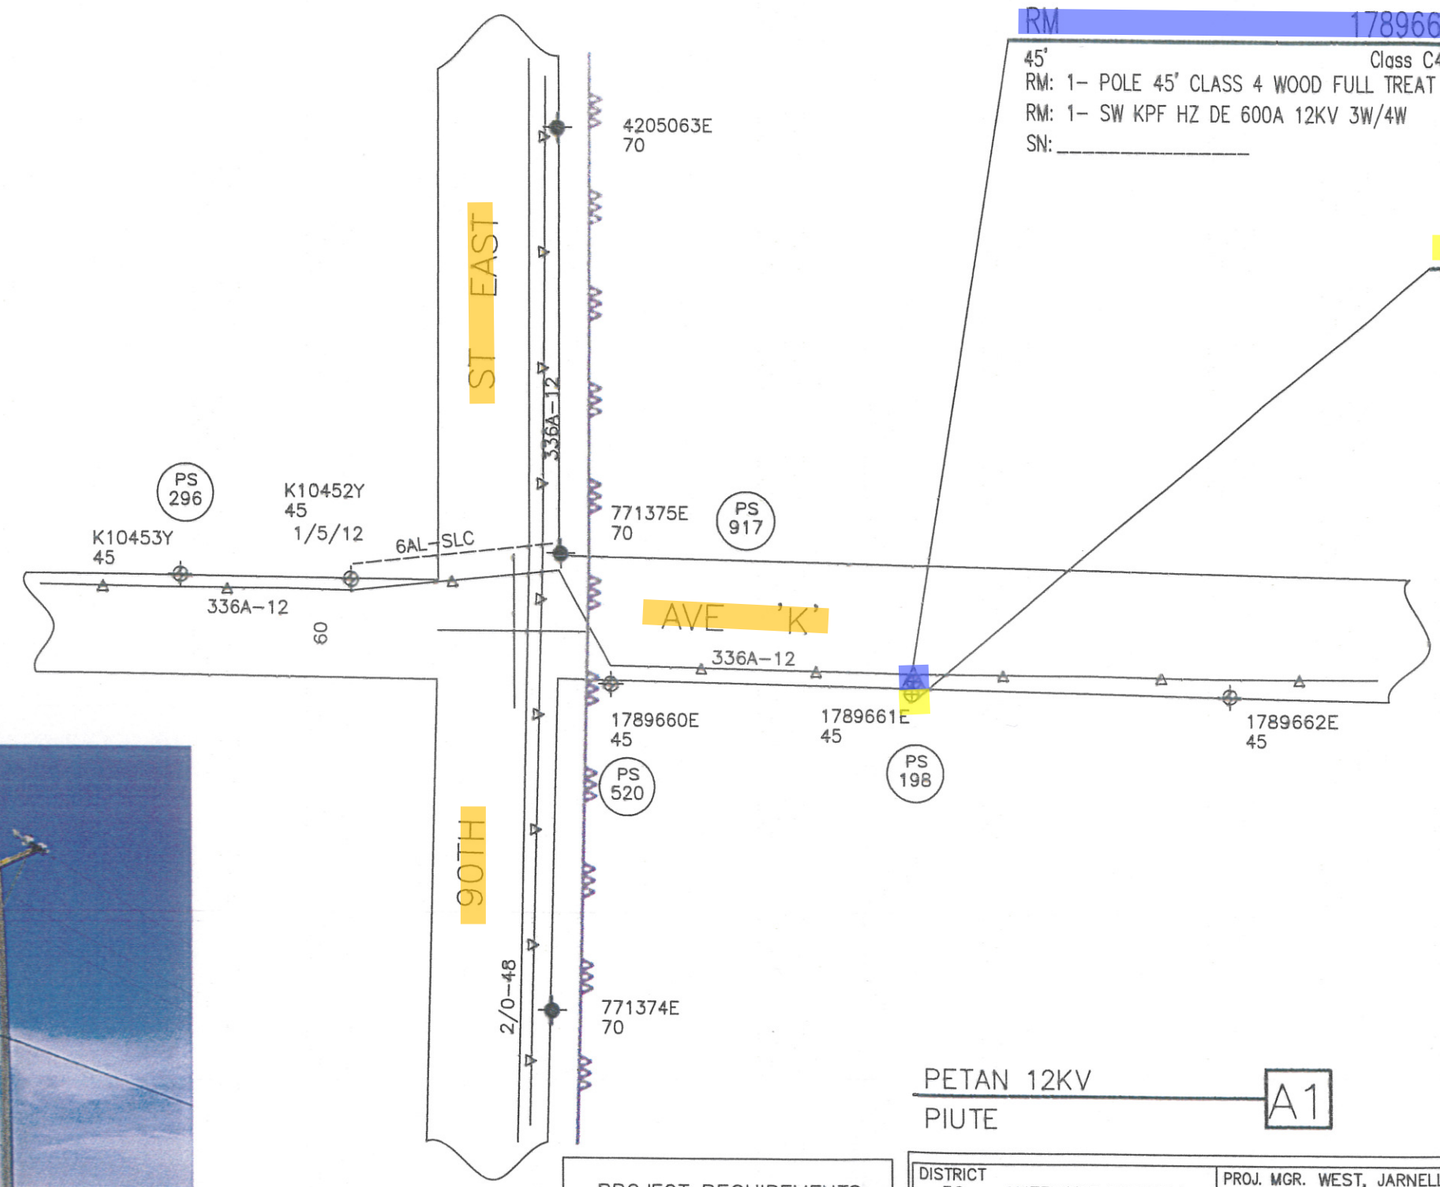

RM 1789661E 1

45' Class C4

RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT

RM: 1- SW KPF HZ DE 600A 12KV 3W/4W

SN: _____

POLE 1789661E 2

45' Class C1

IN: 1- POLE 45' CLASS 1 WOOD FULL TREAT

IN: 1- XA DBLE VB 10' STEEL PINS

IN: 6- INS POLY DE 12KV HOT SHOE 336 ACSR

IN: 1- SW OMNI HZ-I RP DE 600A 12KV 3W (INVERTED)

SN: _____

HARD SET POLE SOUTH.
TRANSFER PRIMARY.
TRANSFER TELCO.
LABEL SWITCH AS PS0198.
SEE TD808695 FOR RELATED WORK.

GPS:

34° 40' 32" N
117° 58' 07" W

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 100'

0 100 200

PETAN 12KV
PIUTE

A1

1789661E

PROJECT REQUIREMENTS	
ENVIRONMENTAL REQUIRED	N
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
PERMIT REQUIRED	Y
OUTAGE REQUIRED	N
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N

DISTRICT 36 – ANTELOPE VALLEY	PROJ. MGR. WEST, JARNELL PHONE		PLANNER DWIGHT MATNEY PHONE 75606		
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 139-87	THOMAS GUIDE LA 4107 J1	GRID NO.
DESIGN NO. 587144_0.01					
CSD 140 Y ___ N ___	BY-PASS CODE	EXISTING ___ CHANGE TO ___	TLM CHECKED ___ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 840939-INFRA REP - DET POLE RELACE		PRODUCT/SAP NO.		PRODUCT/SAP NO.	

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

PROPOSED CONSTRUCTION (LOCATION)
SCE – REPLACE DET POLE
'K' ST S/S, E/O 90TH ST EAST
LAKE LOS ANGELES

SHEET 1 OF 3

JOB NO. 587144_0.01

Southern California Edison Company