VICINITY MAP

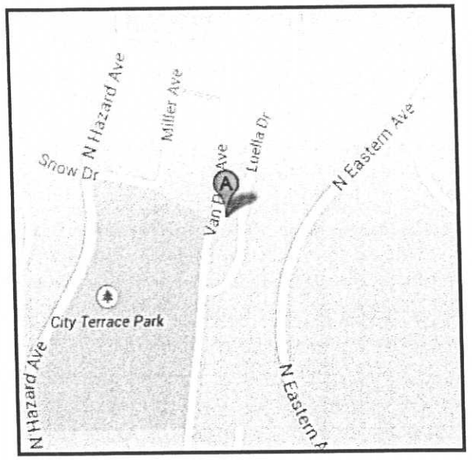

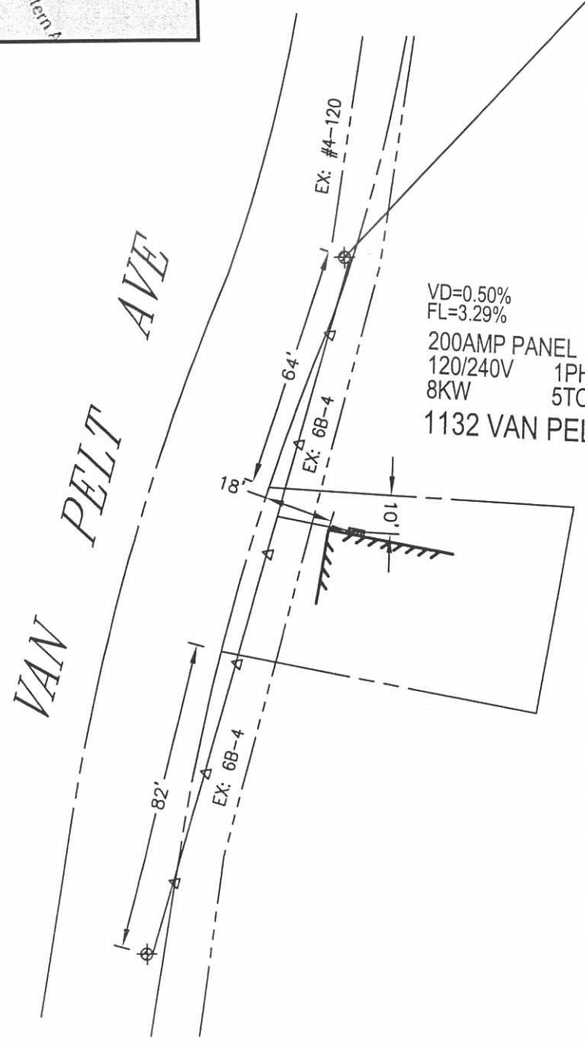

VD=0.50%
FL=3.29%

200AMP PANEL
120/240V 1PHASE
8KW 5TON

1132 VAN PELT AVE LOS ANGELES CA 90063

EXISTING 4390495E (1)
45' Class C4
RM: 1- TR OH 25KVA 2.4KV 120/240 1P
SN: _____
RM: 1- FE CO OPEN 100A 4KV 1-EA
IN: 1- TR OH 50KVA 2.4KV 120/240 1P
SN: _____
IN: 1- FE CO OPEN 100A 4KV 1-EA
RM: 191- CD #4 SOLID BARE CU 3/C
IN: CD 1/0 STR AL TRIPLEX W/ACSR NEUTR (POLE#495E TO #708E) 191' (1 runs)
IN: 6- SEC DE #4 SOL CU AUTO FLEX
IN: 2- SEC DE 1/0 ACSR TRI OR QUAD PREFORM
IN: CD 1/0 STR AL TRIPLEX W/ACSR NEUTR 22' (1 runs)
IN: 2- SEC PREFORM SERVICE 1/0 TRI OR QUAD
IN: 1- SEC SPACER- TRIPLEX
IN: 1- MTR KWH 30A 120/240 1P 3W
IN: 8- SEC ROLLER (166-CLEVIS & SPOOL)

TLM DATA:	4390495E			
	SIZE	kVA	CUST	%LOAD
EXIST:	25	39.4	12	157.6
PROP:	50	47.4	13	94.8
VD= 0.5		FLICKER= 4.9		

PROJECT REQUIREMENTS

EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
PERMIT REQUIRED	Y
PERMIT TYPE: ENCROACHMENT	
OUTAGE REQUIRED	Y
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 40'
0 40 80

ROGERS 4KV O/O TERRACE SUB

DISTRICT 22 – MONTEBELLO	PROJ. MGR. GONZALES, REGINA M PHONE 323-720-5298	PLANNER GONZALES, REGINA M PHONE 323-720-5298	
FOREMAN	TRUCK NO. / P/E / INVENTORY MAP NO. 130-4233-1	THOMAS GUIDE / GRID NO.	DESIGN NO. 636451_0.01
CSD 140 Y___ N___	BY-PASS CODE / EXISTING ___ CHANGE TO ___	TLM CHECKED ___ %LOAD / J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 914659-NEW METER & SERVICE	PRODUCT/SAP NO.	PRODUCT/SAP NO.	

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)
NEW METER & SERVICE
1132 VAN PELT AVE LOS ANGELES CA 90063
LOS ANGELES

SHEET 1 OF 1

JOB NO. 636451_0.01