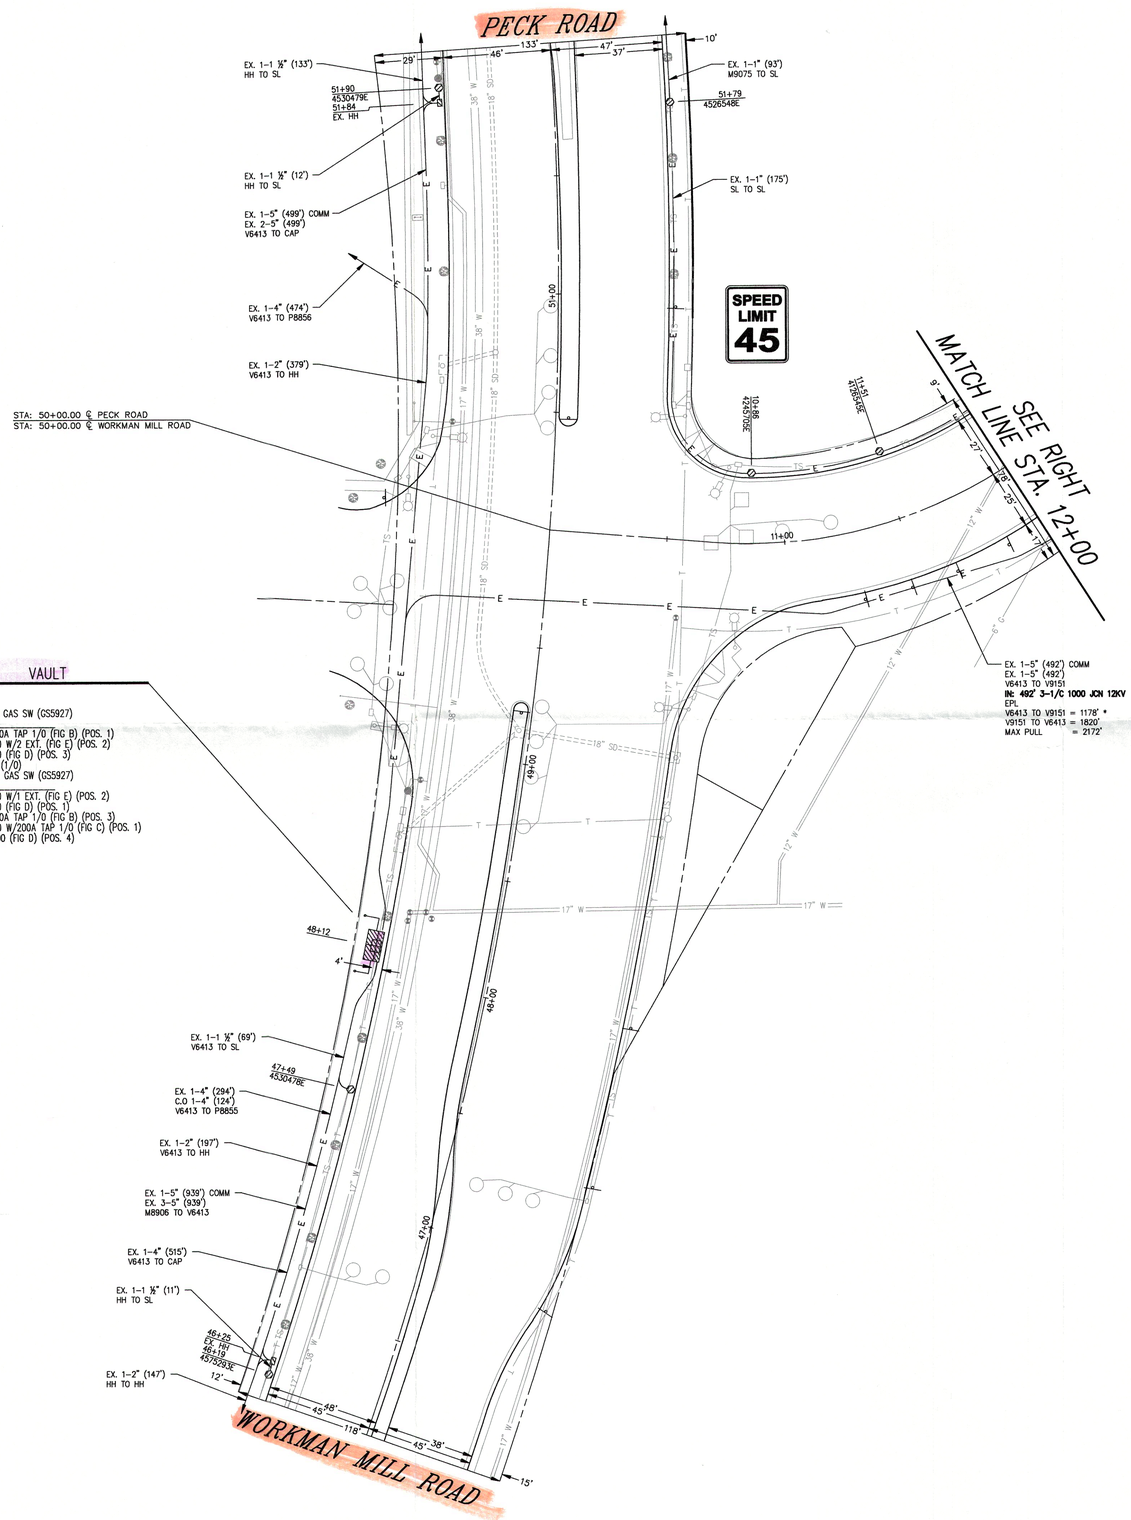

12 **EX: V5526413 VAULT**

6'x12'x7'
2-10" SP VENTS
RM: 1-600A 3WAY RAM GAS SW (GS5927)
SN:
3-600A EXT. W/200A TAP 1/0 (FIG B) (POS. 1)
3-600A ELBOW 350 W/2 EXT. (FIG E) (POS. 2)
3-600A ELBOW 750 (FIG D) (POS. 3)
4-200A DE ELBOW (1/0)
IN: 1-600A 4WAY RAM GAS SW (GS5927)
SN:
3-600A ELBOW 350 W/1 EXT. (FIG E) (POS. 2)
3-600A ELBOW 750 (FIG D) (POS. 1)
3-600A EXT. W/200A TAP 1/0 (FIG B) (POS. 3)
2-600A ELBOW 750 W/200A TAP 1/0 (FIG C) (POS. 1)
3-600A ELBOW 1000 (FIG D) (POS. 4)

EX: V5179151 VAULT 13

8'x14'x9'4"
2-10" SP VENT
EX: 1-50KVA XFMR
4-25KVA XFMR
1-5 WAY GAS SWITCH (GS0843)
RM: 3-600A ELBOW 750 (FIG D) (POS. 2)
IN: 3-600A 2WAY SPLICE T-BODY "A" (1000/750)
3-600A DE RECEP. W/TEST PT. (FIG A) (POS. 2)

SCALE: 1 in = 30 ft

0 30 60

LOCATION 3

SURVEYED
DATE: JUNE 2013

FINAL DESIGN
APPROVED FOR CONSTRUCTION

INVENTORY MAP NO.'S
114-4266-1
116-4266-1
116-4269-1

THOMAS GUIDE MAP NO.'S
LAC 676, G-2 J-3 J-2
LAC 677, A-2 A-3 D-6
LAC 637, C-7

UNDERGROUND SERVICE ALERT
Dial 811
Call USA
For Underground Locating
2 Working Days Before You Dig

DATE	REVISION DESCRIPTION	APPROVED	DRAWN	CHECKED
11/05/13	ADDED TO BASE PLAN; SECTION OF PIONEER BLVD: BEVERLY BLVD TO ORANGE GROVE		ASP	TT

DISTRICT: 22 – MONTEBELLO		PROJ. MGR. ADRIAN FLORES PHONE 714-255-6860		PLANNER REX BURBAGE PHONE 909-945-6722		CONTRACT PLANNER: BRIAN BRISCOE/ASP PHONE: 714-292-6889
FOREMAN		TRUCK NO.	P/E	INVENTORY MAP NO. SEE ABOVE	THOMAS GUIDE SEE ABOVE	GRID NO.
CSD 140 Y ___ N ___	BY-PASS CODE	EXISTING CHANGE TO	TLM CHECKED	%LOAD	J.P.A. NO.	SR NO. 1619960
PRODUCT/SAP NO. TD704560 - UG		PRODUCT/SAP NO. TD704562 - OH				DESIGN NO. 494480
						ASSOCIATED DESIGN NO. 494482
						PRODUCT/SAP NO.
P	11/01/13		BAM/ASP			PROPOSED CONSTRUCTION (LOCATION) 2015 DSP – ASTON 12KV o/o NARROWS SUB
B	07/19/13	S. GOUSA	BAM/ASP	52823		BEVERLY BLVD
TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #	PICO RIVERA / WHITTIER

Southern California Edison Company

SHEET 8 OF 9 | JOB NO. 0494480

0494480_1.dwg Plotted: Feb 04, 2014 11:21am burbogrl