CREW NOTES:

POLE TO BE SET IN SAME HOLE

PERMIT REQUIRED

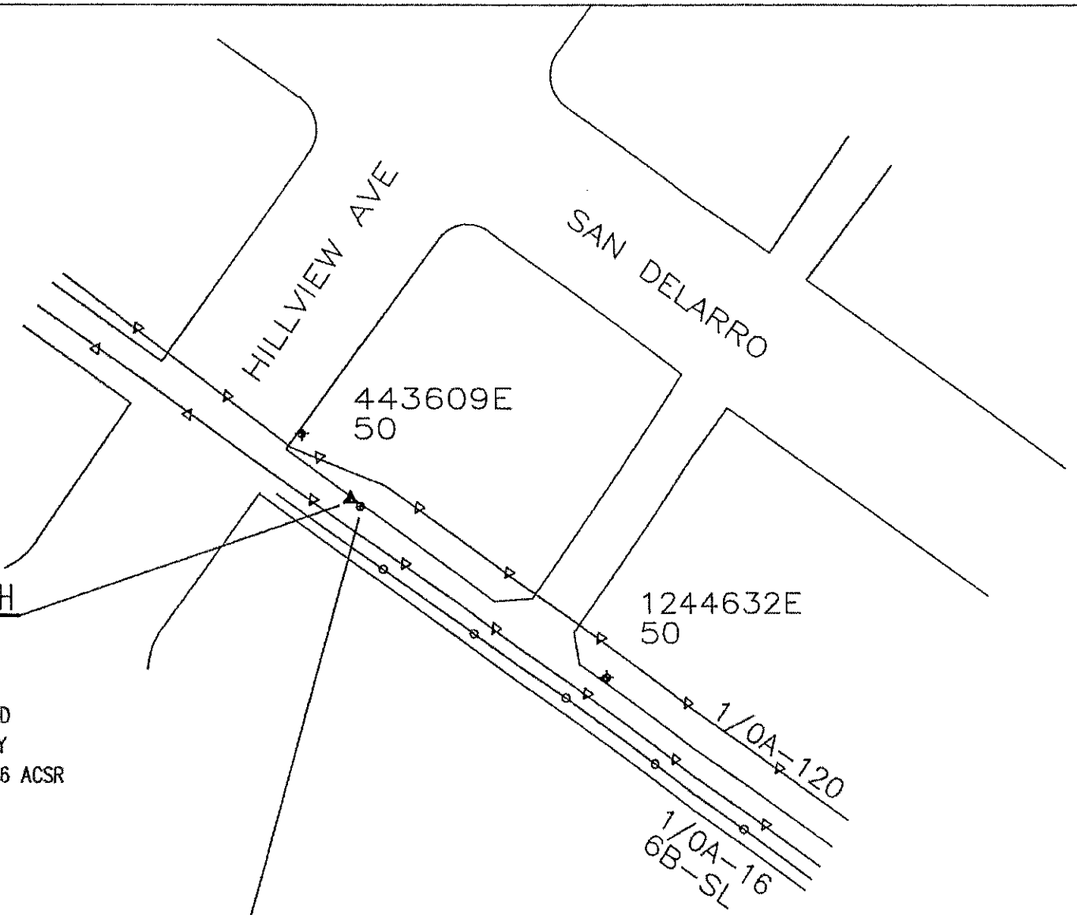

1 RM 96039H
45' Class C4
RM: 1- POLE 45' CLASS 4 WOOD FULL TREAT
RM: 1- XA DBLE VB 10' STEEL PINS
RM: 1- XA SNGL ALLEY ARM 10' W/BRC N/BOND
RM: 1- XA SNGL FB 10' STEEL PINS SECONDARY
RM: 4- INS POLY W/PIN 16(25)KV CLMP #4-336 ACSR
RM: 3- INS GLASS DE 16KV W/L-GUARD 1/0
RM: 7- SEC STEEL PIN & INS - PHASE
RM: 2- SEC STEEL PIN & INS - NEUTRAL
RM: 2- SEC END ARM RACK W/166 ROLLER
RM: 2- SEC ROLLER (166-CLEVIS & SPOOL)
RM: 1- SEC 2" PVC FOR UNDER ARM W/#2 TW
RM: 1- SL 70W HPS COBRA HD DROP W/6' ARM WD PL+

2 POLE 4712039E
45' Class C1
IN: 1- POLE 45' CLASS 1 WOOD FULL TREAT
IN: 1- XA DBLE FB 10' STEEL PINS
IN: 1- XA SNGL ALLEY ARM 10' W/BRC N/BOND
IN: 1- XA SNGL FB 10' STEEL PINS SECONDARY
IN: 6- INS POLY DE 16KV COLD 1/0 ACSR
IN: 3- SEC STEEL PIN & INS - PHASE
IN: 1- SEC STEEL PIN & INS - NEUTRAL
IN: 1- SEC END ARM RACK W/166 ROLLER
IN: 1- SEC ROLLER (166-CLEVIS & SPOOL)
IN: 1- SEC 2" PVC FOR UNDER ARM W/#2 TW
MI: 15- CD 1/0 STR AL BARE ACSR NON-GREASED
IN: 3- INS POLY W/PIN 16KV CLMP #4-653 ACSR
IN: 5- INS POLY W/PIN 12KV CLMP #6-4/0 CU
IN: 1- SL 70W HPS COBRA HD FLAT W/6' ARM WD PL+

***SCE TO PTD

HILLVIEW 4KV O/O AMALIA
BLANCHARD 16KV O/O REPETTO

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 60'
0 60 120

DISTRICT 22 - MONTEBELLO	PROJ. MGR. RODRIGUEZ, STEVE A PHONE 323-720-5268		PLANNER RODRIGUEZ, STEVE A PHONE 323-720-5268		
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 122-4242-1	THOMAS GUIDE 635 H6	GRID NO.
DESIGN NO. 547678_0.01					
CSD 140 Y___ N___	BY-PASS CODE	EXISTING ___ CHANGE TO ___	TLM CHECKED ___ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 780992-INFRA REP - DET POLE RELACE	PRODUCT/SAP NO.		PRODUCT/SAP NO.		

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)

XSTRT BEVERLY BLVD E/O HILLVIEW AVE
LOS ANGELES

SHEET 1 OF 1

JOB NO. 547678_0.01