*

TRANSMISSION POLES

PERMIT NEEDED

SOUTH SAN GABRIAL / LACO

Pole located c/s at address 7812 Graves AVE

MAT 29F – DETERIORATED POLE REPLACEMENT
(TRANSMISSION UNDERBUILD)
SAN GABRIEL
FLOC#: 1551658E & 1551659E

SINGLE LINE
PICADOR 16KV O/O
MESA

B2

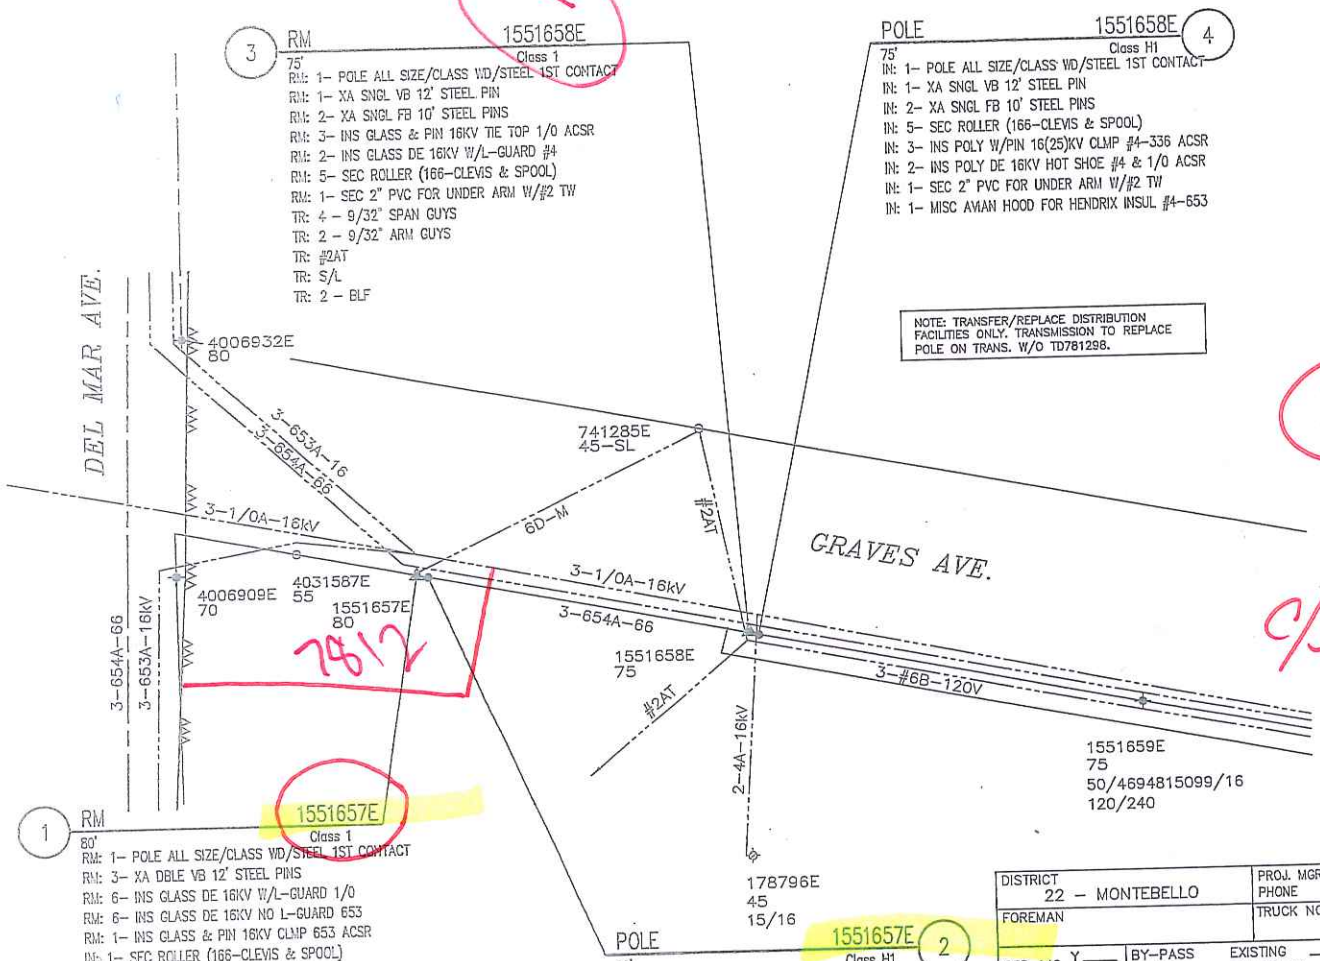

PROJECT REQUIREMENTS	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
PERMIT REQUIRED	Y
PERMIT TYPE: ENCROACHMENT	
OUTAGE REQUIRED	Y
TRAFFIC CONTROL REQUIRED	Y
PED. TRAFFIC CONTROL REQ'D	Y
CONVEYANCE LETTER REQ'D	N

P JS 6.2.14

C/S DIRT

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 50'
0 50 100

FINAL DESIGN
APPROVED FOR CONSTRUCTION

DISTRICT 22 – MONTEBELLO	PROJ. MGR. RODRIGUEZ, JOHN T. PHONE 626-437-9352	PLANNER HOWLAND, EDWARD LEE PHONE 909-238-7109		SR#: 1775699
FOREMAN	TRUCK NO. / P/E	INVENTORY MAP NO. 132-4257-1	THOMAS GUIDE LA 636-E3 / GRID NO. N/A	DESIGN NO. 580379_0.01
CSD 140 Y___ N___	BY-PASS CODE / EXISTING CHANGE TO	TLM CHECKED ___ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 831283-INFRA REP - DET POLE RELACE	PRODUCT/SAP NO.			PRODUCT/SAP NO.

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #
F	J. COMMERFORD	4/9/10	E. HOWLAND	E. HOWLAND	10817

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)
MAT 29F: DET POLE OH IR REPL
VARIOUS LOCATIONS
SAN GABRIEL, CA. 91770

SHEET 1 OF 1

JOB NO. 580379_0.01