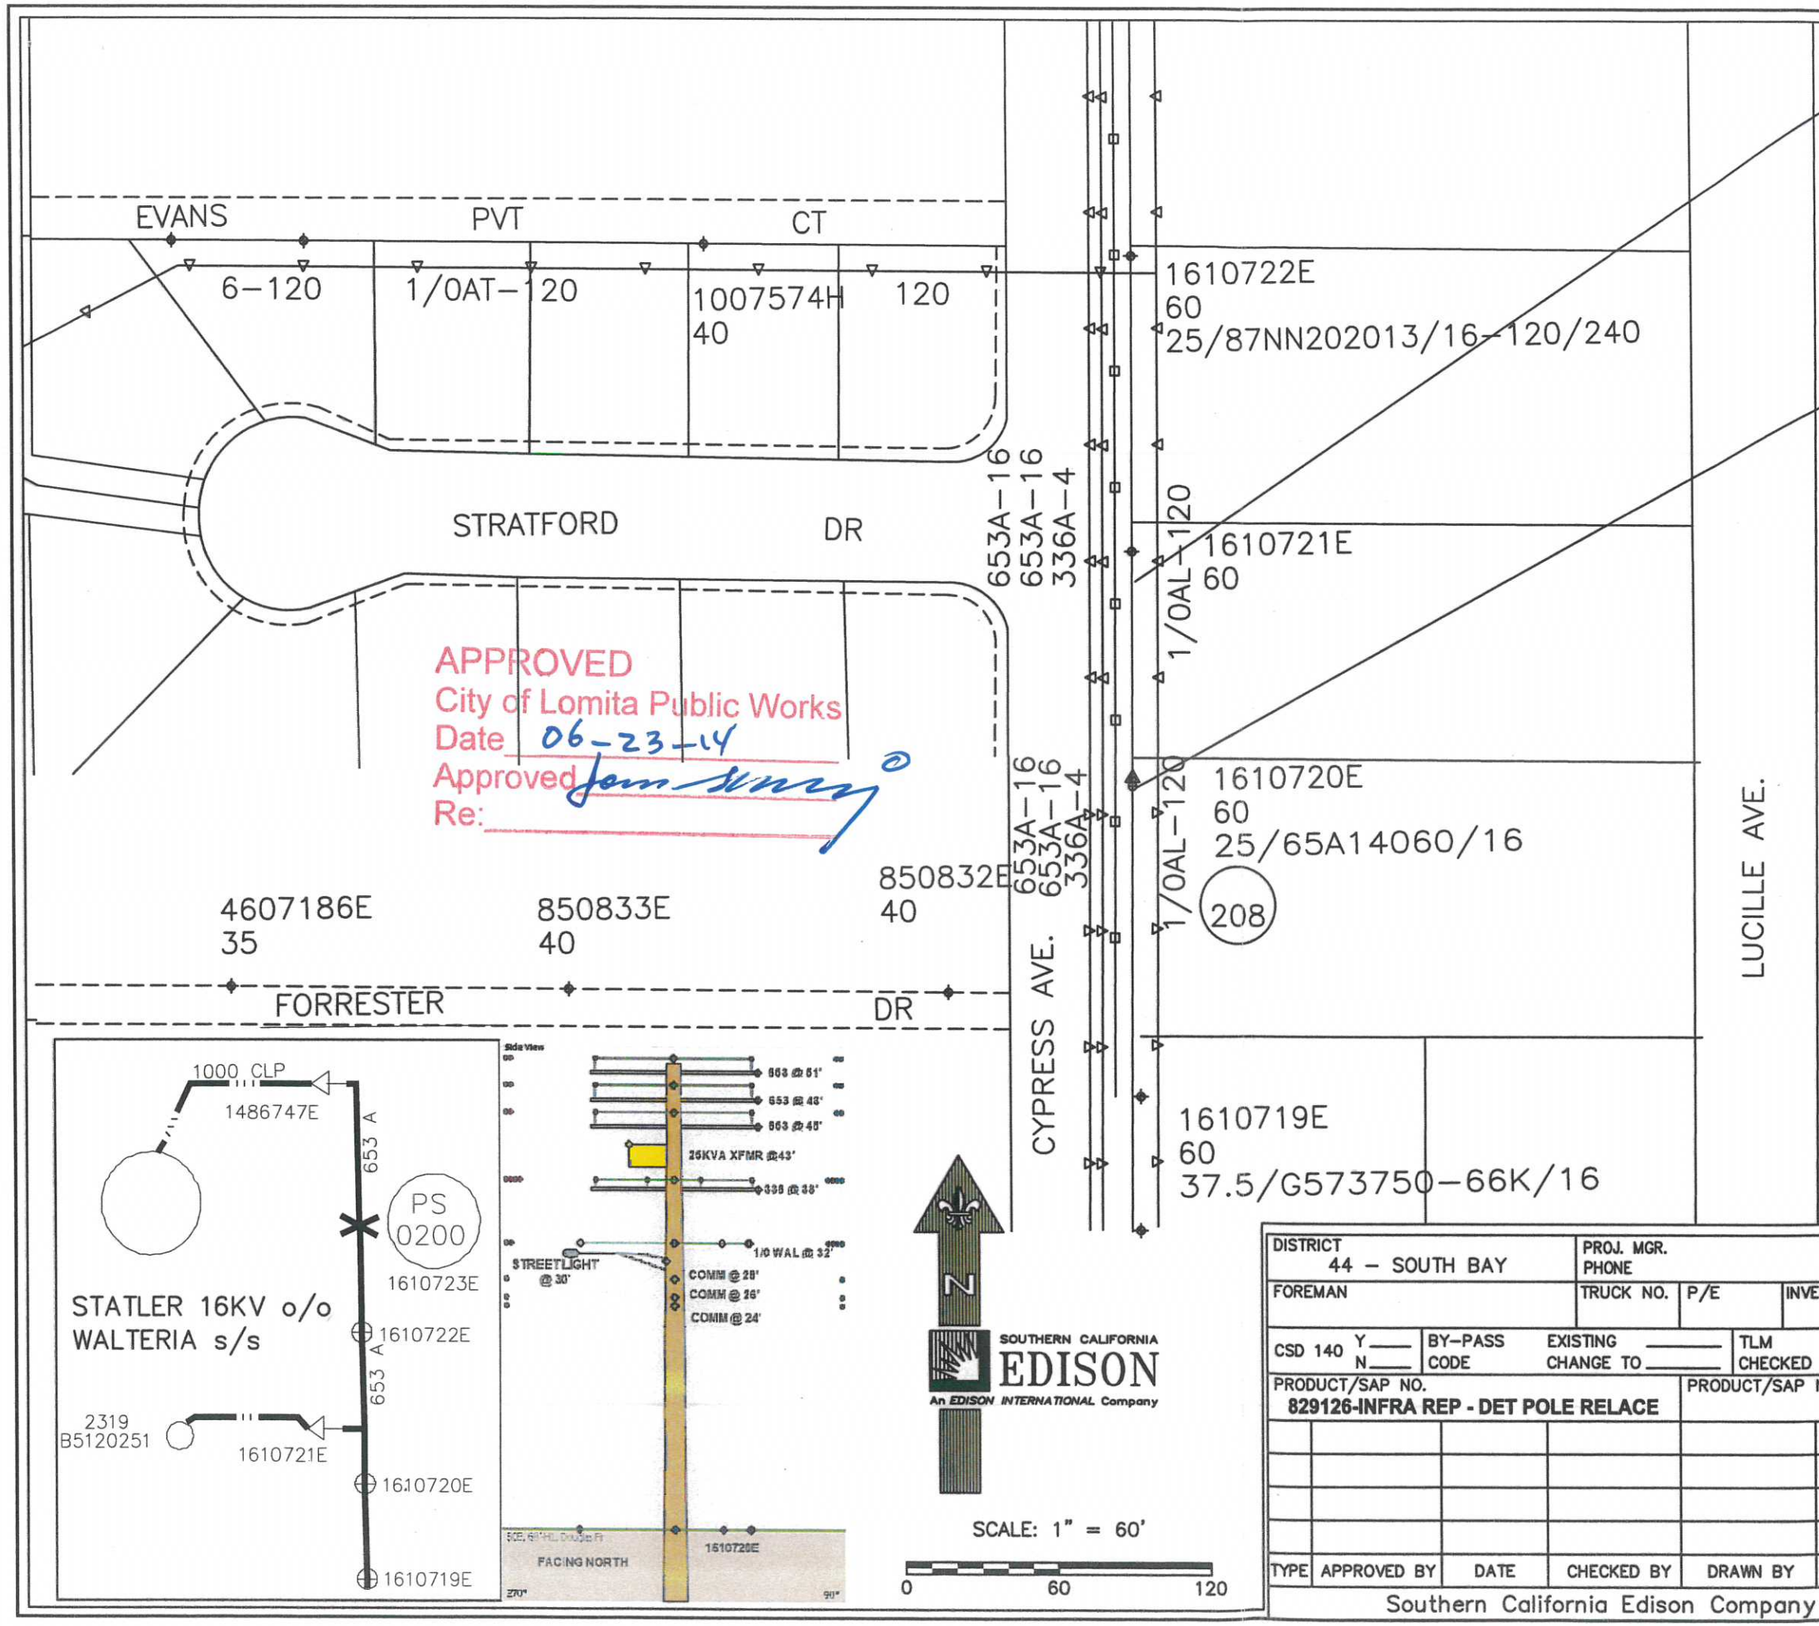

APPROVED
City of Lomita Public Works
Date 06-23-14
Approved
Re:

RM 1610720E (1)
60' Class C2
RM: 1- POLE 60' CLASS 2 WOOD FULL TREAT
RM: 4- XA SNGL FB 10' STEEL PINS
RM: 6- INS POLY W/PIN 16KV CLMP #4-653 ACSR
RM: 4- INS POLY W/PIN 16KV CLMP #4-336 WRACSR
RM: 1- TR OH 25KVA 16KV 120/240 1P
SN: _____
RM: 2- SEC 3-WIRE (284 RACK)

POLE 1610720E (2)
60' Class H1
IN: 1- POLE 60' CLASS H1 WOOD FULL TREAT
IN: 4- XA SNGL FB 10' STEEL PINS
IN: 12- INS POLY W/PIN 16KV CLMP #4-653 ACSR
IN: 4- INS POLY W/PIN 16KV CLMP #4-336 WRACSR
IN: 1- TR OH 25KVA 16KV 120/240 1P
SN: _____
IN: 2- SEC 3-WIRE (284 RACK)

TLM DATA:	SIZE	KVA	#CUST	%LOAD
EXIST	25	25.5	10	101.84%
PROP	25	25.5	10	101.84%
	VD =		FLICKER =	

NOTES:

- POLE IN FRONT OF 25606 CYPRESS AVE.
- HARD SET 1' TO THE SOUTH
- REPLACE POLE AND PCB TRANSFORMER.
- TRANSFER ALL SERVICES, SECONDARIES, AND STREET LIGHT.
- HARDSET POLE 1' SOUTH.
- TRUCK ACCESS AVAILABLE.
- PTC AND TRAFFIC CONTROL NEEDED.

DISTRICT 44 – SOUTH BAY	PROJ. MGR. PHONE			PLANNER BRIAN SMALL PHONE 310-783-9322	
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 32-67C	THOMAS GUIDE	GRID NO.	DESIGN NO. 578800_0.01
CSD 140 Y___ N___	BY-PASS CODE	EXISTING _____ CHANGE TO _____	TLM CHECKED _____ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 829126-INFRA REP - DET POLE RELACE		PRODUCT/SAP NO.		PRODUCT/SAP NO.	

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)
CYPRESS ST. E/S 393' N/O PCH
LOMITA

SHEET 1 OF 1

JOB NO. 578800_0.01