TLM DATA:	2184179E			
	SIZE	kVA	CUST	%LOAD
EXIST:	25	35.6	14	142.60
PROP:	50	35.6	14	71.2
VD= N/A		FLICKER= N/A		

1 EXISTING 2184179E

45' Class C3

RM: 1- TR OH 25KVA 16KV 120/240 1P

SN: _____

RM: 1- FE CO OPEN W/8' XA 100A 16KV 1P

RM: 1- GR OH #6 SOL WP SECONDARY W/ROD

IN: 1- TR OH 50KVA 16KV 120/240 1P

SN: _____

IN: 1- FE CO OPEN W/8' XA 100A 16KV 1P

IN: 1- GR OH #6 SOL WP SECONDARY W/ROD

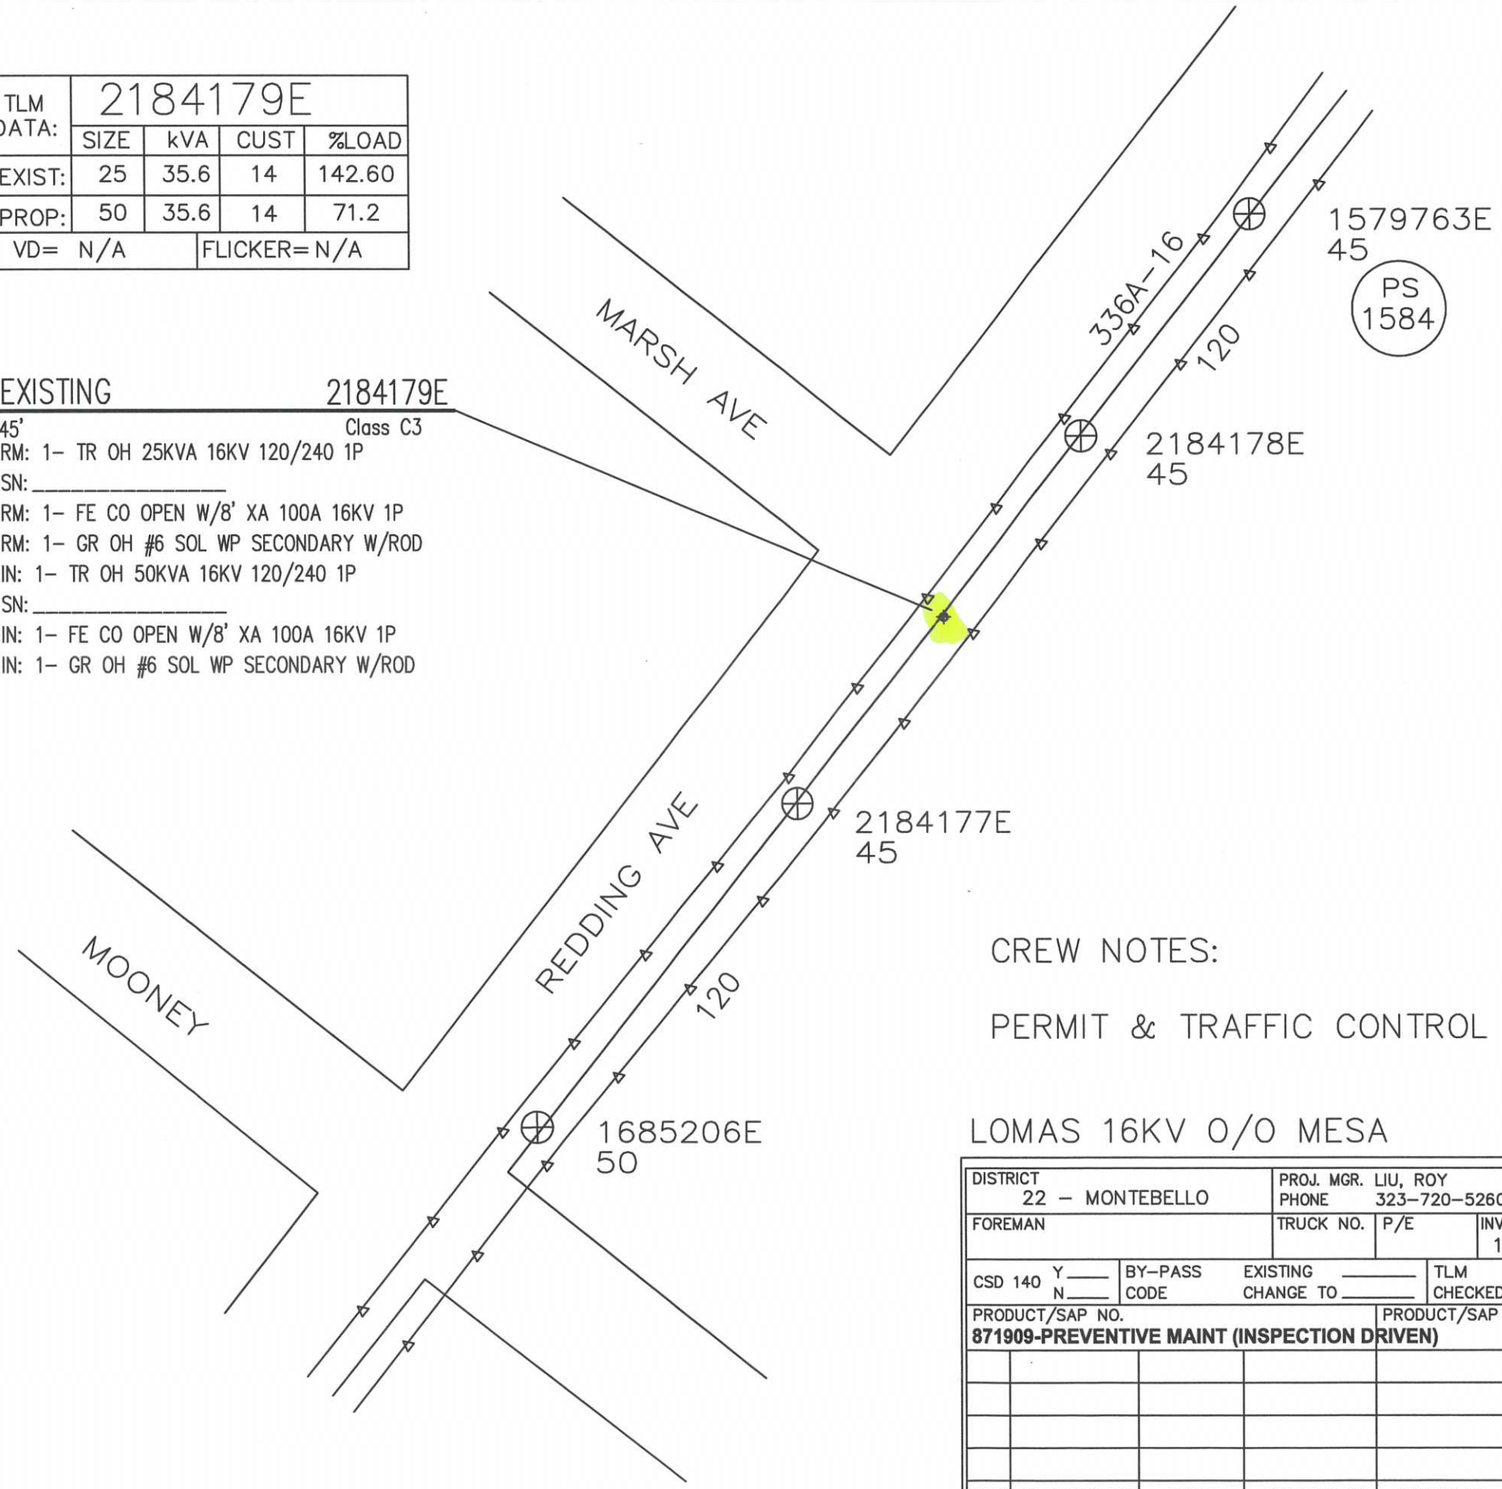

CREW NOTES:

PERMIT & TRAFFIC CONTROL REQUIRED

LOMAS 16KV O/O MESA

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 60'

0 60 120

DISTRICT 22 – MONTEBELLO	PROJ. MGR. LIU, ROY PHONE 323-720-5260		PLANNER LIU, ROY PHONE 323-720-5260		
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 130-4257-1	THOMAS GUIDE 636 E4	GRID NO.
DESIGN NO. **607545_0.01**					
CSD 140 Y____ N____	BY-PASS CODE	EXISTING _____ CHANGE TO _____	TLM CHECKED _____ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. **871909-PREVENTIVE MAINT (INSPECTION DRIVEN)**		PRODUCT/SAP NO.		PRODUCT/SAP NO.	

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)

1822 REDDING
ROSEMEAD

SHEET 1 OF 1

JOB NO. 607545_0.01

0
2184179E