2 POLE 1830949E
45' Class C3
IN: 1- POLE 45' CLASS 3 WOOD FULL TREAT
IN: 1- TR OH 25KVA 16KV 120/240 1P
SN: _____
IN: 1- FE CO MNT FOR ELF W/8' XA 100A 16KV 1P
IN: 2- FE FUSE ELF 15KV 6A
IN: 2- SA POLY NO PRI-N 16KV 1-EA
IN: 1- INS GLASS DE 16KV W/L-GUARD #4
IN: 1- GR OH #6 SOL WP SECONDARY W/ROD
IN: 1- SEC END ARM RACK WITH 3 SPOOL RACK

1 RM 1830949E
40' Class C5
RM: 1- POLE 40' CLASS 5 WOOD FULL TREAT
RM: 1- TR OH 15KVA 16KV 120/240 1P
SN: _____
RM: 1- FE CO OPEN W/8' XA 100A 16KV 1P
RM: 2- SA POLY NO PRI-N 16KV 1-EA
RM: 2- INS GLASS DE 16KV W/L-GUARD #4
RM: 1- GR OH #6 SOL WP SECONDARY W/ROD
RM: 1- SEC END ARM RACK WITH 3 SPOOL RACK

TLM DATA:	1830949E			
	SIZE	kVA	CUST	%LOAD
EXIST:	15	11.9	1	79.31
PROP:	25	11.9	1	47.6
VD= N/A		FLICKER=N/A		

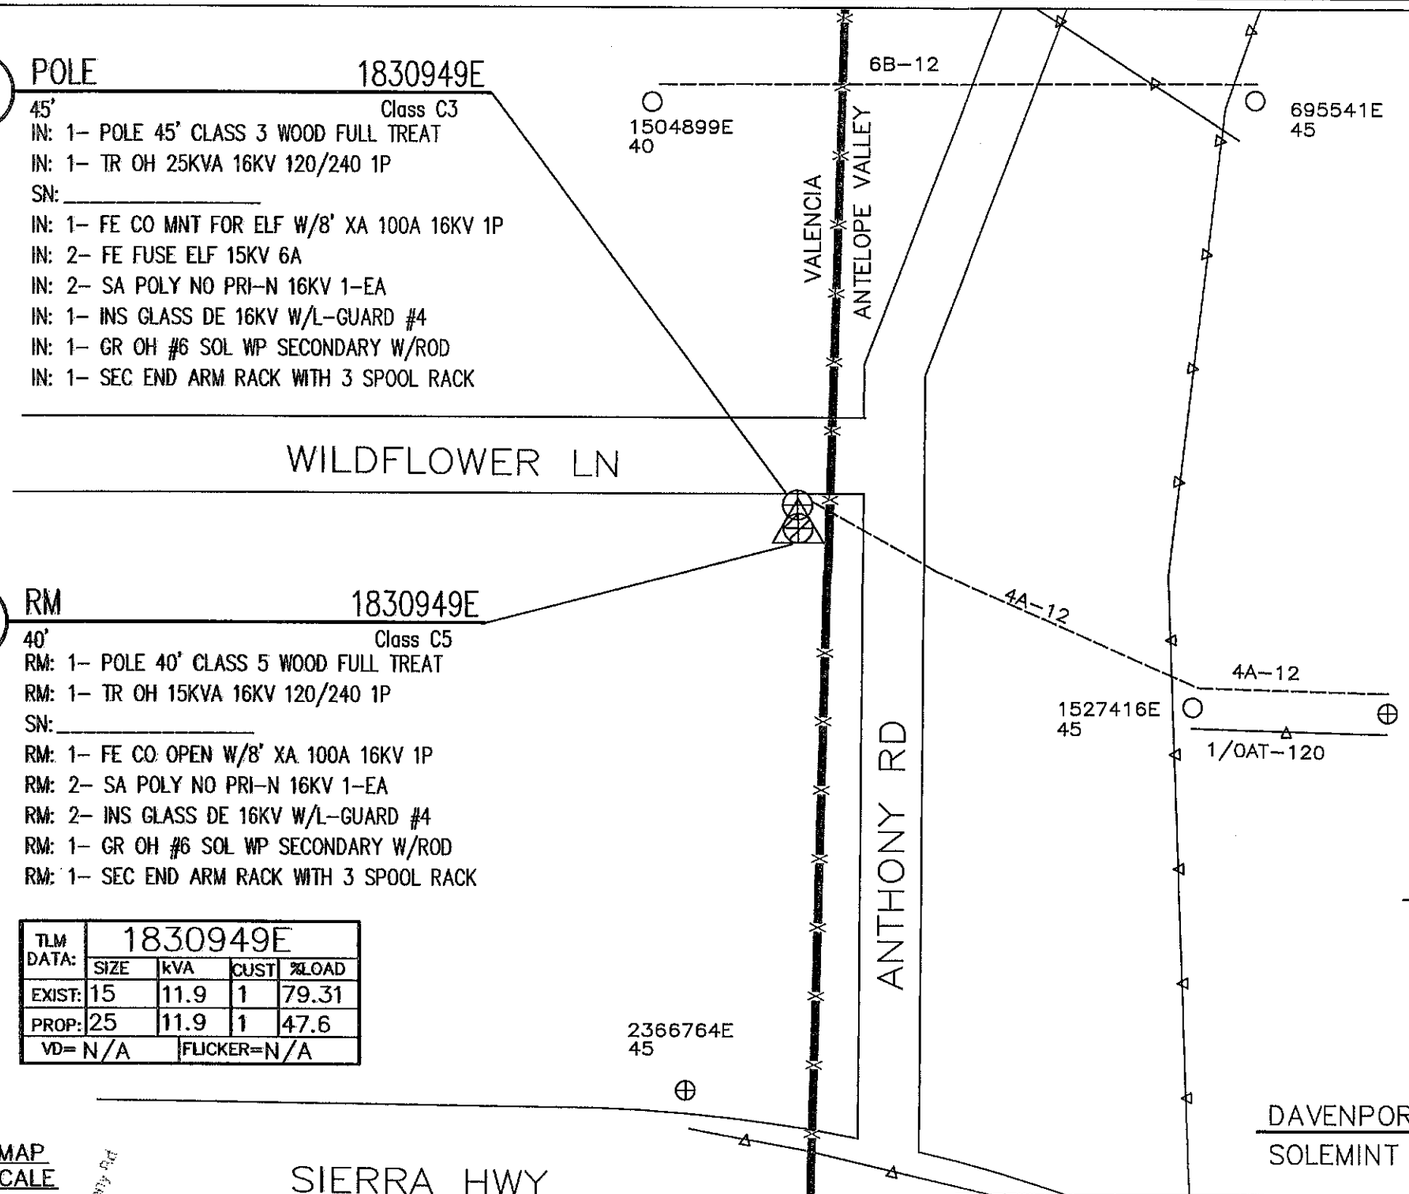

PROJECT REQUIREMENTS	
ENVIRONMENTAL REQUIRED	N
EDISON EASEMENT REQUIRED	N
LEASE AGREEMENT REQUIRED	N
PWRD 88 REQUIRED	N
PERMIT REQUIRED	N
OUTAGE REQUIRED	Y
TRAFFIC CONTROL REQUIRED	N
PED. TRAFFIC CONTROL REQ'D	N
CONVEYANCE LETTER REQ'D	N

POLE DETAILS	
JOINT POLE	Y
RENTER	N
MITC FUME	N
JOINT MEET	N
TRUCK ACCESS	Y
HAND SET	N
CONTACT CATV	N

GPS COORDINATES
34° 31' 15.69" N
118° 16' 55.74" W

NOTES:
-NO PTC
-NO PERMIT
-NO ENVIRONMENTAL
-HARDSET NORTH
-TRANSFER CONDUCTORS
-TRANSFER COMM
-SCE TO PTD

N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

DAVENPORT 16KV
SOLEMINT

A1

SCALE: 1" = 100'
0 100 200

VICINITY MAP
NOT TO SCALE

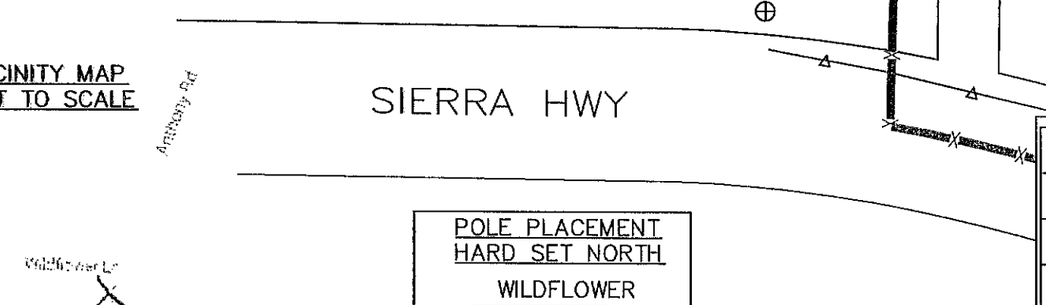

POLE PLACEMENT
HARD SET NORTH



DISTRICT 59 – VALENCIA	PROJ. MGR. CARDOZA, KYLE PHONE		PLANNER CARDOZA, KYLE PHONE 661-257-8251		
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 121-70	THOMAS GUIDE 4374-A2	GRID NO.
DESIGN NO. 601551_0.01					
CSD 140 Y ___ N ___	BY-PASS CODE	EXISTING ___ CHANGE TO ___	TLM CHECKED ___ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 862846-INFRA REPLACEMENT PLP	PRODUCT/SAP NO.		PRODUCT/SAP NO.		

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #
F		8/28/14		APRIL KOZAR	71242

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)
2014 DET POLE 1830949E
VARLOC (6) DET POLES
AGUA DULCE

SHEET ___ OF ___

JOB NO. 601551_0.01