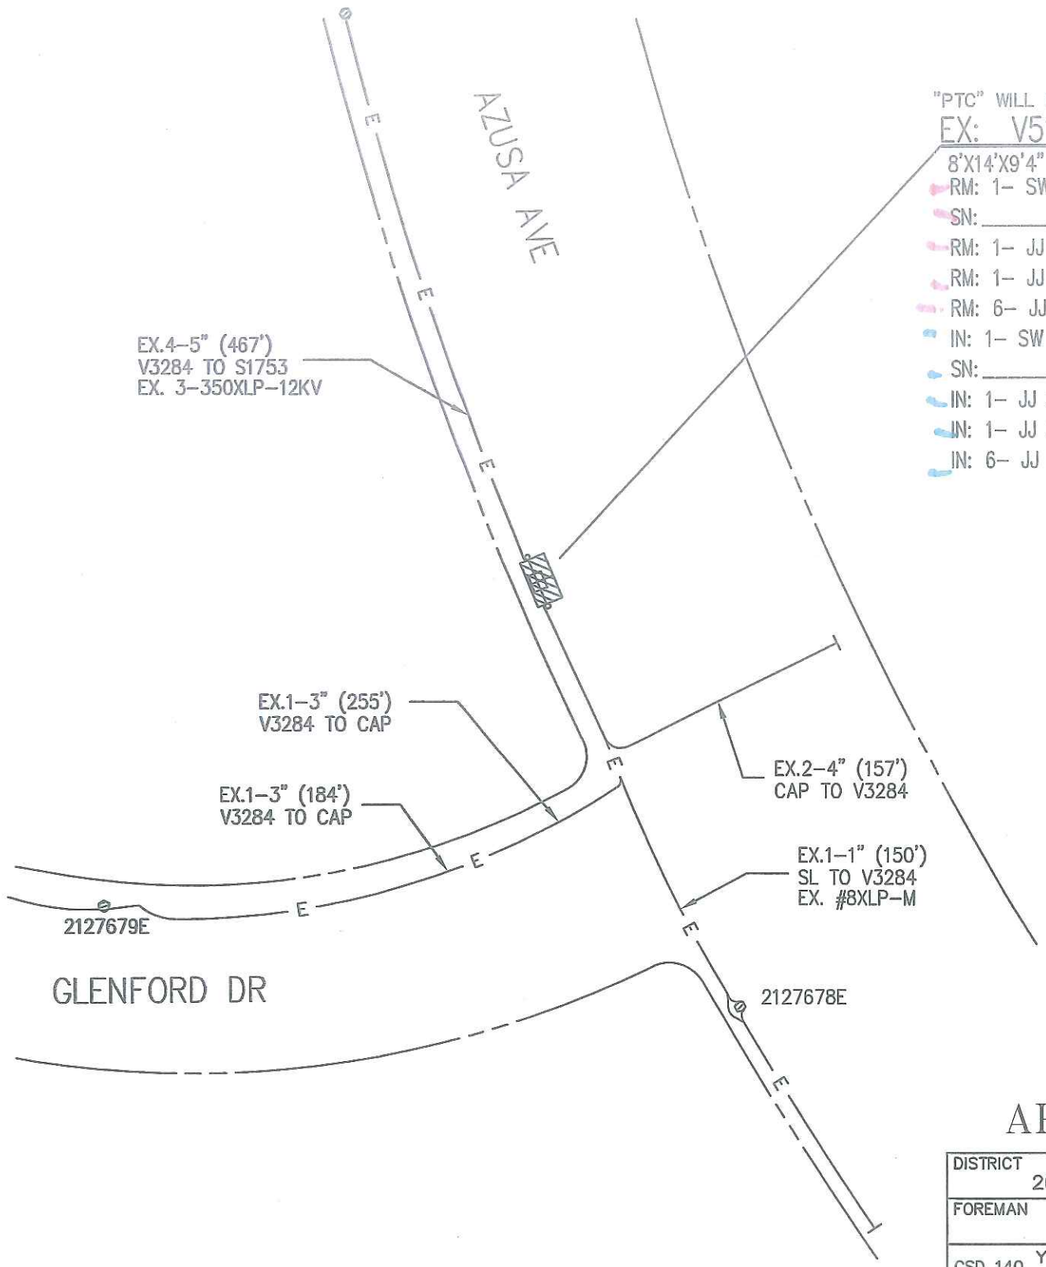

"PTC" WILL BE REQ'D-USE SCENARIO #7

EX: V5164884 VAULT 1

8'X14'X9'4" Tub TUB STYLE

RM: 1- SW UG OIL 4-WY RAM 600A 15KV(OS2168)

SN: _____

RM: 1- JJ 3-DBE 350 600A(POS 4)

RM: 1- JJ 3-DBE 1000 600A(POS 1)

RM: 6- JJ DE DB RCPT INS W/TST PNT 600A(POS 2,3)

IN: 1- SW UG SF6 LB 4-WY 600A 15KV(GS2168)

SN: _____

IN: 1- JJ 3-DBE 350 600A(POS 4)

IN: 1- JJ 3-DBE 1000 600A(POS 1)

IN: 6- JJ DE DB RCPT INS W/TST PNT 600A(POS 2,3)

PROJECT REQUIREMENTS	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
PERMIT REQUIRED	Y
PERMIT TYPE: PER CITY REQMTS	
OUTAGE REQUIRED	Y
TRAFFIC CONTROL REQUIRED	Y
PED. TRAFFIC CONTROL REQ'D	Y
CONVEYANCE LETTER REQ'D	N

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

FINAL DESIGN
APPROVED FOR CONSTRUCTION

SCALE: 1" = 50'

0 50 100

DISTRICT 26 - COVINA	PROJ. MGR. BACH, STEPHEN PHONE 714-796-9862		PLANNER WILTIZ, YAPHET PHONE 714-893-2405		TECH PLANNER ANGULO, EVERARDO PHONE 909-944-4485
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 106-4306-5	THOMAS GUIDE	GRID NO. / DESIGN NO. 511465_0.01
CSD 140 Y___ N___	BY-PASS CODE	EXISTING ___ CHANGE TO ___	TLM CHECKED ___ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 728326-INFRA REPLACEMENT(SW GEAR)	PRODUCT/SAP NO.				PRODUCT/SAP NO.

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #
F	TECH PLANNER	11/13/13	TECH PLANNER	E. ANGULO	10685
		10-25-13		VH-ASP	

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)
GATLIN 12KV% WALNUT SUB
XSTRT W/S AZUSA BL. N/O GLENFOLD DR
HACIENDA HEIGHTS

SHEET 2 OF 2

JOB NO. 511465_0.01