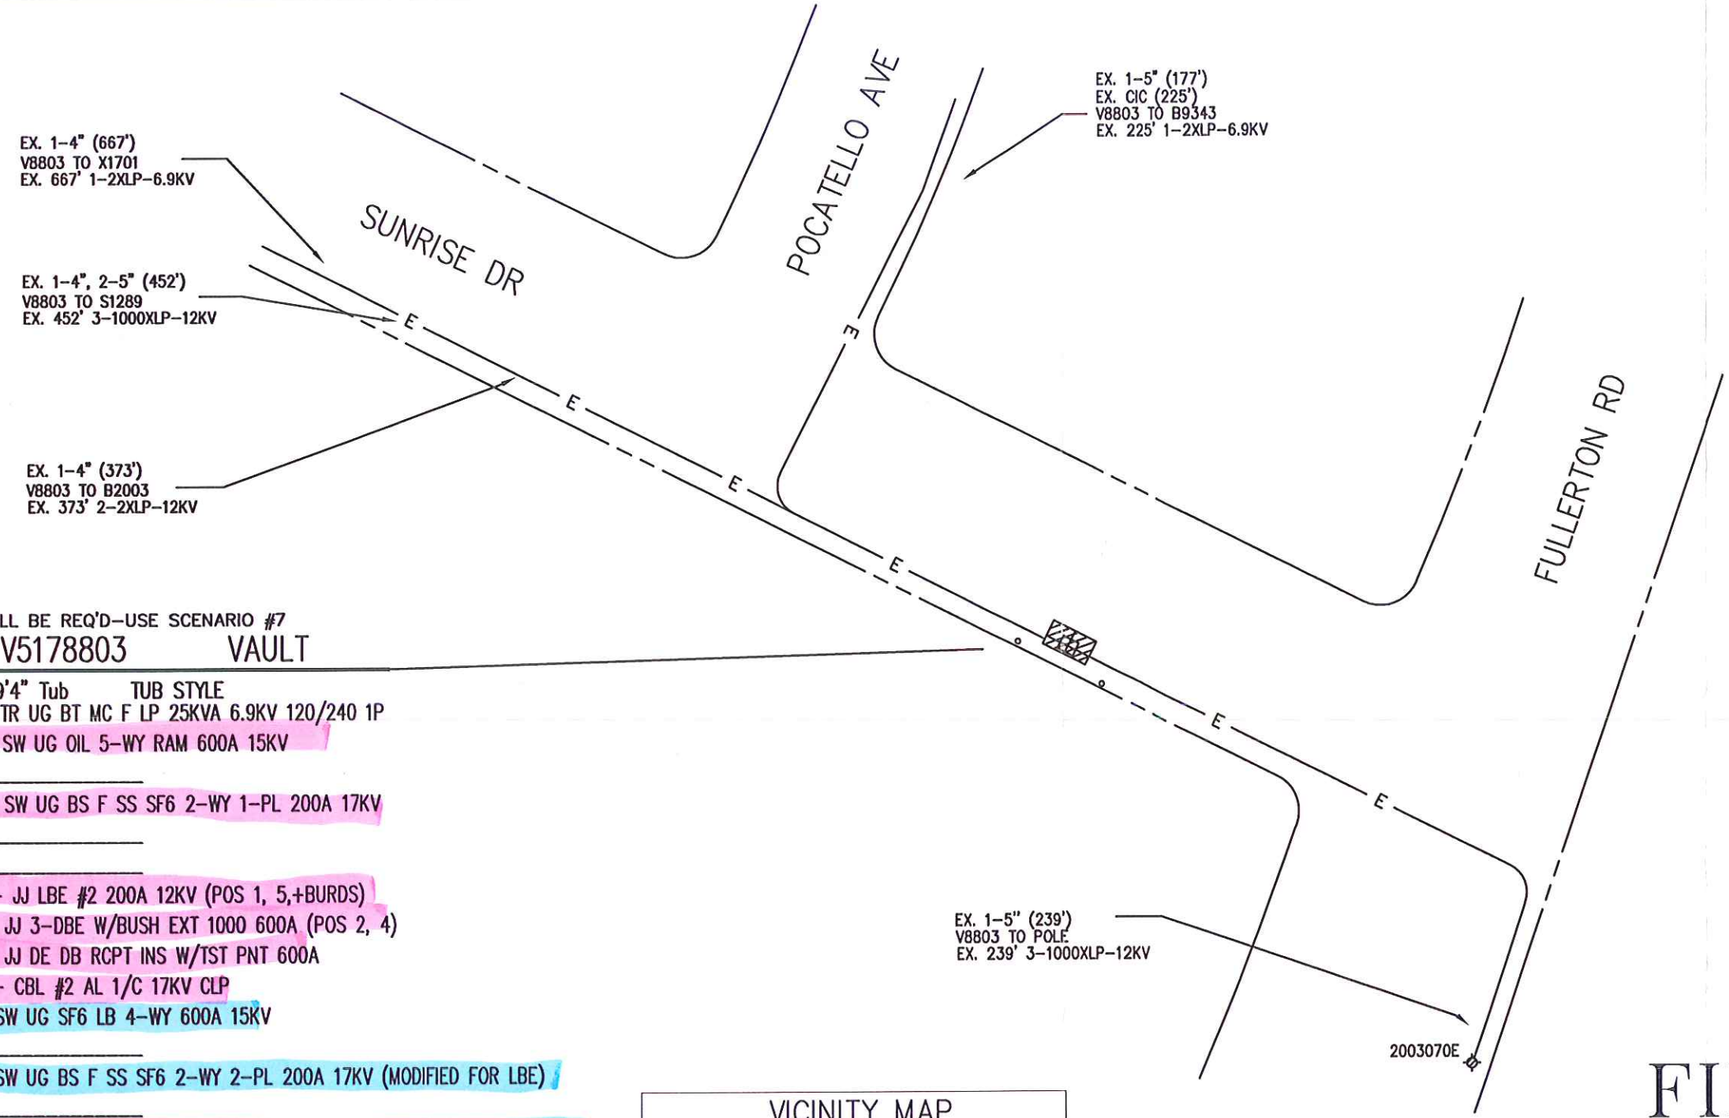

PROJECT REQUIREMENTS	
EDISON EASEMENT REQUIRED	N
PWRD 88 REQUIRED	N
PERMIT REQUIRED	Y
PERMIT TYPE: PER CITY REQMTS	
OUTAGE REQUIRED	Y
TRAFFIC CONTROL REQUIRED	Y
PED. TRAFFIC CONTROL REQ'D	Y
CONVEYANCE LETTER REQ'D	N

"PTC" WILL BE REQ'D-USE SCENARIO #7

1 EX: V5178803 VAULT

8'X14'X9'4" Tub TUB STYLE
EX: 1- TR UG BT MC F LP 25KVA 6.9KV 120/240 1P
RM: 1- SW UG OIL 5-WY RAM 600A 15KV
SN:
RM: 2- SW UG BS F SS SF6 2-WY 1-PL 200A 17KV
SN:
SN:
RM: 12- JJ LBE #2 200A 12KV (POS 1, 5,+BURDS)
RM: 2- JJ 3-DBE W/BUSH EXT 1000 600A (POS 2, 4)
RM: 3- JJ DE DB RCPT INS W/TST PNT 600A
MR: 20- CBL #2 AL 1/C 17KV CLP
IN: 1- SW UG SF6 LB 4-WY 600A 15KV
SN:
IN: 1- SW UG BS F SS SF6 2-WY 2-PL 200A 17KV (MODIFIED FOR LBE)
SN:
IN: 2- JJ DBE 1/0 200A W/BUSH EXT 1/0 600A (POS 3) (MODIFIED FOR LBE)
IN: 2- JJ DBE #2 200A W/BUSH EXT #2 600A (POS 2, 3) (MODIFIED FOR LBE)
IN: 2- JJ 3-DBE 1000 600A (1, 4)
IN: 1- JJ LBE #2 200A 12KV
IN: 4- JJ LBE 1/0 200A 12KV
IN: 2- JJ DE DB RCPT INS W/TST PNT 600A (POS 2)
IN: 15- SL CBL HOOK COMP 20"
MI: 40- CBL 1/0 AL 1-1/C 17KV CLP PJ

Install
Remove

SOUTHERN CALIFORNIA EDISON
An EDISON INTERNATIONAL Company

SCALE: 1" = 50'
0 50 100

VICINITY MAP

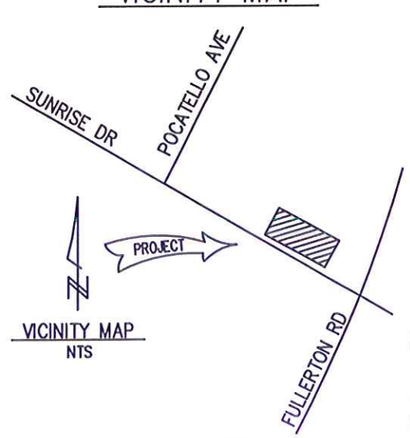

VICINITY MAP
NTS

FINAL DESIGN
APPROVED FOR CONSTRUCTION

DISTRICT 26 – COVINA	PROJ. MGR. BACH, STEPHEN PHONE 714-796-9862		PLANNER QUEZADA, MICHAEL PHONE 714-893-2405		TECH PLANNER ANGULO, EVERARDO PHONE 909-944-4485
FOREMAN	TRUCK NO.	P/E	INVENTORY MAP NO. 102-4314-0	THOMAS GUIDE LA 678-J7	GRID NO.	DESIGN NO. 511472_0.01
CSD 140 Y___ N___	BY-PASS CODE	EXISTING ___ CHANGE TO ___	TLM CHECKED ___ %LOAD	J.P.A. NO.	ASSOCIATED DESIGN NO.
PRODUCT/SAP NO. 728337-INFRA REPLACEMENT(SW GEAR)	PRODUCT/SAP NO.		PRODUCT/SAP NO.		

TYPE	APPROVED BY	DATE	CHECKED BY	DRAWN BY	PAX #
F	TECH PLANNER	12/01/13	TECH PLANNER	ASPLUNDH	10685
		11-07-13		MQ	
		11-04-13		YW-ASP	

Southern California Edison Company

PROPOSED CONSTRUCTION (LOCATION)
SWITCH REPL\ MALLETT12KV O/O RAILROAD
SUNRISE DR. W/O FULLERTON RD
ROWLAND HEIGHTS

SHEET 2 OF 2

JOB NO. 511472_0.01