

**2013-2014 Dry Weather WQO Ratios
for S01 Ballona Creek at Sawtelle Blvd.**

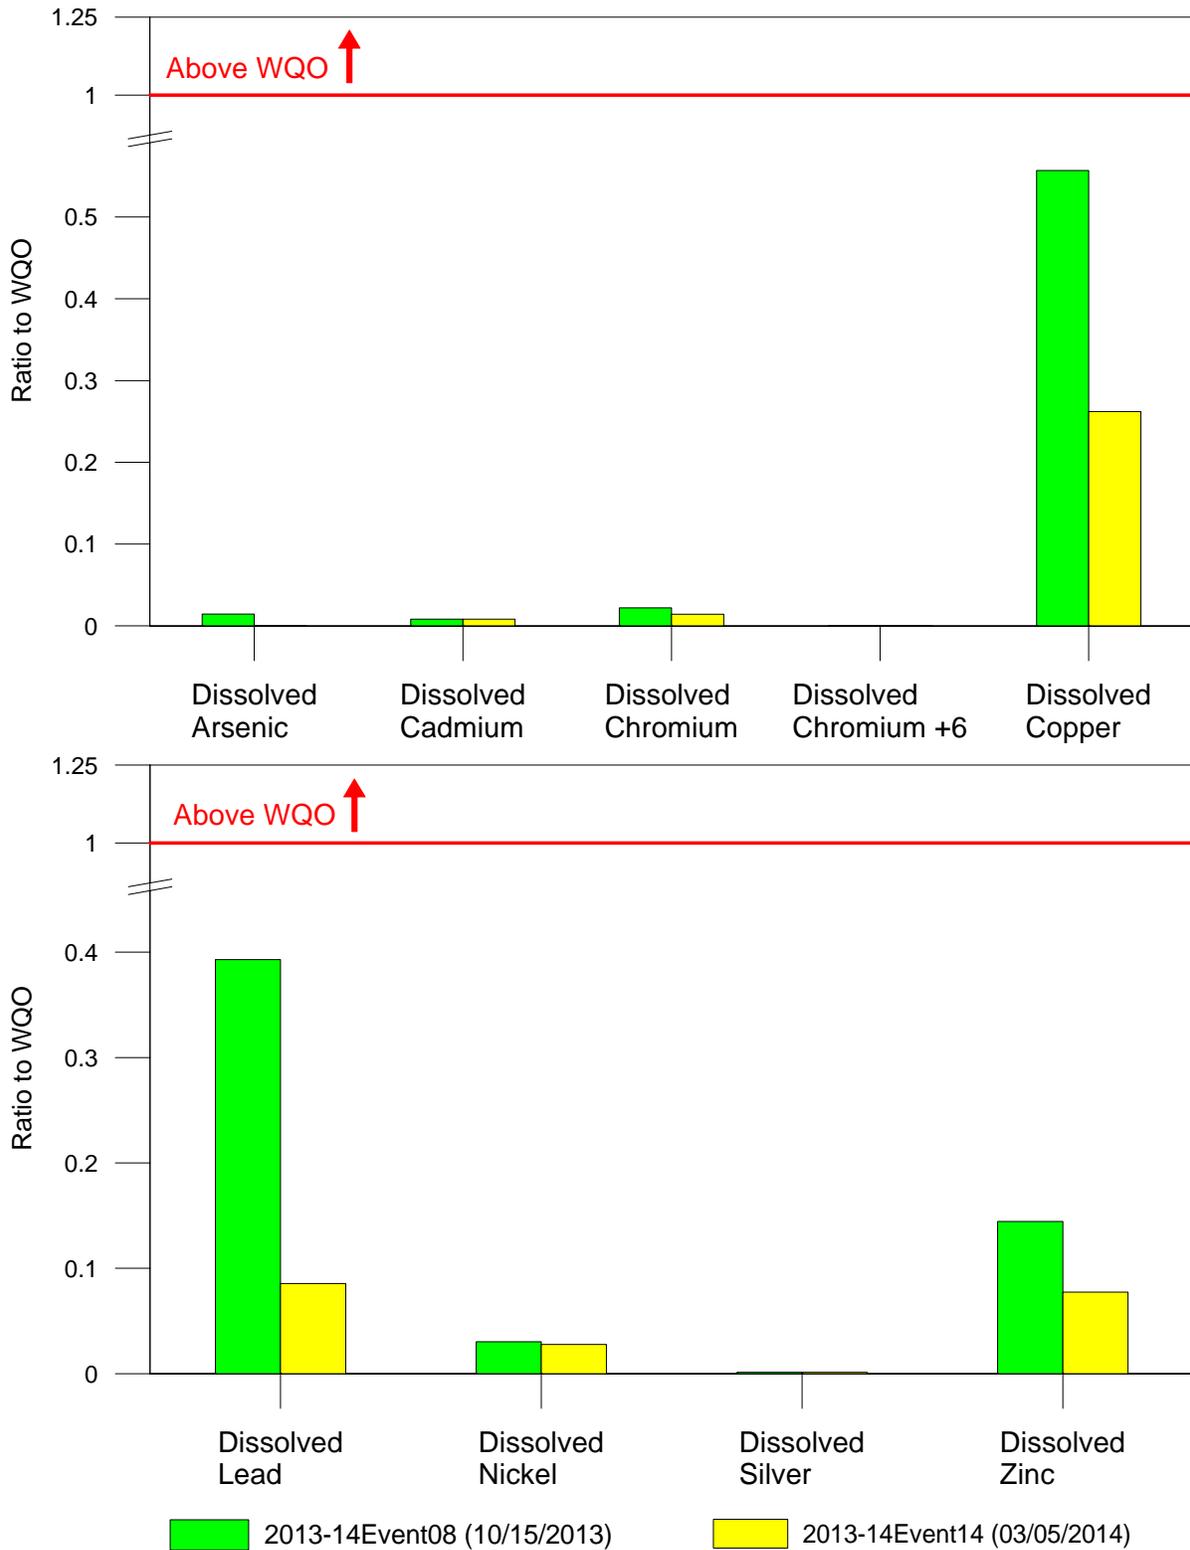


Figure 4-5.1 S01 Ballona Creek at Sawtelle Blvd Dry Weather Ratio Plots

2013-2014 Dry Weather WQO Ratios
for S01 Ballona Creek at Sawtelle Blvd.


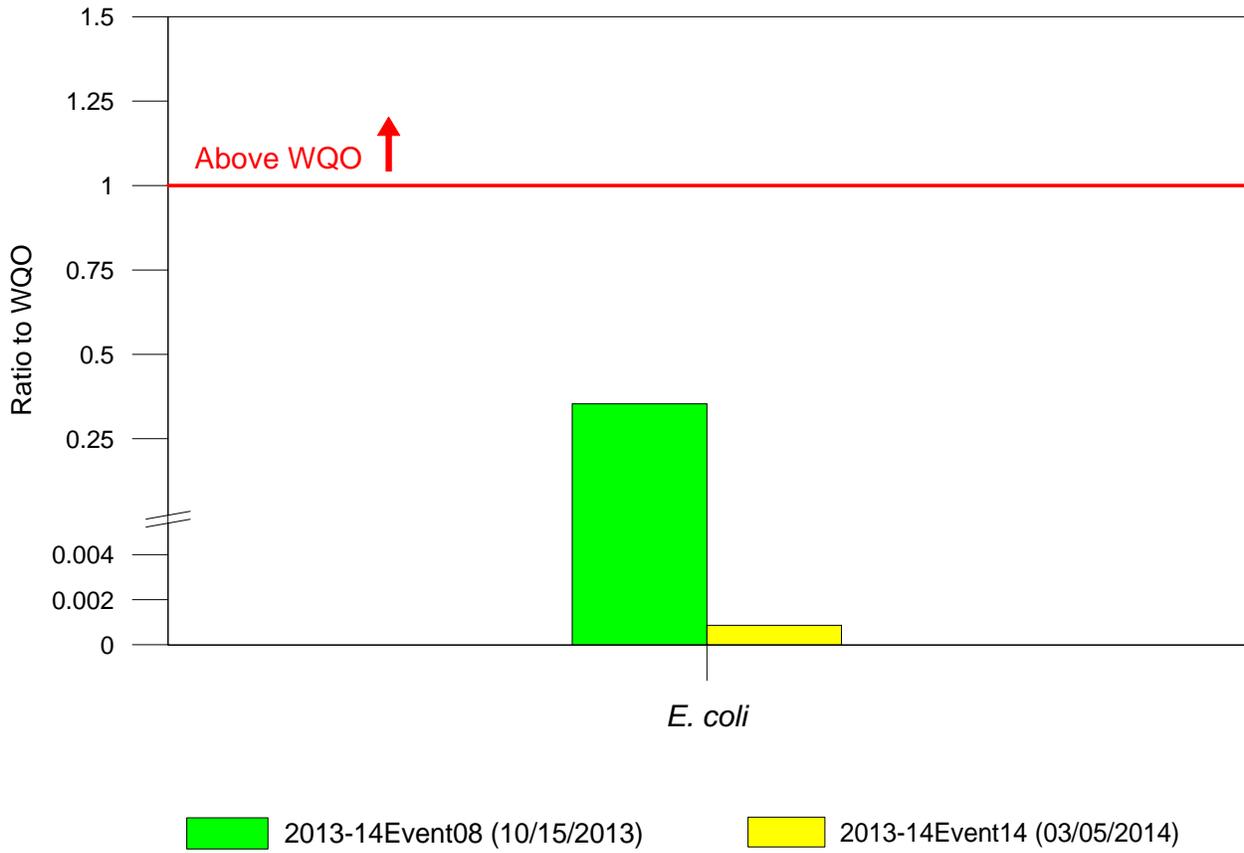


Figure 4-5.1 S01 Ballona Creek at Sawtelle Blvd Dry Weather Ratio Plots

**2013-2014 Dry Weather WQO Ratios
for S01 Ballona Creek at Sawtelle Blvd.**

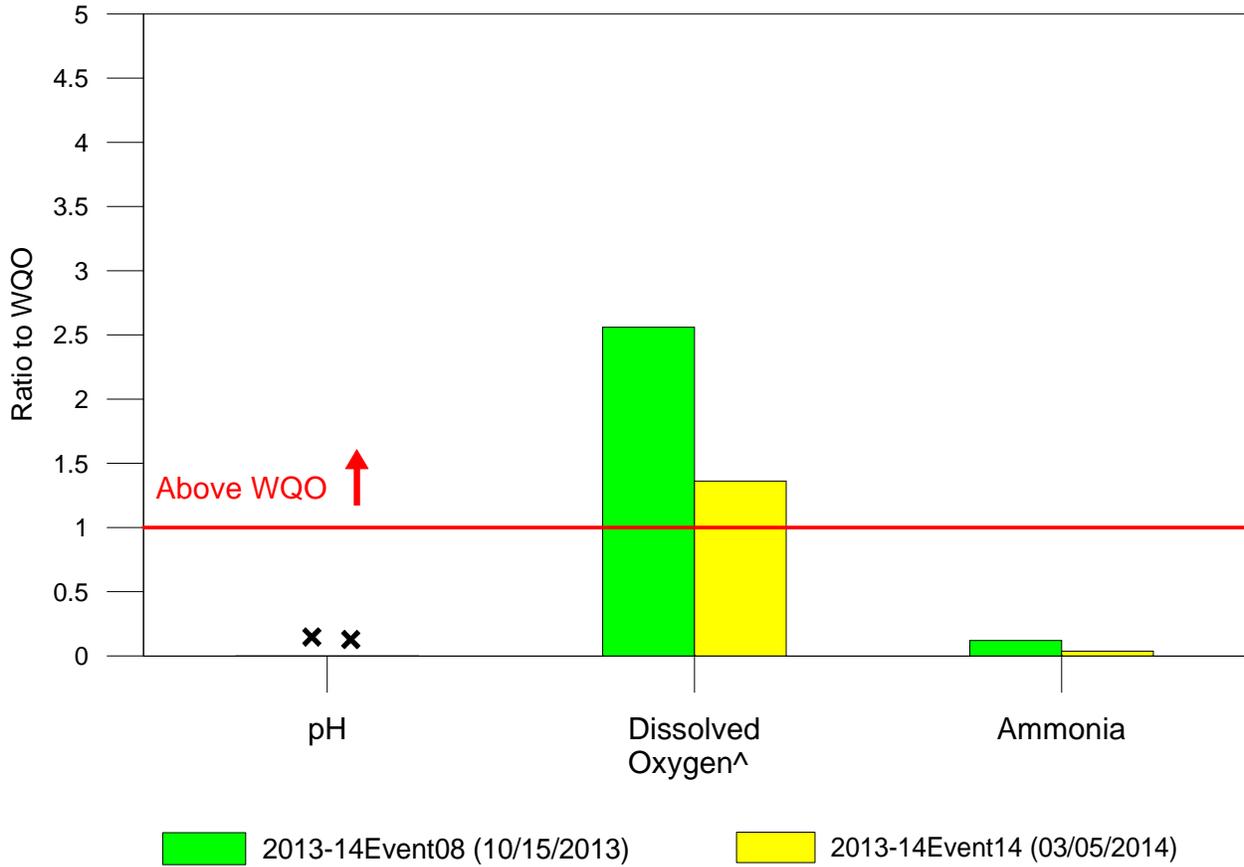

[^]Dissolved oxygen is an exceedance if ratio to WQO is below 1.

× pH was within WQO range.

Figure 4-5.1 S01 Ballona Creek at Sawtelle Blvd Dry Weather Ratio Plots